

# NHAN LE'S RESIDENCE

## 1154 D ST HAYWARD, CA 94541

### ADU Unit A

#### STRUCTURAL GENERAL NOTES

##### A. GENERAL

1. ALL WORK SHALL CONFORM TO CURRENT 2022 CBC, CBC, CMC, CPC, 2022 NEC, 2022 CEC, LAWS & ORDINANCES
2. THE CONTRACTOR SHALL VERIFY & BE RESPONSIBLE FOR ALL DIMENSIONS & CONDITIONS AT THE JOB SITE AND SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES BETWEEN ACTUAL CONDITIONS & WHAT IS SHOWN ON THE DRAWINGS BEFORE PROCEEDING WITH THE WORK.
3. ANY OMISSIONS OR CONFLICTS BETWEEN THE ARCHITECTURAL, STRUCTURAL & MECHANICAL DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE CITY INSPECTOR.
4. SHOP DRAWINGS REQUIRED BY THE SPECIFICATIONS SHALL BE SUBMITTED TO THE ARCHITECT PRIOR TO FABRICATION, & ALLOW REASONABLE TIME FOR REVIEW AND APPROVAL BY THE STRUCTURAL ENGINEER.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF THE BUILDING DURING THE CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ADEQUATE SHORING, BRACING & GUYS IN ACCORDANCE WITH ALL NATIONAL, STATE AND LOCAL SAFETY ORDANCES. ANY DEVIATIONS MUST BE APPROVED PRIOR TO ERECTION.
6. ALL CONDITIONS NOT CLEARLY SHOWN OR DETAILED SHALL BE OF THE SAME TYPE & CHARACTER AS THOSE SHOWN FOR SIMILAR CONDITIONS.

##### B. FOUNDATION

1. FOUNDATION EXCAVATIONS SHALL BE FREE OF LOOSE MATERIAL PRIOR TO THE PLACEMENT OF ANY REINFORCING STEEL OR CONCRETE.

##### C. CONCRETE

1. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS.
2. CONCRETE SHALL BE REGULAR WEIGHT HARD ROCK TYPE (150#CF) & AGGREGATE SHALL CONFORM TO ASTM C33 U.O.N.
3. CEMENT SHALL CONFORM TO ASTM C150, TYPE I OR 2.
4. PLACEMENT OF CONCRETE SHALL BE IN CONFORMANCE WITH ACI 301.
5. CONCRETE SHALL BE MACHINE MIXED AND DELIVERED IN ACCORDANCE WITH ASTM C-94. SUBMIT MIX DESIGN TO THE ARCHITECT FOR APPROVAL PRIOR TO PLACING CONCRETE.
6. PROVIDE MINIMUM CLEAR COVER OF CONCRETE OVER REINFORCING AS FOLLOWS

##### D. REINFORCING STEEL

1. ALL REINFORCING STEEL SHALL CONFORM TO ASTM SPECIFICATION A615 GRADE 60 FOR #5 AND LARGER BARS AND GRADE 40 FOR #3 & #4.
2. ALL REINFORCING STEEL SHALL BE LAPPED AS NOTED BELOW, #4: 24" FOR BOTTOM BARS AND 28" FOR TOP BARS; #5: 30" FOR BOTTOM BARS AND 35" FOR TOP BARS; #6: 40" FOR BOTTOM BARS AND 46" FOR TOP BARS AT SPLICES UNLESS OTHERWISE NOTED ON PLANS. SPLICES SHALL BE LOCATED AS DETERMINED IN THE PLANS. STAGGER ALL LAPS SPLICES.
3. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A82 AND A185.
4. ANCHOR BOLTS, DOWELS AND OTHER EMBEDDED ITEMS SHALL BE SECURELY TIED IN PLACE BEFORE CONCRETE IS PLACED, USE CYT THREAD ANCHOR BOLTS ONLY.

##### E. STRUCTURAL & MISC. STEEL

1. FABRICATION AND ERECTION TO BE IN ACCORDANCE WITH LATEST AISC SPECIFICATIONS. STRUCTURAL STEEL SHALL BE ASTM A36, EXCEPT TUBE COLUMNS WHICH ARE ASTM A500, GRADE B.
2. WELDING TO BE IN ACCORDANCE WITH AWS SPECIFICATIONS. WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS USING E77XX ELECTRODES.
3. ALL PLATES, ETC., TO BE BOLTED TO CONCRETE ELEMENTS, SHALL NOT BE FABRICATED UNTIL THE BOLTS HAVE BEEN LOCATED IN THE FIELD.
4. BOLTS SHALL BE ASTM A307 TYPE. THREADS MAY BE INCLUDED IN THE SHEAR PLANES
5. STEEL TO BE SHOP PRIMED FOR, EXCEPT WHERE EMBEDDED IN CONCRETE OR TO BE WELDED.
6. ALL WELDING SHALL BE CONTINUOUSLY INSPECTED BY AN INDEPENDENT INSPECTOR APPROVED BY THE BUILDING DEPARTMENT.

##### F. WOOD FRAME CONSTRUCTION

1. GENERAL WOOD FRAMING: WOOD FRAMING THROUGHOUT THE BUILDING SHALL BE CONSTRUCTED IN ACCORDANCE WITH CALIFORNIA BUILDING CODE (2022) CBC ADOPTED BY CSJ, AND THE STANDARD PRACTICES RECOMMENDED BY AMERICAN INSTITUTE OF TIMBER CONSTRUCTION AND WCLA GRADING. FOR NAILING SEE SECTION J. BOLTS IN WOOD FRAMING SHALL BE STANDARD MACHINE BOLTS WITH STANDARD MALLEABLE IRON WASHERS.
3. WOOD PLATES: BEARING DIRECTLY UPON CONCRETE SHALL BE P.T.D.F.
4. UNLESS OTHERWISE NOTED ON DRAWINGS OR IN SPECIFICATIONS, FRAMING MEMBERS SHALL HAVE THE FOLLOWING GRADING:

#### Water Supply Load Calculation

This document presents the water supply load and flow rate calculation for the Duplex and ADUs. The calculations follow Table 910.2 and Table 910.4 of the 2022 California Plumbing Code to determine the fixture unit counts and required water flow rate.

Final Fixture Units: 22.0  
Total Supply Flow: 1.2 GPM  
Water Supply Pipe: 1/2" Copper  
Required Water Flow Rate: 1.5 GPM (based on CPC Table 910.4)

1. Bath (1.2 GPM)  
2. Shower (1.8 GPM)  
3. Kitchen Sink (1.0 GPM)  
4. Dishwasher (1.5 GPM)  
5. Washing Machine (2.0 GPM)  
6. Laundry (1.0 GPM)  
7. Lavatory (1.0 GPM)  
8. Kitchen Sink (1.0 GPM)  
9. Shower (1.8 GPM)  
10. Bath (1.2 GPM)  
11. Dishwasher (1.5 GPM)  
12. Washing Machine (2.0 GPM)  
13. Laundry (1.0 GPM)  
14. Lavatory (1.0 GPM)  
15. Kitchen Sink (1.0 GPM)  
16. Shower (1.8 GPM)  
17. Bath (1.2 GPM)  
18. Dishwasher (1.5 GPM)  
19. Washing Machine (2.0 GPM)  
20. Laundry (1.0 GPM)  
21. Lavatory (1.0 GPM)  
22. Kitchen Sink (1.0 GPM)  
23. Shower (1.8 GPM)  
24. Bath (1.2 GPM)  
25. Dishwasher (1.5 GPM)  
26. Washing Machine (2.0 GPM)  
27. Laundry (1.0 GPM)  
28. Lavatory (1.0 GPM)  
29. Kitchen Sink (1.0 GPM)  
30. Shower (1.8 GPM)  
31. Bath (1.2 GPM)  
32. Dishwasher (1.5 GPM)  
33. Washing Machine (2.0 GPM)  
34. Laundry (1.0 GPM)  
35. Lavatory (1.0 GPM)  
36. Kitchen Sink (1.0 GPM)  
37. Shower (1.8 GPM)  
38. Bath (1.2 GPM)  
39. Dishwasher (1.5 GPM)  
40. Washing Machine (2.0 GPM)  
41. Laundry (1.0 GPM)  
42. Lavatory (1.0 GPM)  
43. Kitchen Sink (1.0 GPM)  
44. Shower (1.8 GPM)  
45. Bath (1.2 GPM)  
46. Dishwasher (1.5 GPM)  
47. Washing Machine (2.0 GPM)  
48. Laundry (1.0 GPM)  
49. Lavatory (1.0 GPM)  
50. Kitchen Sink (1.0 GPM)  
51. Shower (1.8 GPM)  
52. Bath (1.2 GPM)  
53. Dishwasher (1.5 GPM)  
54. Washing Machine (2.0 GPM)  
55. Laundry (1.0 GPM)  
56. Lavatory (1.0 GPM)  
57. Kitchen Sink (1.0 GPM)  
58. Shower (1.8 GPM)  
59. Bath (1.2 GPM)  
60. Dishwasher (1.5 GPM)  
61. Washing Machine (2.0 GPM)  
62. Laundry (1.0 GPM)  
63. Lavatory (1.0 GPM)  
64. Kitchen Sink (1.0 GPM)  
65. Shower (1.8 GPM)  
66. Bath (1.2 GPM)  
67. Dishwasher (1.5 GPM)  
68. Washing Machine (2.0 GPM)  
69. Laundry (1.0 GPM)  
70. Lavatory (1.0 GPM)  
71. Kitchen Sink (1.0 GPM)  
72. Shower (1.8 GPM)  
73. Bath (1.2 GPM)  
74. Dishwasher (1.5 GPM)  
75. Washing Machine (2.0 GPM)  
76. Laundry (1.0 GPM)  
77. Lavatory (1.0 GPM)  
78. Kitchen Sink (1.0 GPM)  
79. Shower (1.8 GPM)  
80. Bath (1.2 GPM)  
81. Dishwasher (1.5 GPM)  
82. Washing Machine (2.0 GPM)  
83. Laundry (1.0 GPM)  
84. Lavatory (1.0 GPM)  
85. Kitchen Sink (1.0 GPM)  
86. Shower (1.8 GPM)  
87. Bath (1.2 GPM)  
88. Dishwasher (1.5 GPM)  
89. Washing Machine (2.0 GPM)  
90. Laundry (1.0 GPM)  
91. Lavatory (1.0 GPM)  
92. Kitchen Sink (1.0 GPM)  
93. Shower (1.8 GPM)  
94. Bath (1.2 GPM)  
95. Dishwasher (1.5 GPM)  
96. Washing Machine (2.0 GPM)  
97. Laundry (1.0 GPM)  
98. Lavatory (1.0 GPM)  
99. Kitchen Sink (1.0 GPM)  
100. Shower (1.8 GPM)  
101. Bath (1.2 GPM)  
102. Dishwasher (1.5 GPM)  
103. Washing Machine (2.0 GPM)  
104. Laundry (1.0 GPM)  
105. Lavatory (1.0 GPM)  
106. Kitchen Sink (1.0 GPM)  
107. Shower (1.8 GPM)  
108. Bath (1.2 GPM)  
109. Dishwasher (1.5 GPM)  
110. Washing Machine (2.0 GPM)  
111. Laundry (1.0 GPM)  
112. Lavatory (1.0 GPM)  
113. Kitchen Sink (1.0 GPM)  
114. Shower (1.8 GPM)  
115. Bath (1.2 GPM)  
116. Dishwasher (1.5 GPM)  
117. Washing Machine (2.0 GPM)  
118. Laundry (1.0 GPM)  
119. Lavatory (1.0 GPM)  
120. Kitchen Sink (1.0 GPM)  
121. Shower (1.8 GPM)  
122. Bath (1.2 GPM)  
123. Dishwasher (1.5 GPM)  
124. Washing Machine (2.0 GPM)  
125. Laundry (1.0 GPM)  
126. Lavatory (1.0 GPM)  
127. Kitchen Sink (1.0 GPM)  
128. Shower (1.8 GPM)  
129. Bath (1.2 GPM)  
130. Dishwasher (1.5 GPM)  
131. Washing Machine (2.0 GPM)  
132. Laundry (1.0 GPM)  
133. Lavatory (1.0 GPM)  
134. Kitchen Sink (1.0 GPM)  
135. Shower (1.8 GPM)  
136. Bath (1.2 GPM)  
137. Dishwasher (1.5 GPM)  
138. Washing Machine (2.0 GPM)  
139. Laundry (1.0 GPM)  
140. Lavatory (1.0 GPM)  
141. Kitchen Sink (1.0 GPM)  
142. Shower (1.8 GPM)  
143. Bath (1.2 GPM)  
144. Dishwasher (1.5 GPM)  
145. Washing Machine (2.0 GPM)  
146. Laundry (1.0 GPM)  
147. Lavatory (1.0 GPM)  
148. Kitchen Sink (1.0 GPM)  
149. Shower (1.8 GPM)  
150. Bath (1.2 GPM)  
151. Dishwasher (1.5 GPM)  
152. Washing Machine (2.0 GPM)  
153. Laundry (1.0 GPM)  
154. Lavatory (1.0 GPM)  
155. Kitchen Sink (1.0 GPM)  
156. Shower (1.8 GPM)  
157. Bath (1.2 GPM)  
158. Dishwasher (1.5 GPM)  
159. Washing Machine (2.0 GPM)  
160. Laundry (1.0 GPM)  
161. Lavatory (1.0 GPM)  
162. Kitchen Sink (1.0 GPM)  
163. Shower (1.8 GPM)  
164. Bath (1.2 GPM)  
165. Dishwasher (1.5 GPM)  
166. Washing Machine (2.0 GPM)  
167. Laundry (1.0 GPM)  
168. Lavatory (1.0 GPM)  
169. Kitchen Sink (1.0 GPM)  
170. Shower (1.8 GPM)  
171. Bath (1.2 GPM)  
172. Dishwasher (1.5 GPM)  
173. Washing Machine (2.0 GPM)  
174. Laundry (1.0 GPM)  
175. Lavatory (1.0 GPM)  
176. Kitchen Sink (1.0 GPM)  
177. Shower (1.8 GPM)  
178. Bath (1.2 GPM)  
179. Dishwasher (1.5 GPM)  
180. Washing Machine (2.0 GPM)  
181. Laundry (1.0 GPM)  
182. Lavatory (1.0 GPM)  
183. Kitchen Sink (1.0 GPM)  
184. Shower (1.8 GPM)  
185. Bath (1.2 GPM)  
186. Dishwasher (1.5 GPM)  
187. Washing Machine (2.0 GPM)  
188. Laundry (1.0 GPM)  
189. Lavatory (1.0 GPM)  
190. Kitchen Sink (1.0 GPM)  
191. Shower (1.8 GPM)  
192. Bath (1.2 GPM)  
193. Dishwasher (1.5 GPM)  
194. Washing Machine (2.0 GPM)  
195. Laundry (1.0 GPM)  
196. Lavatory (1.0 GPM)  
197. Kitchen Sink (1.0 GPM)  
198. Shower (1.8 GPM)  
199. Bath (1.2 GPM)  
200. Dishwasher (1.5 GPM)  
201. Washing Machine (2.0 GPM)  
202. Laundry (1.0 GPM)  
203. Lavatory (1.0 GPM)  
204. Kitchen Sink (1.0 GPM)  
205. Shower (1.8 GPM)  
206. Bath (1.2 GPM)  
207. Dishwasher (1.5 GPM)  
208. Washing Machine (2.0 GPM)  
209. Laundry (1.0 GPM)  
210. Lavatory (1.0 GPM)  
211. Kitchen Sink (1.0 GPM)  
212. Shower (1.8 GPM)  
213. Bath (1.2 GPM)  
214. Dishwasher (1.5 GPM)  
215. Washing Machine (2.0 GPM)  
216. Laundry (1.0 GPM)  
217. Lavatory (1.0 GPM)  
218. Kitchen Sink (1.0 GPM)  
219. Shower (1.8 GPM)  
220. Bath (1.2 GPM)  
221. Dishwasher (1.5 GPM)  
222. Washing Machine (2.0 GPM)  
223. Laundry (1.0 GPM)  
224. Lavatory (1.0 GPM)  
225. Kitchen Sink (1.0 GPM)  
226. Shower (1.8 GPM)  
227. Bath (1.2 GPM)  
228. Dishwasher (1.5 GPM)  
229. Washing Machine (2.0 GPM)  
230. Laundry (1.0 GPM)  
231. Lavatory (1.0 GPM)  
232. Kitchen Sink (1.0 GPM)  
233. Shower (1.8 GPM)  
234. Bath (1.2 GPM)  
235. Dishwasher (1.5 GPM)  
236. Washing Machine (2.0 GPM)  
237. Laundry (1.0 GPM)  
238. Lavatory (1.0 GPM)  
239. Kitchen Sink (1.0 GPM)  
240. Shower (1.8 GPM)  
241. Bath (1.2 GPM)  
242. Dishwasher (1.5 GPM)  
243. Washing Machine (2.0 GPM)  
244. Laundry (1.0 GPM)  
245. Lavatory (1.0 GPM)  
246. Kitchen Sink (1.0 GPM)  
247. Shower (1.8 GPM)  
248. Bath (1.2 GPM)  
249. Dishwasher (1.5 GPM)  
250. Washing Machine (2.0 GPM)  
251. Laundry (1.0 GPM)  
252. Lavatory (1.0 GPM)  
253. Kitchen Sink (1.0 GPM)  
254. Shower (1.8 GPM)  
255. Bath (1.2 GPM)  
256. Dishwasher (1.5 GPM)  
257. Washing Machine (2.0 GPM)  
258. Laundry (1.0 GPM)  
259. Lavatory (1.0 GPM)  
260. Kitchen Sink (1.0 GPM)  
261. Shower (1.8 GPM)  
262. Bath (1.2 GPM)  
263. Dishwasher (1.5 GPM)  
264. Washing Machine (2.0 GPM)  
265. Laundry (1.0 GPM)  
266. Lavatory (1.0 GPM)  
267. Kitchen Sink (1.0 GPM)  
268. Shower (1.8 GPM)  
269. Bath (1.2 GPM)  
270. Dishwasher (1.5 GPM)  
271. Washing Machine (2.0 GPM)  
272. Laundry (1.0 GPM)  
273. Lavatory (1.0 GPM)  
274. Kitchen Sink (1.0 GPM)  
275. Shower (1.8 GPM)  
276. Bath (1.2 GPM)  
277. Dishwasher (1.5 GPM)  
278. Washing Machine (2.0 GPM)  
279. Laundry (1.0 GPM)  
280. Lavatory (1.0 GPM)  
281. Kitchen Sink (1.0 GPM)  
282. Shower (1.8 GPM)  
283. Bath (1.2 GPM)  
284. Dishwasher (1.5 GPM)  
285. Washing Machine (2.0 GPM)  
286. Laundry (1.0 GPM)  
287. Lavatory (1.0 GPM)  
288. Kitchen Sink (1.0 GPM)  
289. Shower (1.8 GPM)  
290. Bath (1.2 GPM)  
291. Dishwasher (1.5 GPM)  
292. Washing Machine (2.0 GPM)  
293. Laundry (1.0 GPM)  
294. Lavatory (1.0 GPM)  
295. Kitchen Sink (1.0 GPM)  
296. Shower (1.8 GPM)  
297. Bath (1.2 GPM)  
298. Dishwasher (1.5 GPM)  
299. Washing Machine (2.0 GPM)  
300. Laundry (1.0 GPM)  
301. Lavatory (1.0 GPM)  
302. Kitchen Sink (1.0 GPM)  
303. Shower (1.8 GPM)  
304. Bath (1.2 GPM)  
305. Dishwasher (1.5 GPM)  
306. Washing Machine (2.0 GPM)  
307. Laundry (1.0 GPM)  
308. Lavatory (1.0 GPM)  
309. Kitchen Sink (1.0 GPM)  
310. Shower (1.8 GPM)  
311. Bath (1.2 GPM)  
312. Dishwasher (1.5 GPM)  
313. Washing Machine (2.0 GPM)  
314. Laundry (1.0 GPM)  
315. Lavatory (1.0 GPM)  
316. Kitchen Sink (1.0 GPM)  
317. Shower (1.8 GPM)  
318. Bath (1.2 GPM)  
319. Dishwasher (1.5 GPM)  
320. Washing Machine (2.0 GPM)  
321. Laundry (1.0 GPM)  
322. Lavatory (1.0 GPM)  
323. Kitchen Sink (1.0 GPM)  
324. Shower (1.8 GPM)  
325. Bath (1.2 GPM)  
326. Dishwasher (1.5 GPM)  
327. Washing Machine (2.0 GPM)  
328. Laundry (1.0 GPM)  
329. Lavatory (1.0 GPM)  
330. Kitchen Sink (1.0 GPM)  
331. Shower (1.8 GPM)  
332. Bath (1.2 GPM)  
333. Dishwasher (1.5 GPM)  
334. Washing Machine (2.0 GPM)  
335. Laundry (1.0 GPM)  
336. Lavatory (1.0 GPM)  
337. Kitchen Sink (1.0 GPM)  
338. Shower (1.8 GPM)  
339. Bath (1.2 GPM)  
340. Dishwasher (1.5 GPM)  
341. Washing Machine (2.0 GPM)  
342. Laundry (1.0 GPM)  
343. Lavatory (1.0 GPM)  
344. Kitchen Sink (1.0 GPM)  
345. Shower (1.8 GPM)  
346. Bath (1.2 GPM)  
347. Dishwasher (1.5 GPM)  
348. Washing Machine (2.0 GPM)  
349. Laundry (1.0 GPM)  
350. Lavatory (1.0 GPM)  
351. Kitchen Sink (1.0 GPM)  
352. Shower (1.8 GPM)  
353. Bath (1.2 GPM)  
354. Dishwasher (1.5 GPM)  
355. Washing Machine (2.0 GPM)  
356. Laundry (1.0 GPM)  
357. Lavatory (1.0 GPM)  
358. Kitchen Sink (1.0 GPM)  
359. Shower (1.8 GPM)  
360. Bath (1.2 GPM)  
361. Dishwasher (1.5 GPM)  
362. Washing Machine (2.0 GPM)  
363. Laundry (1.0 GPM)  
364. Lavatory (1.0 GPM)  
365. Kitchen Sink (1.0 GPM)  
366. Shower (1.8 GPM)  
367. Bath (1.2 GPM)  
368. Dishwasher (1.5 GPM)  
369. Washing Machine (2.0 GPM)  
370. Laundry (1.0 GPM)  
371. Lavatory (1.0 GPM)  
372. Kitchen Sink (1.0 GPM)  
373. Shower (1.8 GPM)  
374. Bath (1.2 GPM)  
375. Dishwasher (1.5 GPM)  
376. Washing Machine (2.0 GPM)  
377. Laundry (1.0 GPM)  
378. Lavatory (1.0 GPM)  
379. Kitchen Sink (1.0 GPM)  
380. Shower (1.8 GPM)  
381. Bath (1.2 GPM)  
382. Dishwasher (1.5 GPM)  
383. Washing Machine (2.0 GPM)  
384. Laundry (1.0 GPM)  
385. Lavatory (1.0 GPM)  
386. Kitchen Sink (1.0 GPM)  
387. Shower (1.8 GPM)  
388. Bath (1.2 GPM)  
389. Dishwasher (1.5 GPM)  
390. Washing Machine (2.0 GPM)  
391. Laundry (1.0 GPM)  
392. Lavatory (1.0 GPM)  
393. Kitchen Sink (1.0 GPM)  
394. Shower (1.8 GPM)  
395. Bath (1.2 GPM)  
396. Dishwasher (1.5 GPM)  
397. Washing Machine (2.0 GPM)  
398. Laundry (1.0 GPM)  
399. Lavatory (1.0 GPM)  
400. Kitchen Sink (1.0 GPM)  
401. Shower (1.8 GPM)  
402. Bath (1.2 GPM)  
403. Dishwasher (1.5 GPM)  
404. Washing Machine (2.0 GPM)  
405. Laundry (1.0 GPM)  
406. Lavatory (1.0 GPM)  
407. Kitchen Sink (1.0 GPM)  
408. Shower (1.8 GPM)  
409. Bath (1.2 GPM)  
410. Dishwasher (1.5 GPM)  
411. Washing Machine (2.0 GPM)  
412. Laundry (1.0 GPM)  
413. Lavatory (1.0 GPM)  
414. Kitchen Sink (1.0 GPM)  
415. Shower (1.8 GPM)  
416. Bath (1.2 GPM)  
417. Dishwasher (1.5 GPM)  
418. Washing Machine (2.0 GPM)  
419. Laundry (1.0 GPM)  
420. Lavatory (1.0 GPM)  
421. Kitchen Sink (1.0 GPM)  
422. Shower (1.8 GPM)  
423. Bath (1.2 GPM)  
424. Dishwasher (1.5 GPM)  
425. Washing Machine (2.0 GPM)  
426. Laundry (1.0 GPM)  
427. Lavatory (1.0 GPM)  
428. Kitchen Sink (1.0 GPM)  
429. Shower (1.8 GPM)  
430. Bath (1.2 GPM)  
431. Dishwasher (1.5 GPM)  
432. Washing Machine (2.0 GPM)  
433. Laundry (1.0 GPM)  
434. Lavatory (1.0 GPM)  
435. Kitchen Sink (1.0 GPM)  
436. Shower (1.8 GPM)  
437. Bath (1.2 GPM)  
438. Dishwasher (1.5 GPM)  
439. Washing Machine (2.0 GPM)  
440. Laundry (1.0 GPM)  
441. Lavatory (1.0 GPM)  
442. Kitchen Sink (1.0 GPM)  
443. Shower (1.8 GPM)  
444. Bath (1.2 GPM)  
445. Dishwasher (1.5 GPM)  
446. Washing Machine (2.0 GPM)  
447. Laundry (1.0 GPM)  
448. Lavatory (1.0 GPM)  
449. Kitchen Sink (1.0 GPM)  
450. Shower (1.8 GPM)  
451. Bath (1.2 GPM)  
452. Dishwasher (1.5 GPM)  
453. Washing Machine (2.0 GPM)  
454. Laundry (1.0 GPM)  
455. Lavatory (1.0 GPM)  
456. Kitchen Sink (1.0 GPM)  
457. Shower (1.8 GPM)  
458. Bath (1.2 GPM)  
459. Dishwasher (1.5 GPM)  
460. Washing Machine (2.0 GPM)  
461. Laundry (1.0 GPM)  
462. Lavatory (1.0 GPM)  
463. Kitchen Sink (1.0 GPM)  
464. Shower (1.8 GPM)  
465. Bath (1.2 GPM)  
466. Dishwasher (1.5 GPM)  
467. Washing Machine (2.0 GPM)  
468. Laundry (1.0 GPM)  
469. Lavatory (1.0 GPM)  
470. Kitchen Sink (1.0 GPM)  
471. Shower (1.8 GPM)  
472. Bath (1.2 GPM)  
473. Dishwasher (1.5 GPM)  
474. Washing Machine (2.0 GPM)  
475. Laundry (1.0 GPM)  
476. Lavatory (1.0 GPM)  
477. Kitchen Sink (1.0 GPM)  
478. Shower (1.8 GPM)  
479. Bath (1.2 GPM)  
480. Dishwasher (1.5 GPM)  
481. Washing Machine (2.0 GPM)  
482. Laundry (1.0 GPM)  
483. Lavatory (1.0 GPM)  
484. Kitchen Sink (1.0 GPM)  
485. Shower (1.8 GPM)  
486. Bath (1.2 GPM)  
487. Dishwasher (1.5 GPM)  
488. Washing Machine (2.0 GPM)  
489. Laundry (1.0 GPM)  
490. Lavatory (1.0 GPM)  
491. Kitchen Sink (1.0 GPM)  
492. Shower (1.8 GPM)  
493. Bath (1.2 GPM)  
494. Dishwasher (1.5 GPM)  
495. Washing Machine (2.0 GPM)  
496. Laundry (1.0 GPM)  
497. Lavatory (1.0 GPM)  
498. Kitchen Sink (1.0 GPM)  
499. Shower (1.8 GPM)  
500. Bath (1.2 GPM)  
501. Dishwasher (1.5 GPM)  
502. Washing Machine (2.0 GPM)  
503. Laundry (1.0 GPM)  
504. Lavatory (1.0 GPM)  
505. Kitchen Sink (1.0 GPM)  
506. Shower (1.8 GPM)  
507. Bath (1.2 GPM)  
508. Dishwasher (1.5 GPM)  
509. Washing Machine (2.0 GPM)  
510. Laundry (1.0 GPM)  
511. Lavatory (1.0 GPM)  
512. Kitchen Sink (1.0 GPM)  
513. Shower (1.8 GPM)  
514. Bath (1.2 GPM)  
515. Dishwasher (1.5 GPM)  
516. Washing Machine (2.0 GPM)  
517. Laundry (1.0 GPM)  
518. Lavatory (1.0 GPM)  
519. Kitchen Sink (1.0 GPM)  
520. Shower (1.8 GPM)  
521. Bath (1.2 GPM)  
522. Dishwasher (1.5 GPM)  
523. Washing Machine (2.0 GPM)  
524. Laundry (1.0 GPM)  
525. Lavatory (1.0 GPM)  
526. Kitchen Sink (1.0 GPM)  
527. Shower (1.8 GPM)  
528. Bath (1.2 GPM)  
529. Dishwasher (1.5 GPM)  
530. Washing Machine (2.0 GPM)  
531. Laundry (1.0 GPM)  
532. Lavatory (1.0 GPM)  
533. Kitchen Sink (1.0 GPM)  
534. Shower (1.8 GPM)  
535. Bath (1.2 GPM)  
536. Dishwasher (1.5 GPM)  
537. Washing Machine (2.0 GPM)  
538. Laundry (1.0 GPM)  
539. Lavatory (1.0 GPM)  
540. Kitchen Sink (1.0 GPM)  
541. Shower (1.8 GPM)  
542. Bath (1.2 GPM)  
543. Dishwasher (1.5 GPM)  
544. Washing Machine (2.0 GPM)  
545. Laundry (1.0 GPM)  
546. Lavatory (1.0 GPM)  
547. Kitchen Sink (1.0 GPM)  
548. Shower (1.8 GPM)  
549. Bath (1.2 GPM)  
550. Dishwasher (1.5 GPM)  
551. Washing Machine (2.0 GPM)  
552. Laundry (1.0 GPM)  
553. Lavatory (1.0 GPM)  
554. Kitchen Sink (1.0 GPM)  
555. Shower (1.8 GPM)  
556. Bath (1.2 GPM)  
557. Dishwasher (1.5 GPM)  
558. Washing Machine (2.0 GPM)  
559. Laundry (1.0 GPM)  
560. Lavatory (1.0 GPM)  
561. Kitchen Sink (1.0 GPM)  
562. Shower (1.8 GPM)  
563. Bath (1.2 GPM)  
564. Dishwasher (1.5 GPM)  
565. Washing Machine (2.0 GPM)  
566. Laundry (1.0 GPM)  
567. Lavatory (1.0 GPM)  
568. Kitchen Sink (1.0 GPM)  
569. Shower (1.8 GPM)  
570. Bath (1.2 GPM)  
571. Dishwasher (1.5 GPM)  
572. Washing Machine (2.0 GPM)  
573. Laundry (1.0 GPM)  
574. Lavatory (1.0 GPM)  
575. Kitchen Sink (1.0 GPM)  
576. Shower (1.8 GPM)  
577. Bath (1.2 GPM)  
578. Dishwasher (1.5 GPM)  
579. Washing Machine (2.0 GPM)  
580. Laundry (1.0 GPM)  
581. Lavatory (1.0 GPM)  
582. Kitchen Sink (1.0 GPM)  
583. Shower (1.8 GPM)  
584. Bath (1.2 GPM)  
585. Dishwasher (1.5 GPM)  
586. Washing Machine (2.0 GPM)  
587. Laundry (1.0 GPM)  
588. Lavatory (1.0 GPM)  
589. Kitchen Sink (1.0 GPM)  
590. Shower (1.8 GPM)  
591. Bath (1.2 GPM)  
592. Dishwasher (1.5 GPM)  
593. Washing Machine (2.0 GPM)  
594. Laundry (1.0 GPM)  
595. Lavatory (1.0 GPM)  
596. Kitchen Sink (1.0 GPM)  
597. Shower (1.8 GPM)  
598. Bath (1.2 GPM)  
599. Dishwasher (1.5 GPM)  
600. Washing Machine (2.0 GPM)  
601. Laundry (1.0 GPM)  
602. Lavatory (1.0 GPM)  
603. Kitchen Sink (1.0 GPM)  
604. Shower (1.8 GPM)  
605. Bath (1.2 GPM)  
606. Dishwasher (1.5 GPM)  
607. Washing Machine (2.0 GPM)  
608. Laundry (1.0 GPM)  
609. Lavatory (1.0 GPM)  
610. Kitchen Sink (1.0 GPM)  
611. Shower (1.8 GPM)  
612. Bath (1.2 GPM)  
613. Dishwasher (1.5 GPM)  
614. Washing Machine (2.0 GPM)  
615. Laundry (1.0 GPM)  
616. Lavatory (1.0 GPM)  
617. Kitchen Sink (1.0 GPM)  
618. Shower (1.8 GPM)  
619. Bath (1.2 GPM)  
620. Dishwasher (1.5 GPM)  
621. Washing Machine (2.0 GPM)  
622. Laundry (1.0 GPM)  
623. Lavatory (1.0 GPM)  
624. Kitchen Sink (1.0 GPM)  
625. Shower (1.8 GPM)  
626. Bath (1.2 GPM)  
627. Dishwasher (1.5 GPM)  
628. Washing Machine (2.0 GPM)  
629. Laundry (1.0 GPM)  
630. Lavatory (1.0 GPM)  
631. Kitchen Sink (1.0 GPM)  
632. Shower (1.8 GPM)  
633. Bath (1.2 GPM)  
634. Dishwasher (1.5 GPM)  
635. Washing Machine (2.0 GPM)  
636. Laundry (1.0 GPM)  
637. Lavatory (1.0 GPM)  
638. Kitchen Sink (1.0 GPM)  
639. Shower (1.8 GPM)  
640. Bath (1.2 GPM)  
641. Dishwasher (1.5 GPM)  
642. Washing Machine (2.0 GPM)  
643. Laundry (1.0 GPM)  
644. Lavatory (1.0 GPM)  
645. Kitchen Sink (1.0 GPM)  
646. Shower (1.8 GPM)  
647. Bath (1.2 GPM)  
648. Dishwasher (1.5 GPM)  
649. Washing Machine (2.0 GPM)  
650. Laundry (1.0 GPM)  
651. Lavatory (1.0 GPM)  
652. Kitchen Sink (1.0 GPM)  
653. Shower (1.8 GPM)  
654. Bath (1.2 GPM)  
655. Dishwasher (1.5 GPM)  
656. Washing Machine (2.0 GPM)  
657. Laundry (1.0 GPM)  
658. Lavatory (1.0 GPM)  
659. Kitchen Sink (1.0 GPM)  
660. Shower (1.8 GPM)  
661. Bath (1.2 GPM)  
662. Dishwasher (1.5 GPM)  
663. Washing Machine (2.0 GPM)  
664. Laundry (1.0 GPM)  
665. Lavatory (1.0 GPM)  
666. Kitchen Sink (1.0 GPM)  
667. Shower (1.8 GPM)  
668. Bath (1.2 GPM)  
669. Dishwasher (1.5 GPM)  
670. Washing Machine (2.0 GPM)  
671. Laundry (1.0 GPM)  
672. Lavatory (1.0 GPM)  
673. Kitchen Sink (1.0 GPM)  
674. Shower (1.8 GPM)  
675. Bath (1.2 GPM)  
676. Dishwasher (1.5 GPM)  
677. Washing Machine (2.0 GPM)  
678. Laundry (1.0 GPM)  
679. Lavatory (1.0 GPM)  
680. Kitchen Sink (1.0 GPM)  
681. Shower (1.8 GPM)  
682. Bath (1.2 GPM)  
683. Dishwasher (1.5 GPM)  
684. Washing Machine (2.0 GPM)  
685. Laundry (1.0 GPM)  
686. Lavatory (1.0 GPM)  
687. Kitchen Sink (1.0 GPM)  
688. Shower (1.8 GPM)  
689. Bath (1.2 GPM)  
690. Dishwasher (1.5 GPM)  
691. Washing Machine (2.0 GPM)  
692. Laundry (1.0 GPM)  
693. Lavatory (1.0 GPM)  
694. Kitchen Sink (1.0 GPM)  
695. Shower (1.8 GPM)  
696. Bath (1.2 GPM)  
697. Dishwasher (1.5 GPM)  
698. Washing Machine (2.0 GPM)  
699. Laundry (1.0 GPM)  
700. Lavatory (1.0 GPM)  
701. Kitchen Sink (1.0 GPM)  
702. Shower (1.8 GPM)  
703. Bath (1.2 GPM)  
704. Dishwasher (1.5 GPM)  
705. Washing Machine (2.0 GPM)  
706. Laundry (1.0 GPM)  
707. Lavatory (1.0 GPM)  
708. Kitchen Sink (1.0 GPM)  
709. Shower (1.8 GPM)  
710. Bath (1.2 GPM)  
711. Dishwasher (1.5 GPM)  
712. Washing Machine (2.0 GPM)  
713. Laundry (1.0 GPM)  
714. Lavatory (1.0 GPM)  
715. Kitchen Sink (1.0 GPM)  
716. Shower (1.8 GPM)  
717. Bath (1.2 GPM)



FLOOR PLAN NOTES:

- ALL CONCRETE TO BE POURED ON UNDISTURBED SOIL.
- ALL LUMBER IN CONTACT WITH CONCRETE SHALL BE FOUNDATION GRADE RWD OR PRESSURE TREATED.
- ALL LUMBER USED IN CONSTRUCTION LOCATED NEARER THAN 8" TO EARTH SHALL BE F.G. RWD OR P.T.
- PROVIDE SOLID BLOCKING FOR ALL PONY WALLS LESS THAN 14" HIGH
- PROVIDE FIRESTOPS @ CONCEALED DRAFT OPENING, CEILING LINES, FLOOR LINES, FURRED AREAS, SUSPENDED CEILINGS, STAIR STRINGERS, SHOWERS, CHIMNEY ENCLOSURES, & MID HEIGHT OF WALLS OVER 10' IN HEIGHT.
- VERIFY MIN. 22"x30" FLOOR ACCESS. ATTIC ACCESS WITH 30" CLEARING ABOVE OPENING.
- DOORS, WINDOWS, & SHOWER DOORS WITHIN HAZARDOUS AREAS TO BE TEMPERED.
- ALL POSTS, BEAMS & WALLS SUPPORTING THE FLOOR/ CEILING SHALL HAVE ONE-HOUR FIRE PROTECTION.
- ALL NEW WINDOWS AND GLASS SLIDING DOOR SHALL BE LOW-E DUAL GLAZED U.N.O.
- MATERIAL GRADE STAMPS WILL BE CHECKED ON FRAME INSPECTION.
- ALL CONSTRUCTION SHALL COMPLY WITH THE 2022 EDITION OF THE CBC, CMC, CPC, CEC, CRC AND CFC AND THE 2022 CALIFORNIA ENERGY CODE.
- CHANGES FROM THE APPROVED PLANS DURING CONSTRUCTION OTHER THAN 1.) CABINET CHANGES WHEN NOT BEING SUPPORTED ENTIRELY BY THE ROOF STRUCTURE, APPROVED PLAN, 2.) INTERIOR NON-STRUCTURAL WALL FINISHES; SHALL CAUSE PLAN APPROVAL AND CONSTRUCTION TO BE SUSPENDED. A NEW PLAN CHECK (FOR A NEW PLAN) SHOWING CHANGES WILL BE SUBMITTED FOR REVIEW AND APPROVAL THROUGH THE NORMAL PLAN CHECK PROCESS.
- FIREBLOCKING WITH NON-COMBUSTIBLE MATERIAL SHALL BE PROVIDED IN OPENINGS AROUND VENTS, PIPES, DUCTS, FIREPLACES, AND SIMILAR OPENINGS PER CBC 708.2.1 (4).
- PROVIDE SMOKE DETECTORS (HARDWIRED 110v W/BATT BACK-UP) IN EVERY BEDROOMS, THE HALL WAY TO THE BEDROOM. PROVIDE CARBON MONOXIDE SMOKE ALARM DETECTOR IN ALL SLEEPING ROOM.
- IN EACH NEW BEDROOM, THERE IS AT LEAST ONE WINDOW, FOR EMERGENCY ESCAPE OR RESCUE. REQUIRE OPENING OF MINIMUM NET CLEAR AREA, 5.7 SQ. FT. HEIGHT 24", WIDTH 20", AND MAXIMUM FINISHED OPENING HEIGHT 44" ABOVE FINISH FLOOR
- NEW 3'X3" MIN. CONCRETE LANDING AT ALL NEW EXTERIOR DOOR. LANDING SHALL NOT BE LOWER THAN 7'-1/2" FROM FLOOR LEVEL.
- BATHROOM SLIDING DOOR MUST BE TEMPERED GLASS.
- ALL NEW BEDROOM MUST BE AFCI CIRCUIT.
- PRESSURE OR THERMOSTATIC MIXING VALVE AT THE SHOWERS AND TUBS, WHICH LIMIT WATER TEMPERATURE TO 120 DEGREES F
- THE SHOWERS MUST HAVE INSIDE DIMENSION OF AT LEAST 30 INCHES, THE TOTAL FLOOR AREA OF A SHOWER MUST BE AT LIST 1,024 SQUARE INCHES. OPENING TO SHOWER MUST BE MIN. 24 INCHES WIDE, THE DOOR MUST BE TEMPERED GLASS.(SEE DETAILS)

ELECTRICAL NOTES:

- MOTION SENSOR WITH INTEGRAL PHOTOCONTROL
- ALL HARDWIRED LIGHTING IN BATHROOMS, GARAGES, LAUNDRY AND UTILITY ROOMS MUST BE HIGH EFFICACY. CONTROLLED BY A MANUAL-ON MOTION SENSOR NEW LIGHTS MUST BE HIGH EFFICACY 2022 ENERGY CODE).
  - ALL HARDWIRED LIGHTING IN OTHER ROOMS (HALLWAYS, DINING ROOMS, FAMILY ROOMS AND BEDROOMS) SHALL BE HIGH EFFICACY. CONTROLLED BY A MANUAL-ON OCCUPANT SENSOR. A DIMMER MUST CONTROL IT
  - ALL SWITCHES ON A MULTIPLE SWITCHED CIRCUIT SHALL BE CONTROLLED BY THE DIMMER SWITCH ON THAT CIRCUIT
  - ALL RECESSED FIXTURES SHALL BE LABELED AS BEING CERTIFIED TO HAVE A LEAKAGE RATING OF LESS THAN 2.0 AT 75 PASCAL
  - ALL HIGH EFFICACY FIXTURES AND NON-HIGH EFFICACY FIXTURES SHALL BE SWITCHED SEPARATELY
  - SMOKE DETECTOR SYSTEM SHALL BE HARD-WIRED, INTERCONNECTED TO SOUND SIMULTANEOUSLY AND EQUIPED WITH BATTERY BACK UP.
  - MIN. 100% OF WATTAGE OF LIGHTS IN KITCHEN SHALL BE HIGH EFFICACY AND THOSE THAT ARE NOT SHALL BE SWITCHED SEPARATELY
  - LIGHTS MOUNTED TO EXTERIOR OF BUILDING SHALL BE HIGH EFFICACY OR ON A PHOTO CONTROL/MOTION SENSOR COMBINATION

LAMP POWER RATING:	MINIMUM LAMP EFFICACY:
15 watts or less	40 lumens per watt
over 15 watts to 40 watts	50 lumens per watt
over 40 watts	60 lumens per watt

NOTES:



NOTE: WATER-RESISTANT GYPSUM BACKING BOARD SHALL NOT BE USED WHERE THERE WILL BE DIRECT EXPOSURE TO WATER, OR IN AREAS SUBJECT TO CONTINUOUS HIGH HUMIDITY. RT02.3.7.1 USE CEMENTITIOUS BACKER BOARD OR EQUAL IN ALL WET LOCATIONS.

Note: on plan the fire-resistance-rated floor/ceiling and wall assemblies shall extend to and be tight against the exterior wall, and wall assemblies shall extend from the foundation to the underside of the roof sheathing or rated floor/ceiling assembly.


NOTE: Water Fixture Flow Rate Requirements (Water Conservation) Note: All plumbing fixtures must meet the maximum flow rates below to comply with California Plumbing Code (CPC) water conservation standards.

- Toilet • Max flow rate: 1.28 GPF (gallons per flush) • Code: CPC 403.2.1
- Kitchen Faucet • Max flow rate: 1.5 GPM (gallons per minute) • Code: CPC 407.2.1.1
- Residential Lavatory Faucet • Max flow rate: 1.2 GPM • Code: CPC 407.2.1.1
- Shower Head • Max flow rate: 1.8 GPM • Code: CPC 408.2

NOTE: NSP - Windows/Doors Maximum U-Factor 0.30, Maximum SHGC 0.23 for Zone 12 only. NFRC labels are required for all windows & Doors.

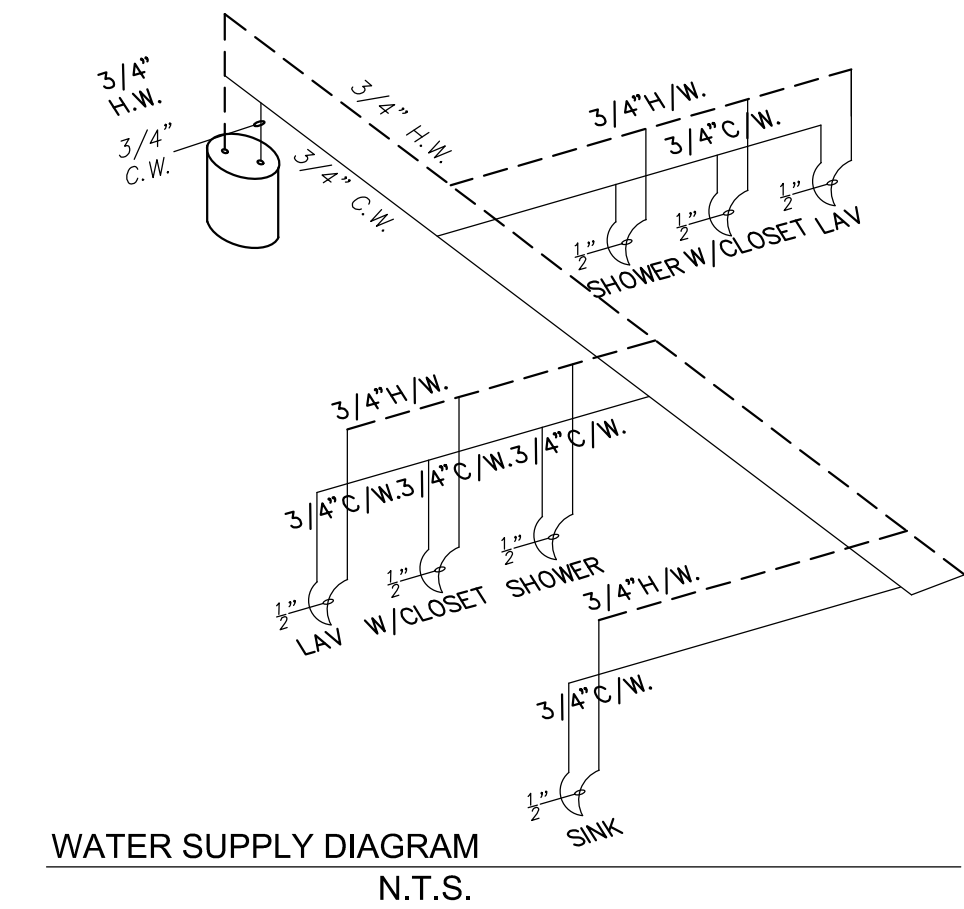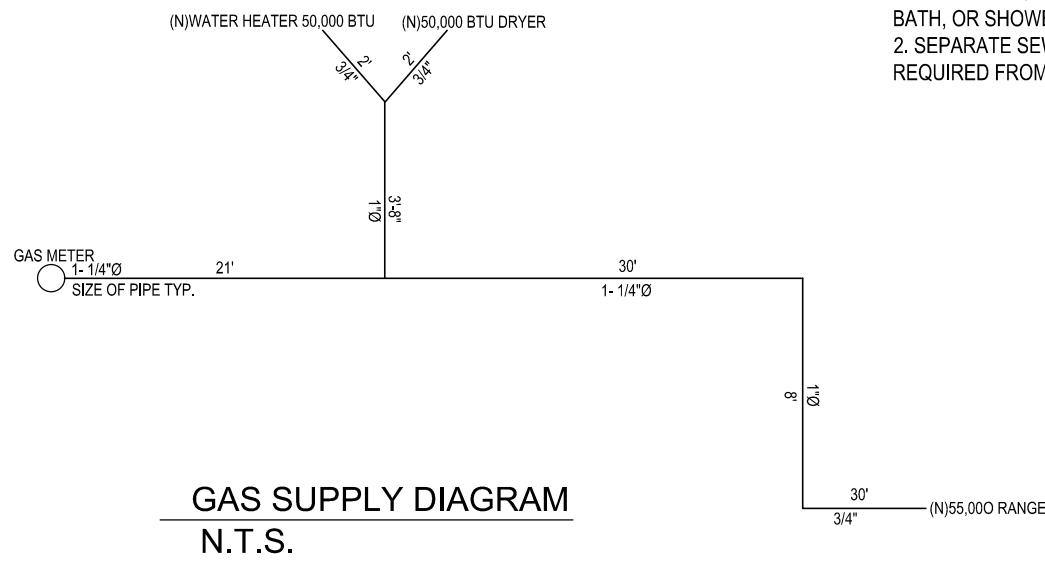

- MIN. SHOWER INTERIOR CLEAR DIMENSION IS 1,024 S.F. IN WITH NO DIMENSION LESS THAN 30" TO FINISH
  - BATHROOM DOOR MUST BE TEMPERED GLASS
- SHOWER AND TUB/SHOWER WALLS TO SPECIFY A SMOOTH, HARD, NONABSORBENT SURFACE(I.E. CERAMIC TILES) OVER MOISTURE RESISTANT UNDERLAYMENT(I.E. CEMENT, FIBER-CEMENT OR GLASS MAT GTMSUM BACKERS) TO A HEIGHT OF 72" ABOVE THE DRAIN.

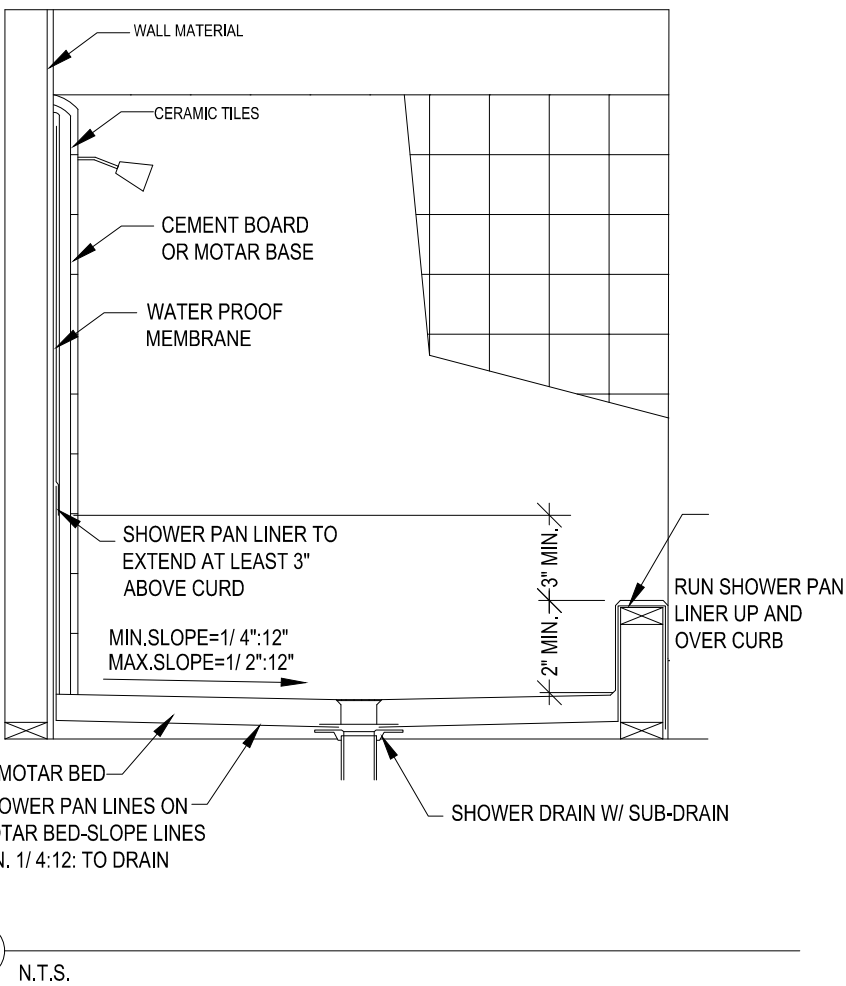


NOTE: ALL 120-VOLT, SINGLE PHASE, 15 AND 20 AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DEN, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALL TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.

NOTE: 1. USE DUROCK, 'WONDERBOARD', OR AN APPROVED EQUAL BEHIND GLUED-ON TILE IN TUB, BATH, OR SHOWER AREAS. 2. SEPARATE SEWER LATERAL PERMIT AND INSPECTIONS REQUIRED FROM DOT PRIOR TO CONNECTING.

NOTE: ALL ELECTRICAL RECEPTACLE OUTLETS, SWITCH, AND CONTROLS (INCLUDING CONTROLS FOR HEATING, VENTILATION AND AIR CONDITIONING) INTENDED TO BE USED BY OCCUPANTS SHALL BE LOCATED NOT MORE THAN 48 INCHES MEASURED TO THE TOP OF THE OUTLET BOX, AND NOT LESS THAN 15 INCHES MEASURED TO THE BOTTOM OF THE OUTLET BOX AND ABOVE THE FINISH FLOOR PER SECTION R302.1.2 AGING IN PLACE REQUIREMENTS. PLEASE SEE SECTION FOR EXCEPTIONS TO THESE REQUIREMENTS

NOTE - AGING IN PLACE REQUIREMENTS (CRC R327):




- Provide solid lumber or approved construction material for future grab bar reinforcement at shower and toilet walls.
- Documentation for grab bar reinforcement shall be included in the Operation and Maintenance Manual per California Green Building Standards Code, Chapter 4, Division 4.

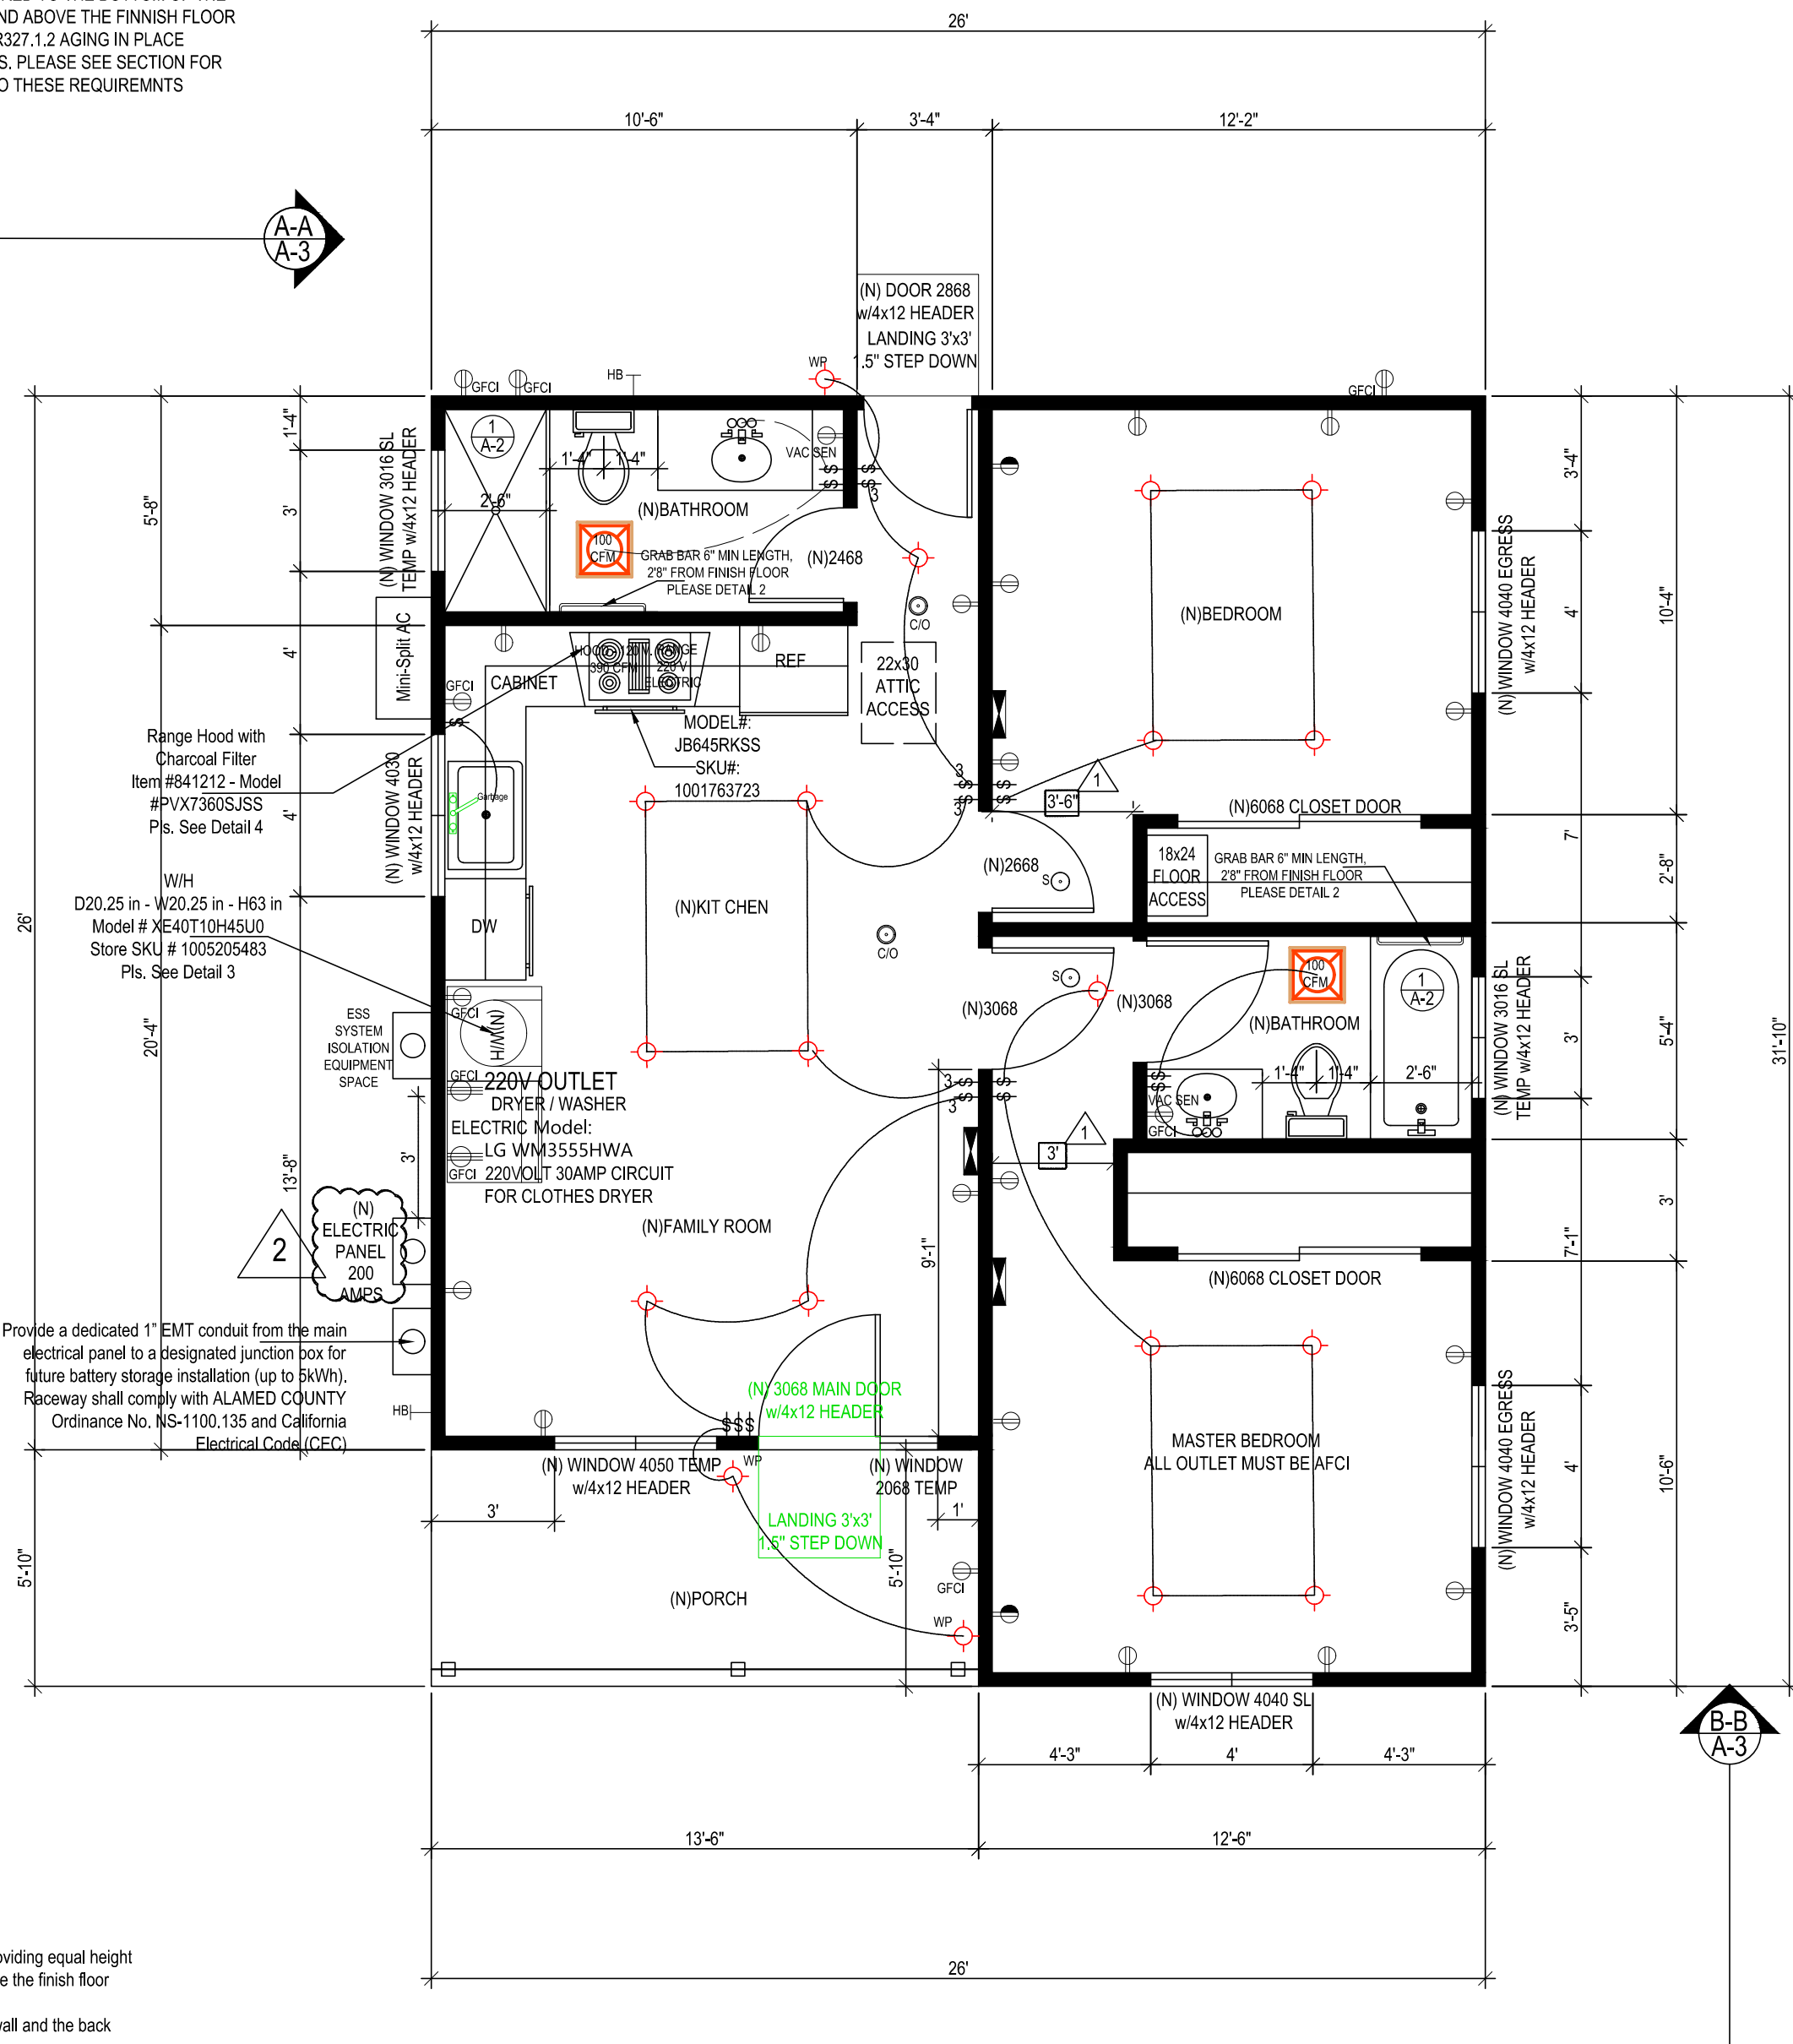

PROPOSAL FLOOR PLAN 749 SF  
SCALE: 1 / 4" = 1'-0"

Aging-In Design note added for reinforcement installation:

- Reinforcement shall not be less than 2x8 nominal lumber or other construction material providing equal height and load capacity. Reinforcement shall be located between 32 inches and 35-1/4 inches above the finish floor flush with the wall framing.
- Water closet reinforcement shall be installed on both side walls of the fixture, or one side wall and the back wall.
- Shower reinforcement shall be continuous where wall framing is provided.
- bathtub and combination bathtub/shower reinforcement shall be continuous on each end of the bathtub and the back wall. Additionally, backwall reinforcement for a lower grab bar shall be provided with the bottom edge located no more than 6 inches above the bathtub rim.
- On electrical plan: Receptacles, switches and controls (including controls for heating, ventilation and air conditioning) intended to be used by occupants shall be located no more than 48 inches measured from the top of the outlet box and not less than 15 inches measured from the bottom of the outlet box above the finish box.
- Doorbell buttons or controls, when installed, shall not exceed 48 inches above exterior floor or landing, measured from the top of the doorbell button assembly. Where doorbell buttons integrated with other features are required to be installed above 48 inches measured from the exterior floor or landing, a standard doorbell button or control shall also be provided at a height not exceeding 48 inches above exterior floor or landing, measured from the top of the doorbell button or control.

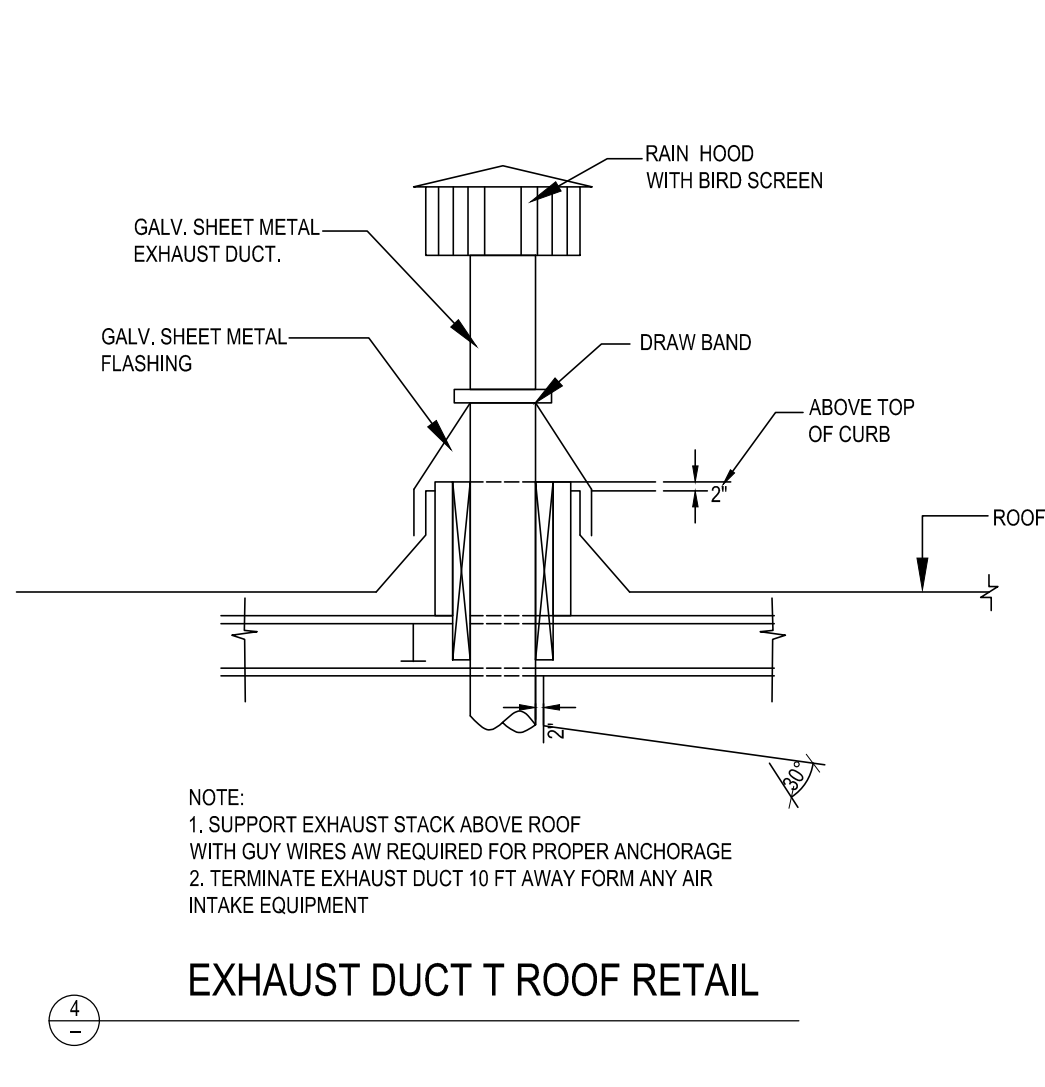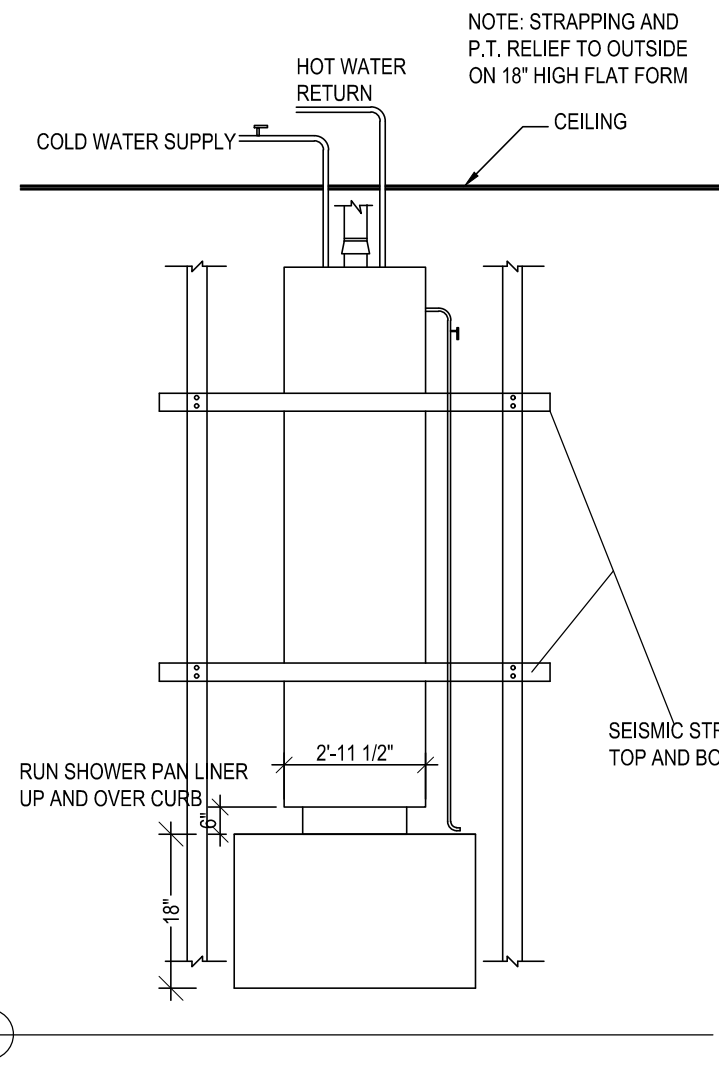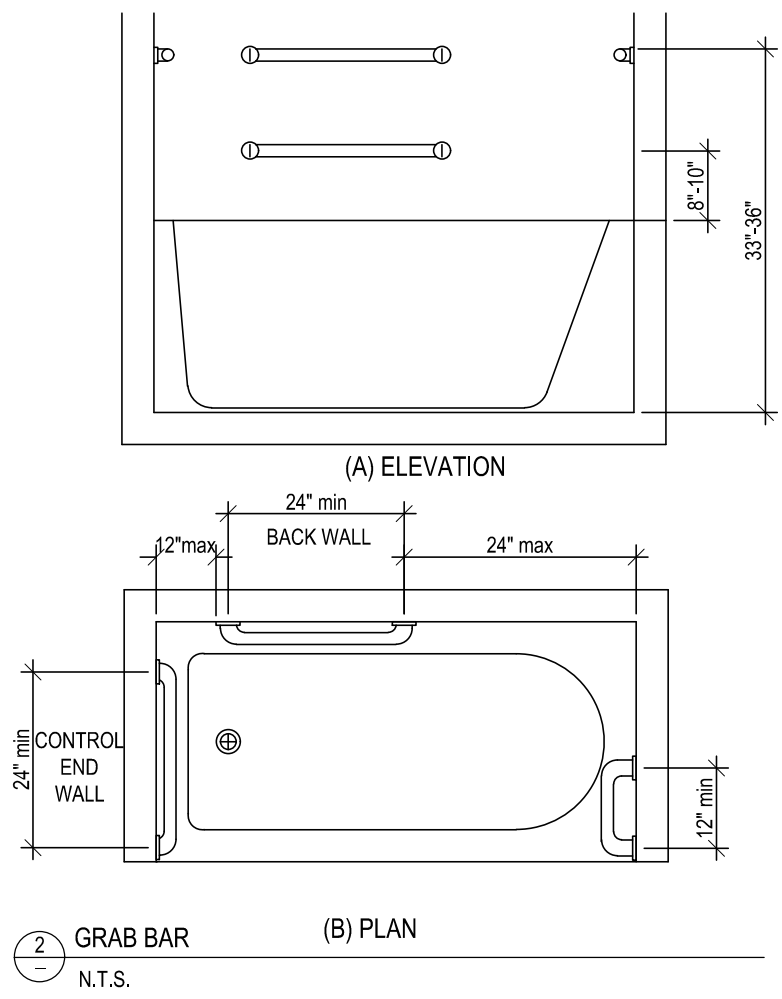

ELECTRICAL LEGENDS

- CEILING RECEPTACLE OUTLET
- DUPLEX RECEPTACLE, MTD @ 12" U.O.N.
- SINGLE OUTLET
- 220V OUTLET
- WEATHERPROOF DUPLEX OUTLET W/GFI
- GFI DUPLEX OUTLET W/GROUND FAULT INTERRUPTER
- DUPLEX RECEPTACLE, MTD@12" U.O.N. SPLIT WIRE WITH HALF SW/CONTROLLED SPECIAL PURPOSE
- FLOOR DUPLEX RECEPTACLE OUTLET
- CARBON MONOXIDE SMOKE DETECTOR W/BATTERY BACK UP
- CEILING LIGHT
- FLUORESCENT LIGHT
- RECESSED CANISTER
- FLOOR OUTLET (DBL)
- SWITCH
- 3 WAY SWITCH
- 4 WAY SWITCH
- DIMMER SWITCH
- TIMER SWITCH
- CEILING FAN
- FUEL GAS
- FAN TO OUTSIDE AIR
- CARBON MONOXIDE SMOKE DETECTOR W/BATTERY BACK UP
- INCANDESCENT LIGHT FIXTURE (CEILING)
- WEATHERPROOF LIGHT FIXTURE
- DISPOSAL
- RECESSED LIGHT FIXTURE
- GreenBuilder Series 100 CFM Wall or Ceiling Bathroom Exhaust Fan with Adjustable Humidity Sensor, ENERGY STAR (MODEL GB100H)
- CHIME
- PUSH BUTTON
- GAS RISER
- GAS STUB
- HORSE BID WITH BACKFLOW PREVENTATION DEVICE
- HOSE BIBB SHUT OFF VALVE
- BELL / BUZZER
- ELECTRICAL DISCONNECT
- DECORATIVE ABOVE MIRROR BATHROOM LIGHT
- CIRCUIT BREAKER
- KEY
- MOTION SENSOR
- CHANDELIER
- FLOOR SUPPLY AIR REGISTER
- CEILING SUPPLY AIR REGISTER
- FLUORESCENT LIGHT FIXTURE (SURFACE) SEE PLAN
- CO DETECTORS U.L./SFM LISTED APPROVED

LEGEND

- NEW WALL
- EXISTING WALL TO REMAIN.
- EXISTING WALL TO BE REMOVE
- EXISTING OPENING TO BE ENCLOSED
- EXISTING WINDOW TO REMAIN
- EXISTING WINDOW TO BE REMOVED
- EXISTING DOORS TO REMAIN

STAMPED FROM CITY

REVIEWED FOR COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email: helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

PROPOSAL FLOOR PLAN  
AND ELECTRIC

1154 D ST HAYWARD, CA 94541

Unit A

REVISION	DATE	BY
1	05-19-2025	HL
2	06-13-2025	HL

Scale: AS SHOWN


SHEET NO:

A-2



ROOF VENTILATION:

REQUIRED: 749 S.I.  
749 SF/150 = 4.9 SF/144= 720 S.I.  
PROPOSED: 1192 S.I.  
2 GABLE VENT: 2x14x14 +2x196 = 392 S.I.  
DORMER VENTS: 8x 24x12= 2x 100 = 200 S.I.  
TOTAL= 1,192 S.I.

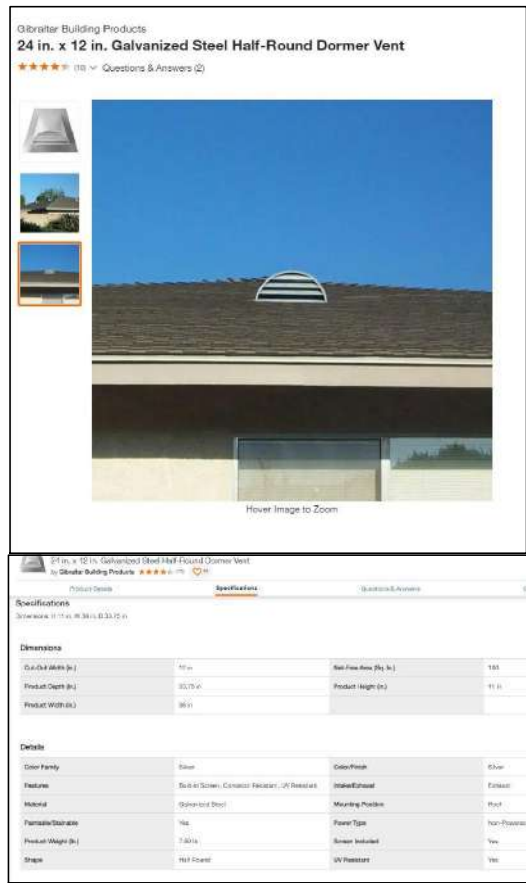

7 / 8" EXTERIOR CEMENT PLASTER (3 COATS) OVER METAL LATH, 2 LAYER GRADE "D" BUILDING PAPER 1/2" CDX OR OSB, 2x STUDS EXTERIOR WALL (MATCH EXISTING)

(N) COMPOSITION SHINGLE (CLASS 'C' MIN.) w/1/2" CDX OR OSB AND RADIANT BARRIER PAPER OVER TYP. #30 FELT (COLOR MATCH WITH EXISTING)

7 / 8" EXTERIOR CEMENT PLASTER (3 COATS) OVER METAL LATH, 2 LAYER GRADE "D" BUILDING PAPER 1/2" CDX OR OSB, 2x STUDS EXTERIOR WALL (MATCH EXISTING)

26 GA. GI. SHEET METAL WEEP SCREED MIN. 4" INCHES ABOVE GRADE, 2" INCHES ABOVE PAVED AREAS

HOUSE FRONT ELEVATION  
SCALE: 1 / 4" = 1'-0"

7 / 8" EXTERIOR CEMENT PLASTER (3 COATS) OVER METAL LATH, 2 LAYER GRADE "D" BUILDING PAPER 1/2" CDX OR OSB, 2x STUDS EXTERIOR WALL (MATCH EXISTING)

(N) COMPOSITION SHINGLE (CLASS 'C' MIN.) w/1/2" CDX OR OSB AND RADIANT BARRIER PAPER OVER TYP. #30 FELT (COLOR MATCH WITH EXISTING)

26 GA. GI. SHEET METAL WEEP SCREED MIN. 4" INCHES ABOVE GRADE, 2" INCHES ABOVE PAVED AREAS

HOUSE REAR ELEVATION  
SCALE: 1 / 4" = 1'-0"

(N) COMPOSITION SHINGLE (CLASS 'C' MIN.) w/1/2" CDX OR OSB AND RADIANT BARRIER PAPER OVER TYP. #30 FELT (COLOR MATCH WITH EXISTING)


(N) COMPOSITION SHINGLE (CLASS 'C' MIN.) w/1/2" CDX OR OSB AND RADIANT BARRIER PAPER OVER TYP. #30 FELT (COLOR MATCH WITH EXISTING)

7 / 8" EXTERIOR CEMENT PLASTER (3 COATS) OVER METAL LATH, 2 LAYER GRADE "D" BUILDING PAPER 1/2" CDX OR OSB, 2x STUDS EXTERIOR WALL (MATCH EXISTING)


(N) COMPOSITION SHINGLE (CLASS 'C' MIN.) w/1/2" CDX OR OSB AND RADIANT BARRIER PAPER OVER TYP. #30 FELT (COLOR MATCH WITH EXISTING)

HOUSE RIGHT ELEVATION  
SCALE: 1 / 4" = 1'-0"

26 GA. GI. SHEET METAL WEEP SCREED MIN. 4" INCHES ABOVE GRADE, 2" INCHES ABOVE PAVED AREAS

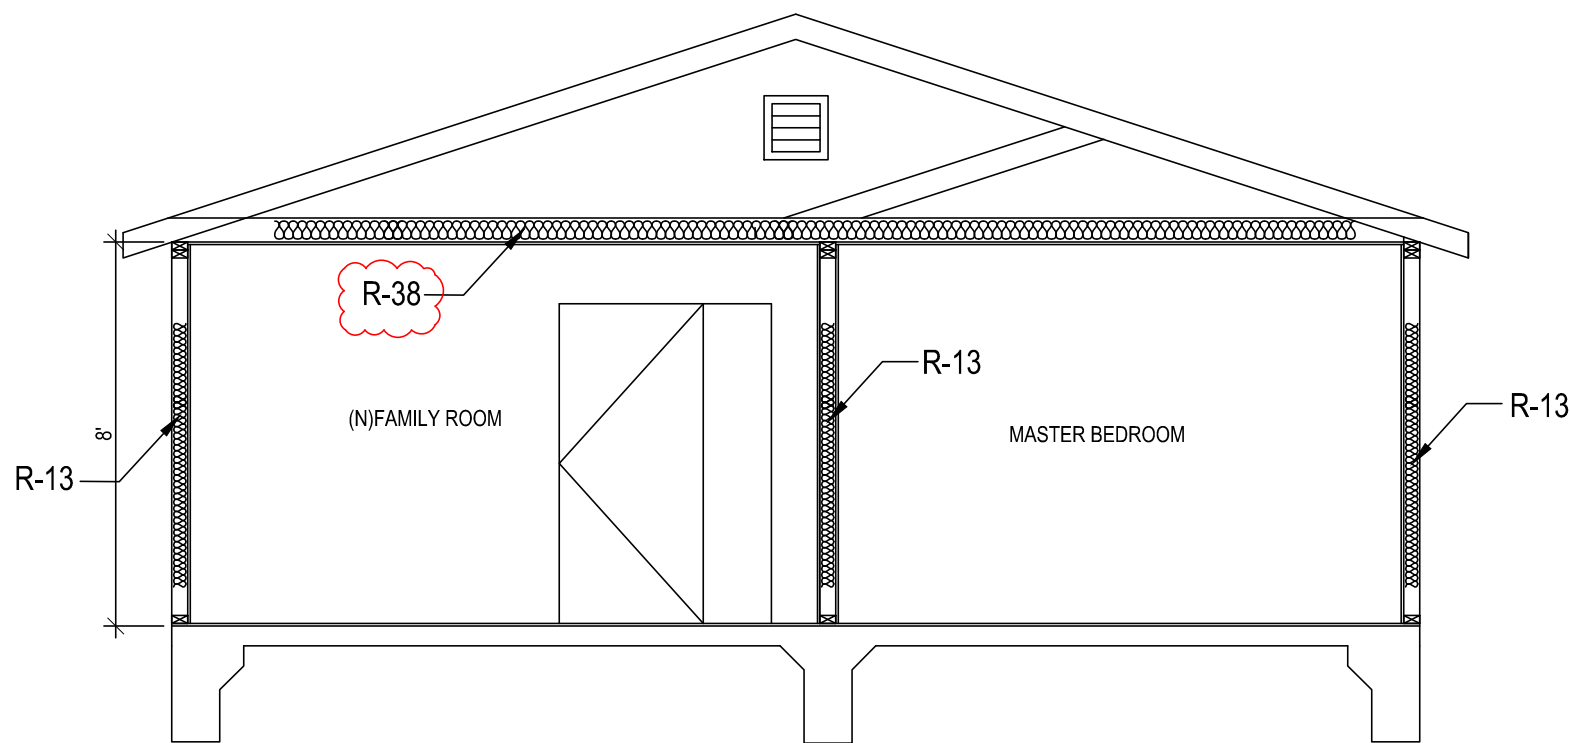

HOUSE FRONT ELEVATION  
SCALE: 1 / 4" = 1'-0"

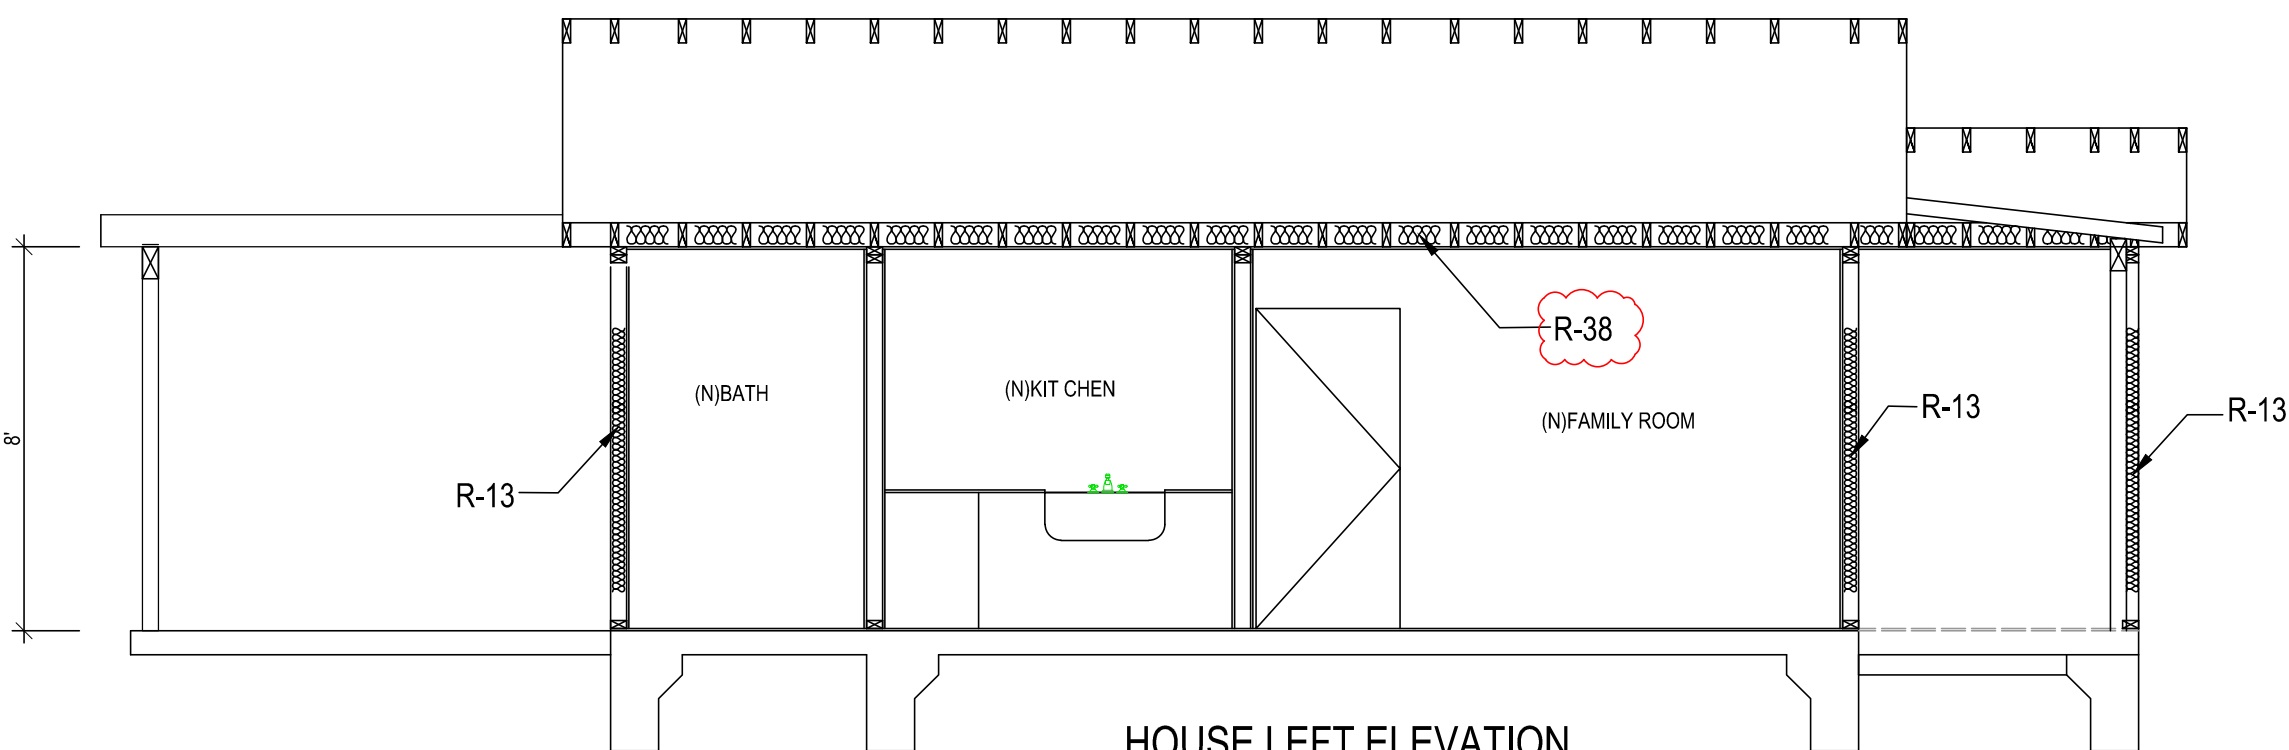

HOUSE LEFT ELEVATION  
SCALE: 1 / 4" = 1'-0"

STAMPED FROM CITY

REVIEWED FOR  
COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email: helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

ELEVATION PLANS

1154 D ST HAYWARD, CA 94541

Unit A

REVISION	DATE	BY
1	05-19-2025	HL

Scale: AS SHOWN

SHEET NO:

A-3




BRACE WALL SCHEDULE						
TYPE	STUD	1/2 CDX (OSB)	NAILS	SILL PLATE NAILS P.T.	FRAMING CLIP ANGLE @ TOP PLATE	ANCHOR BOLT
	2X4 @16" O.C.	1/2 CDX (OSB)	10d @ 6" EDGE 10d @ 12" FIELD	16d@4" O.C.	LS80 @ 16"O.C. A 35 @ 16" O.C.	5/8 Ø-12" @ 48"O.C. W/3"x3"x0.4 PWASHER
	ALTERNATE SHEAR WALL BRACE					

MODEL #	DIAMETER (INCHES)	LENGTH L (INCHES)	MINIMUM IMBEDDED L <sub>e</sub> (INCHES)	MIN. END DISTANCE d <sub>e</sub> (INCHES)	MIN. EDGE DISTANCE d <sub>e</sub> (INCHES)	MIN. WALL WIDTH b (INCHES)
SSTB16	5/8	1'-5"	12 5/8"	0-5"	0-1 3/4"	0-4"
SSTB20	5/8	1'-9"	16 5/8"	0-5"	0-1 3/4"	0-4"
SSTB24	5/8	2'-1"	20 5/8"	0-5"	0-1 3/4"	0-4"
SSTB28	7/8	2'-3"	24 7/8"	0-5"	0-1 3/4"	0-4"


NOTE:  
FOUNDATION NOTES:  
CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE  
STRENGTH OF  
2,500 PSI AT 28 DAYS. (R402.2)

DESIGN LOADS:  
FLOOR DEAD = 10 psf  
CEILING DEAD = 6 psf  
ROOF DEAD = 10 psf  
FLOOR LIVE = 40 psf  
CEILING LIVE = 10 psf  
ROOF LIVE = 20 psf  
WINDS PEED, V = 110 mph  
SEISMIC DESIGN CATEGORY D2  
S<sub>DS</sub> = 1.872  
WALL HEIGHT = 8 FEET


NOTE:  
PLACE SOLAR PANELS  
IN MOST OPTIMAL POSITION  
MIN 2.8 KWdc.  
Related to the solar panel installation, including  
providing typical attachment details, specifying the  
maximum screw diameter, and ensuring that  
blocking and/or framing sizes meet the 4D edge  
distance requirement per NDS Table 12.5.10, will be  
handled by the solar panel company. This includes  
obtaining the necessary permit and completing the  
installation. Additionally, this scope of work will be  
included on page A-1.

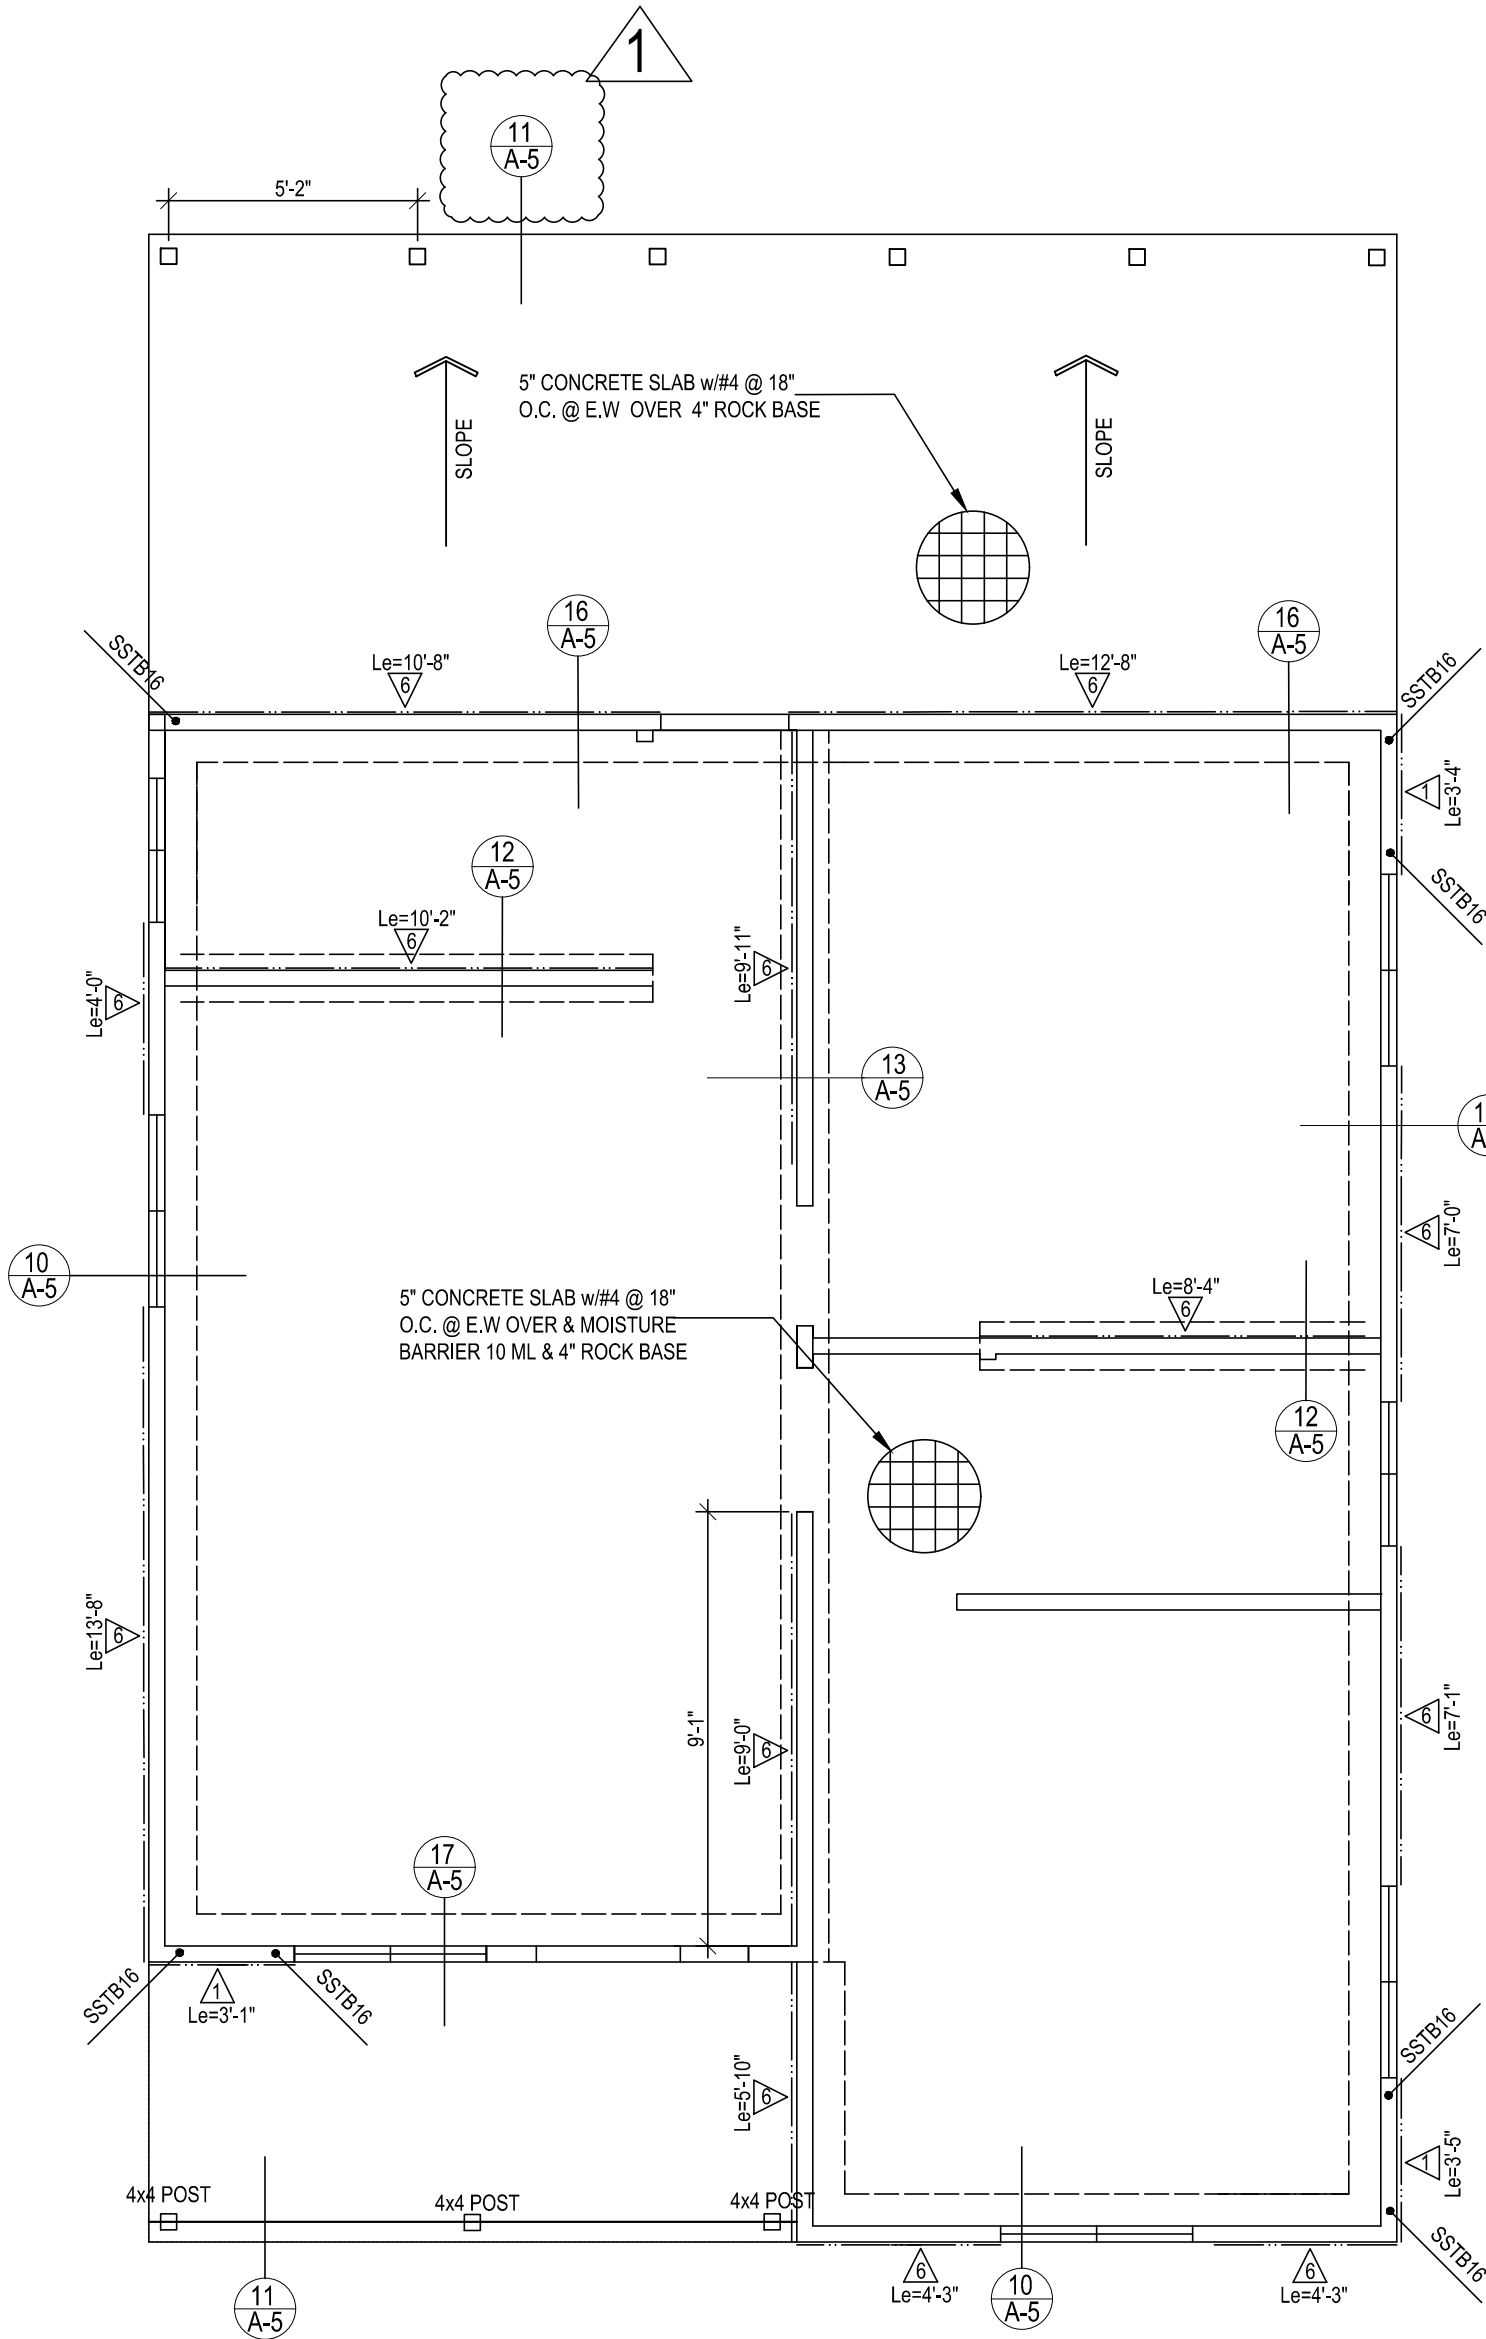


FOUNDATION PLAN  
SCALE: 1 / 4" = 1'-0"

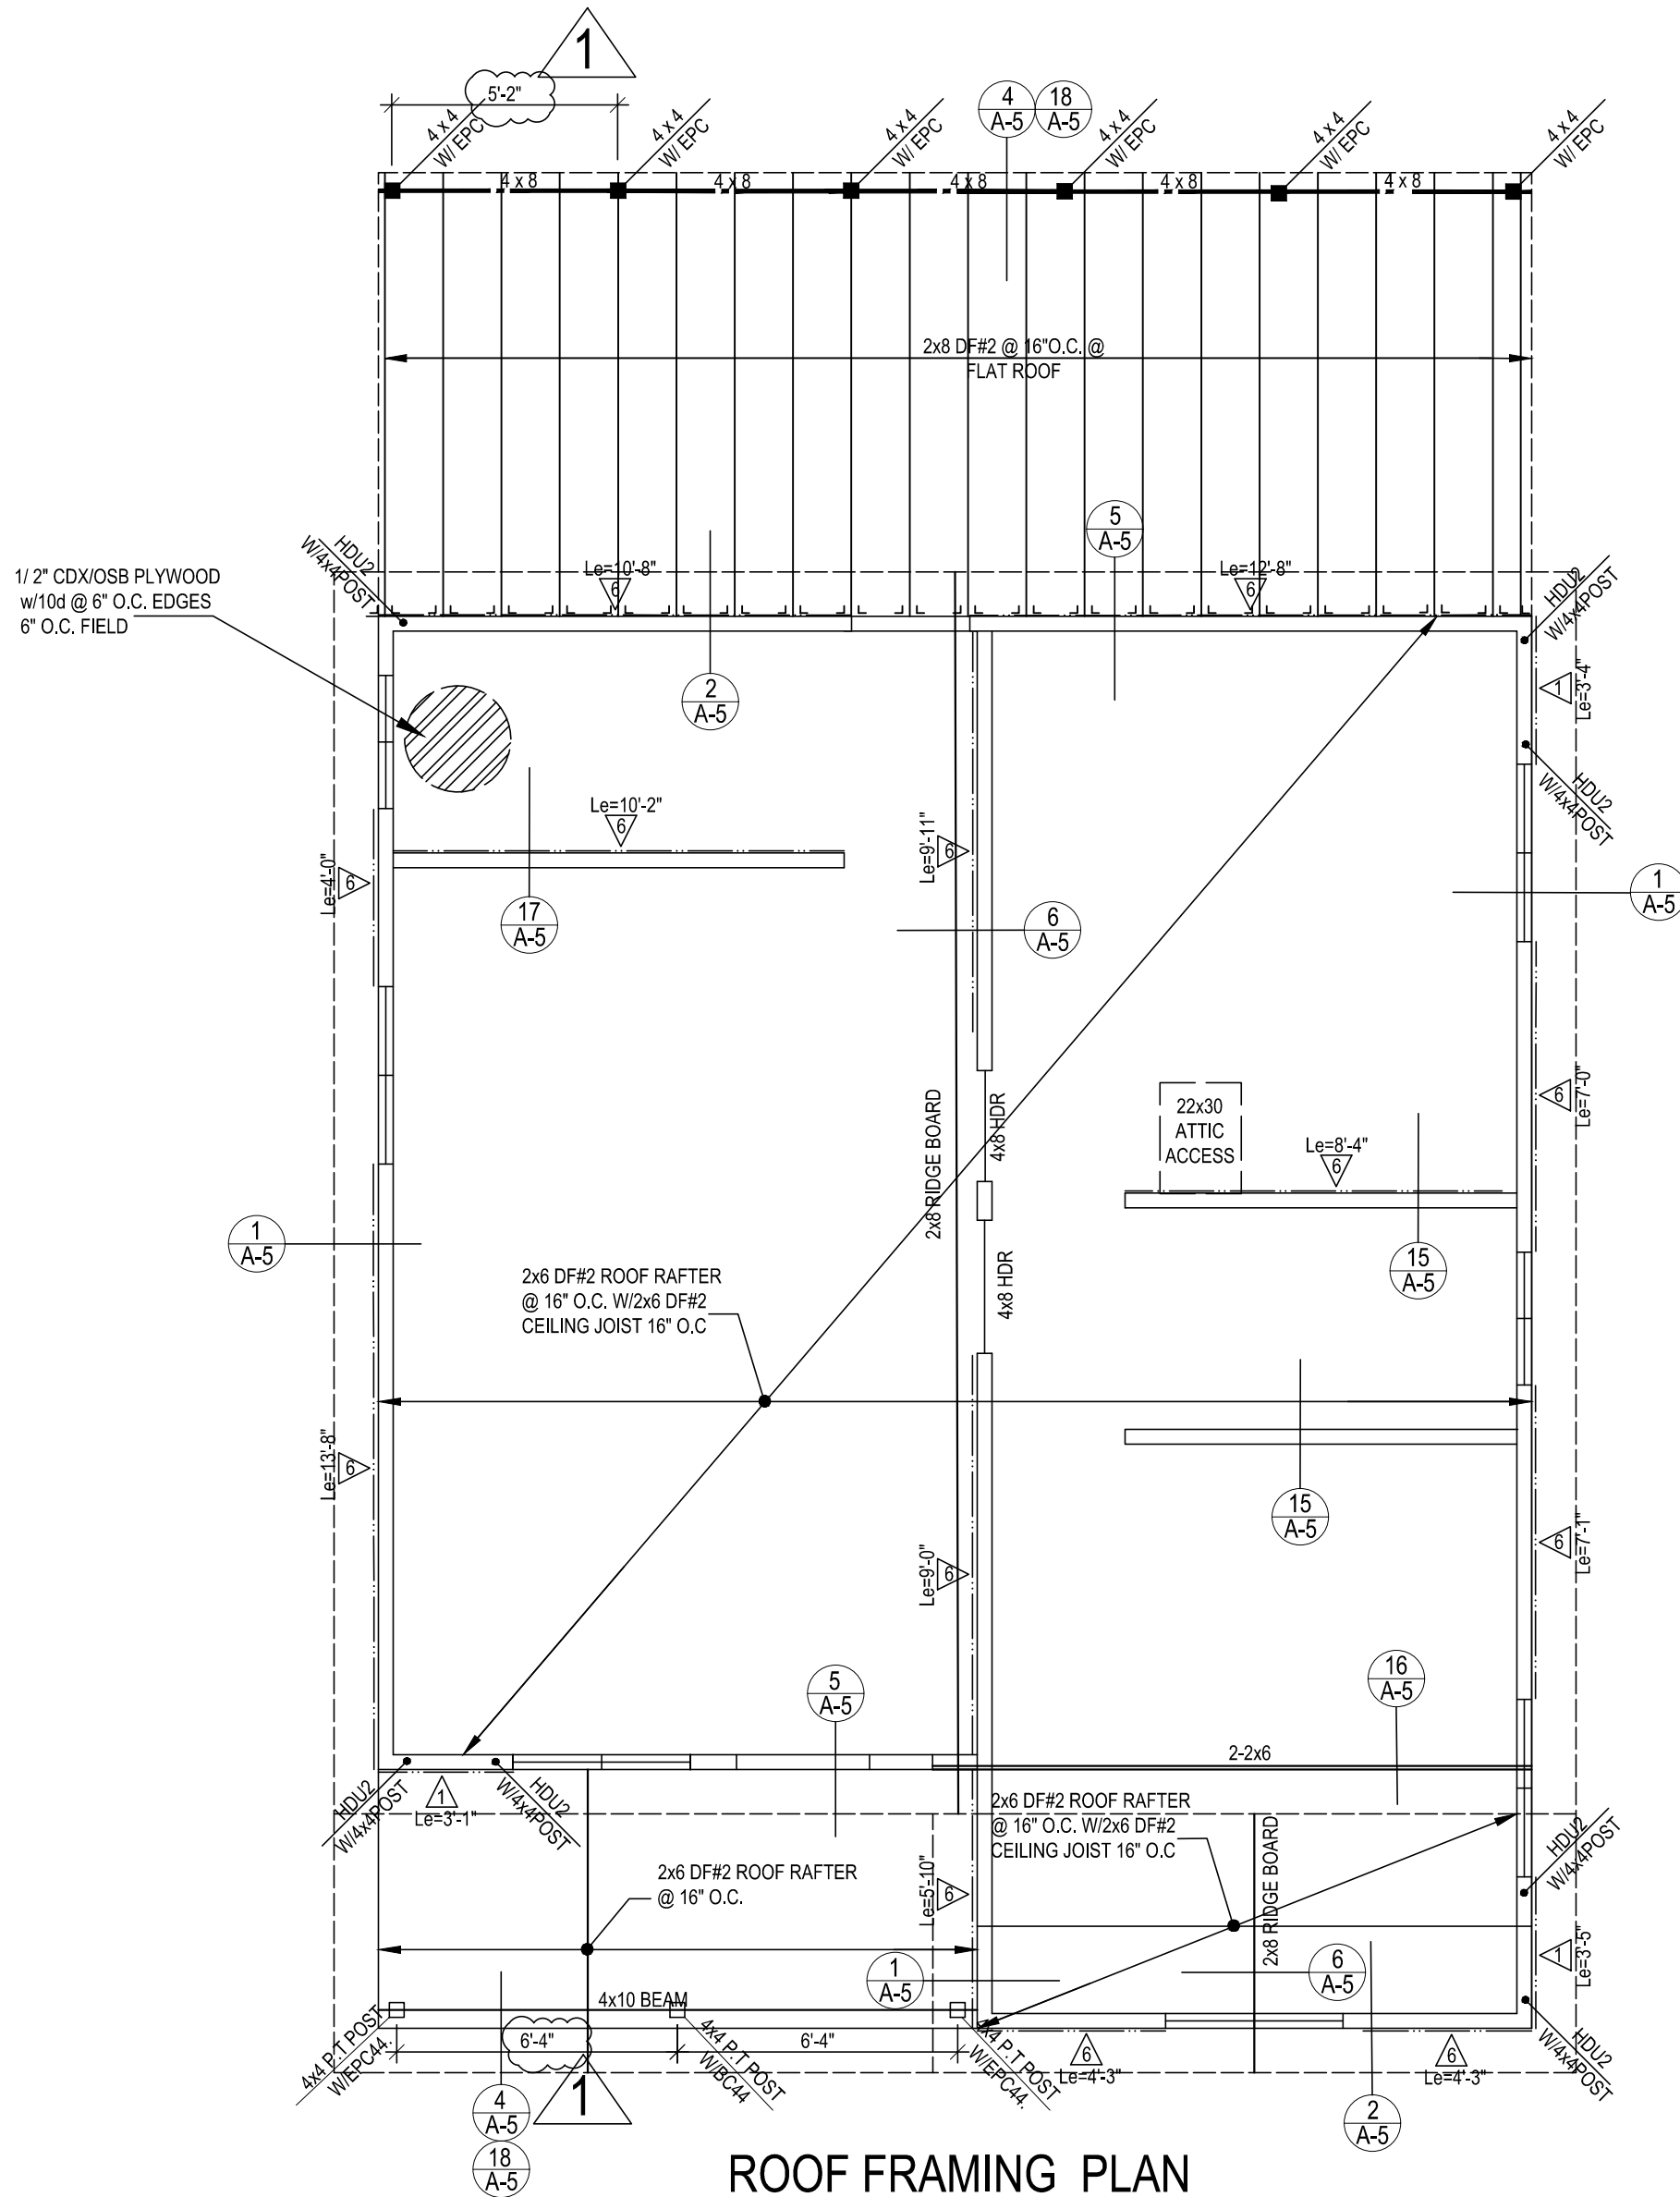

ROOF FRAMING PLAN  
SCALE: 1 / 4" = 1'-0"

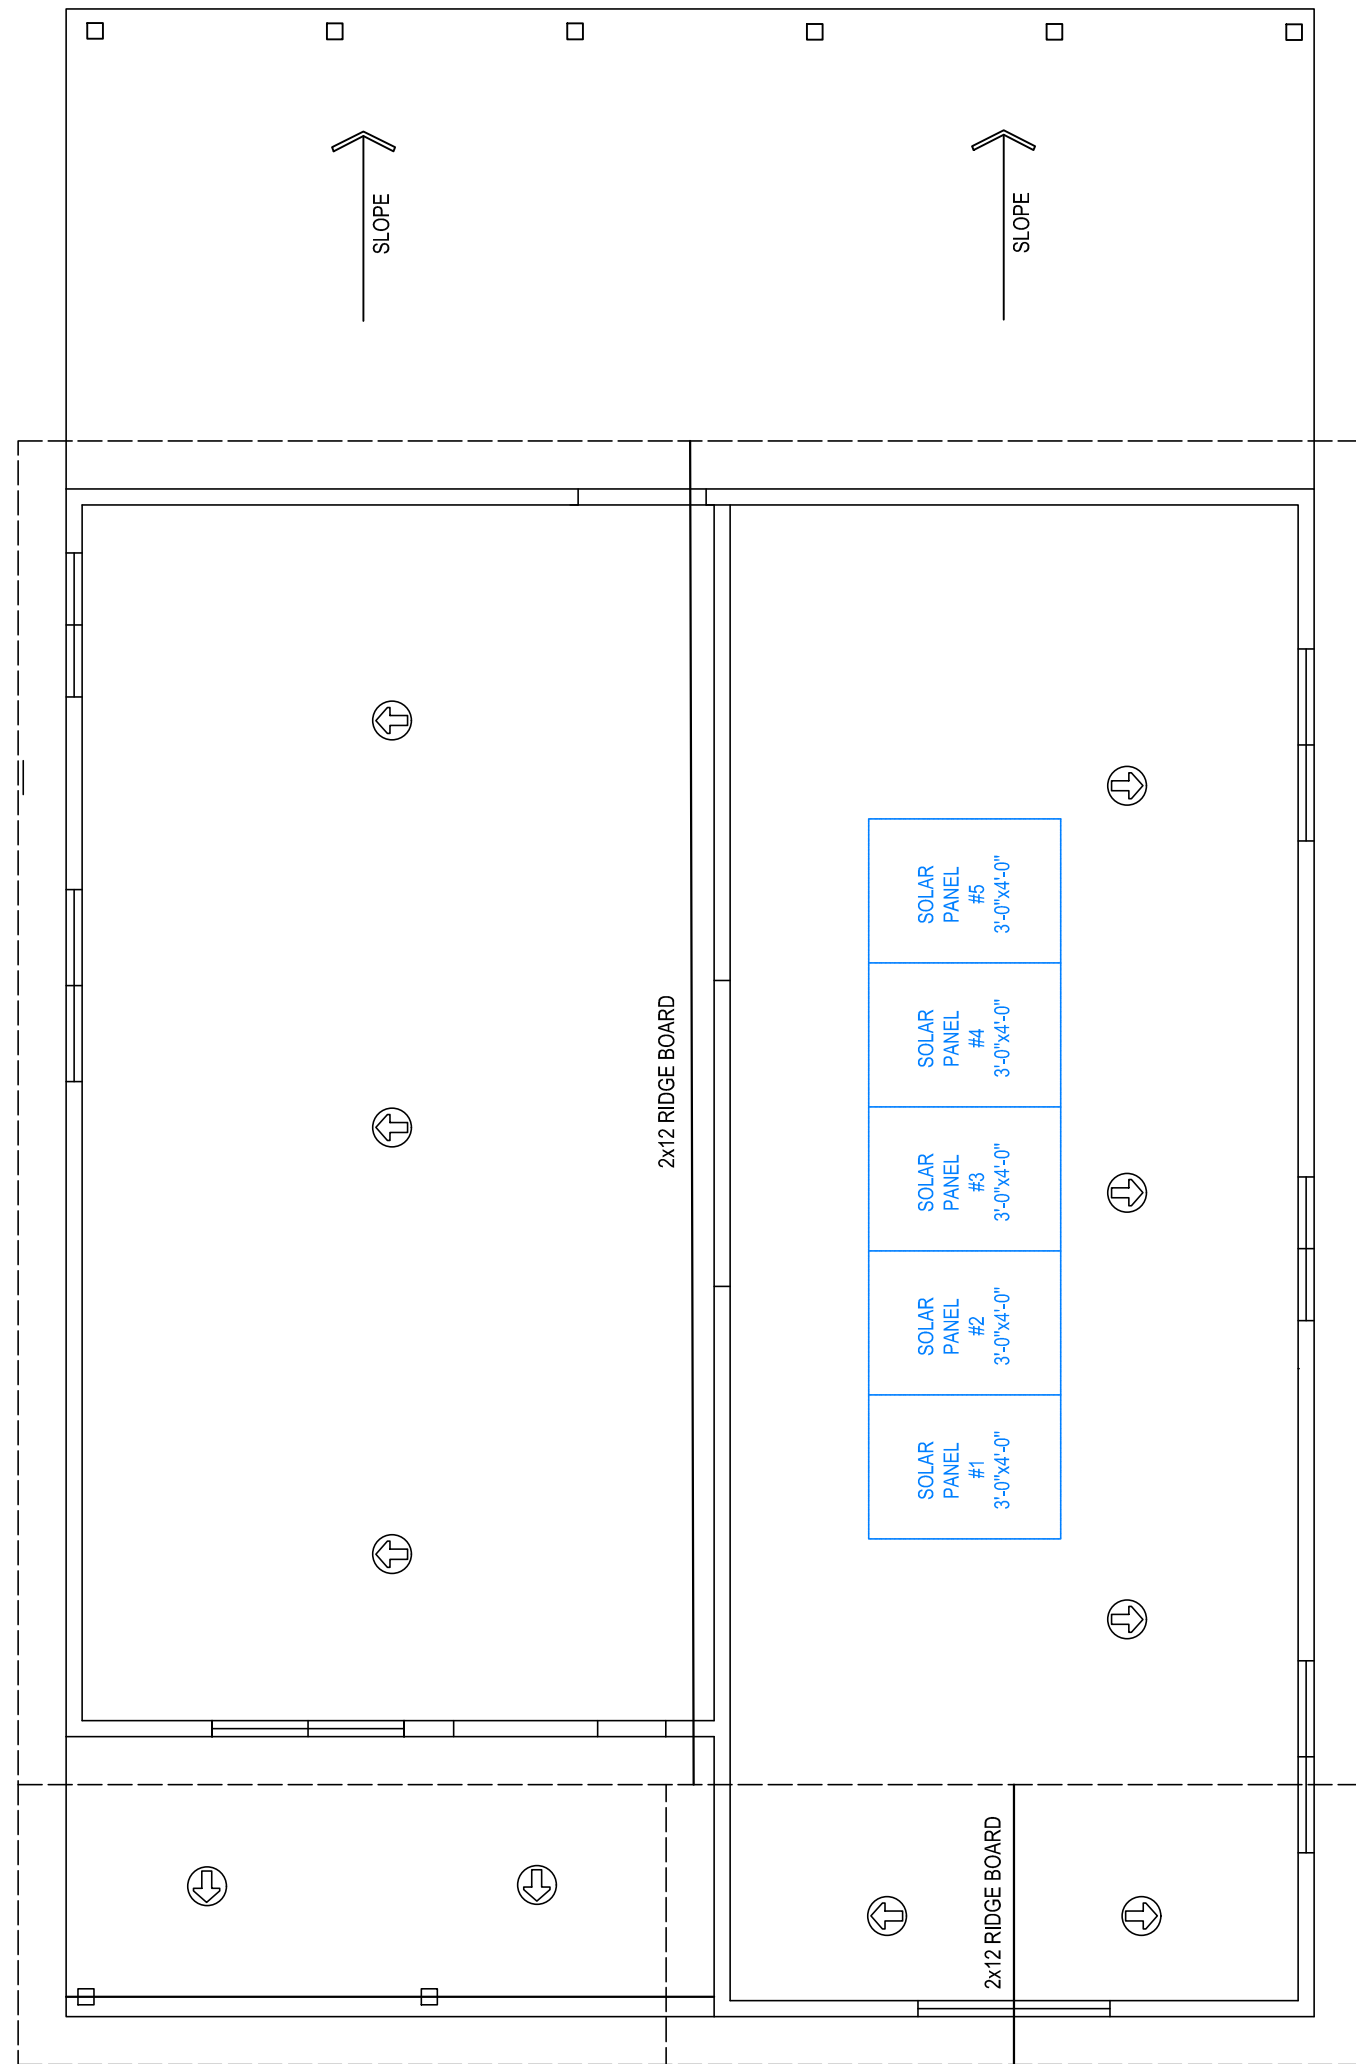

ROOF PLAN  
SCALE: 1 / 4" = 1'-0"

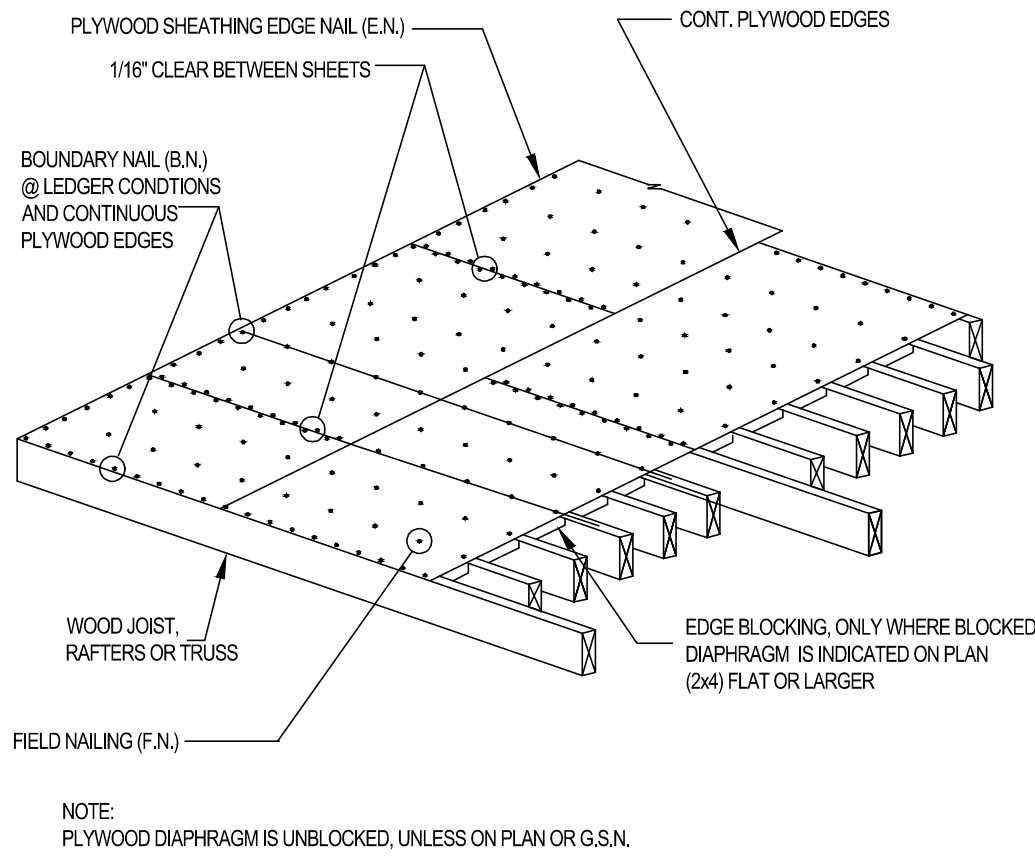

TYPICAL PLYWOOD LAYOUT

NOTES:

- CEILING HEIGHTS: SHALL BE AT LEAST 7'-0" IN HABITABLE ROOMS (BEDROOMS, LIVING ROOMS, DINING ROOMS. CRC R305.1
- EMERGENCY ESCAPE WINDOWS: EACH NEW BEDROOM OR SLEEPING ROOM SHALL HAVE AN EMERGENCY
- ESCAPE WINDOW THAT IS AT LEAST 20" IN WIDTH (NET), 24" IN HEIGHT (NET) WHEN OPEN AND WITH AN OPERABLE AREA OF AT LEAST 5.0 SQUARE FEET IN AREA. ESCAPE WINDOWS SHALL BE INSTALLED WITH BOTTOM OF CLEAR OPENING NO MORE THAN 44" ABOVE FINISH FLOOR. CRC R310.
- ATTIC ACCESS: PROVIDE ACCESS TO ATTIC SPACE WITH AN ACCESS OPENING AT LEAST 22x30" IN SIZE LOCATE THE ACCESS DOOR WHERE THERE IS AT LEAST 30" OF CLEAR HEAD SPACE IN THE ATTIC. CRC 807.
- ATTIC VENTILATION: ATTICS MUST BE VENTILATED WITH TOTAL AREA OF ATTIC VENTS AT LEAST 1.0 SF. (NET) FOR EACH 150 SF. OF ATTIC AREA TO BE VENTILATED. INDICATE ON THE PLANS THE SIZE, LOCATION AND TYPE OF EACH VENT. CRC R806.1.
- SILL PLATES: SILL PLATES FOR NEW WALLS IN A GARAGE CONVERSION MUST BE PRESSURE-TREATED WOOD OR FOUNDATION GRADE (FG) REDWOOD. CRC R317.1.
- INSULATION: INDICATE ON THE PLANS EXTERIOR WALL INSULATION AND CEILING INSULATION. MINIMUM WALL INSULATION IS R-13 AND MINIMUM CEILING INSULATION IS R-30.
- PROVIDE SOLID BLOCKING UNDER ALL NEW INTERIOR WALLS.
- ALL SLEEPERS FOR NEW SUBFLOOR MUST BE PRESSURE-TREATED WOOD.
- PROVIDE VAPOR BARRIER IF CARPET IS DIRECTLY INSTALL ON CONCRETE SLAB.
- ENERGY COMPLIANCE. REFER TO SHEET FOR ENERGY COMPLIANCE REQUIREMENTS.

STAMPED FROM CITY

REVIEWED FOR  
COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email: helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

FOUNDATION PLANS  
AND ROOF FRAMING PLANS  
1154 D ST HAYWARD, CA 94541  
Unit A

REVISION	DATE	BY
	05-19-2025	HL

Scale: AS SHOWN

SHEET NO:

A-4





TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email:helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

DETAILS OF FOUNDATION PLANS  
AND ROOF FRAMING

1154 D ST HAYWARD, CA 94541









Unit A

REVISION	DATE	BY
1	05-19-2025	HL
2	06-13-2025	HL










Scale: AS SHOWN

SHEET NO:



A-5

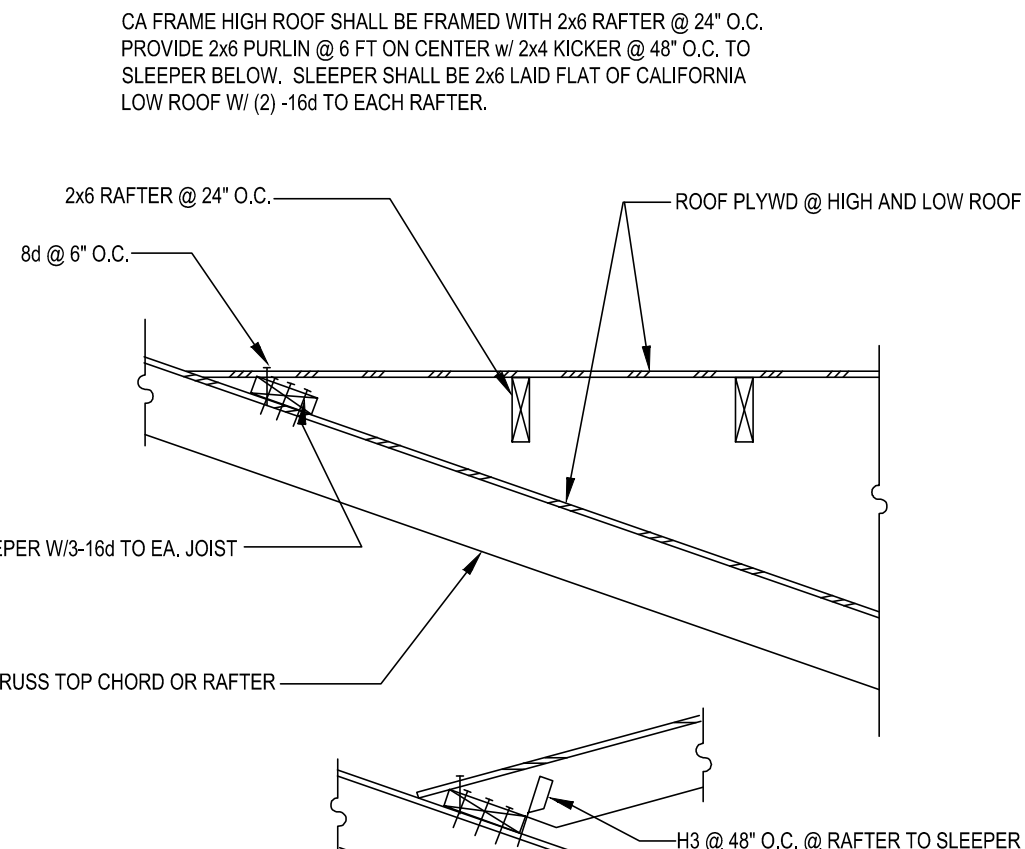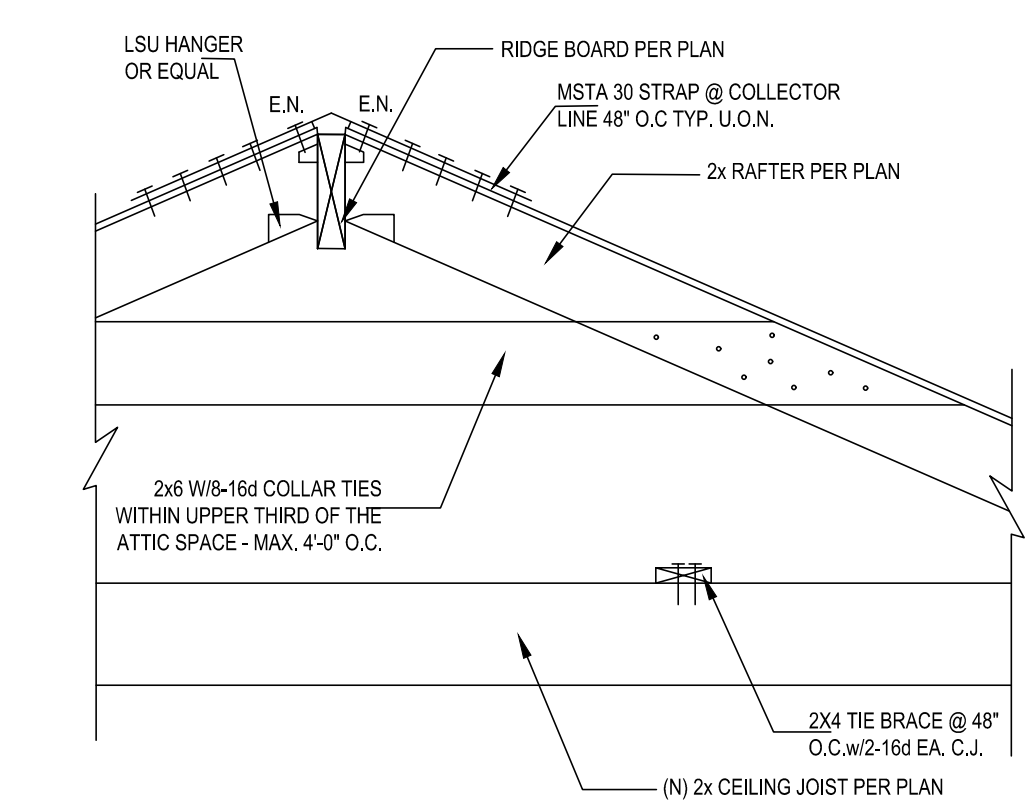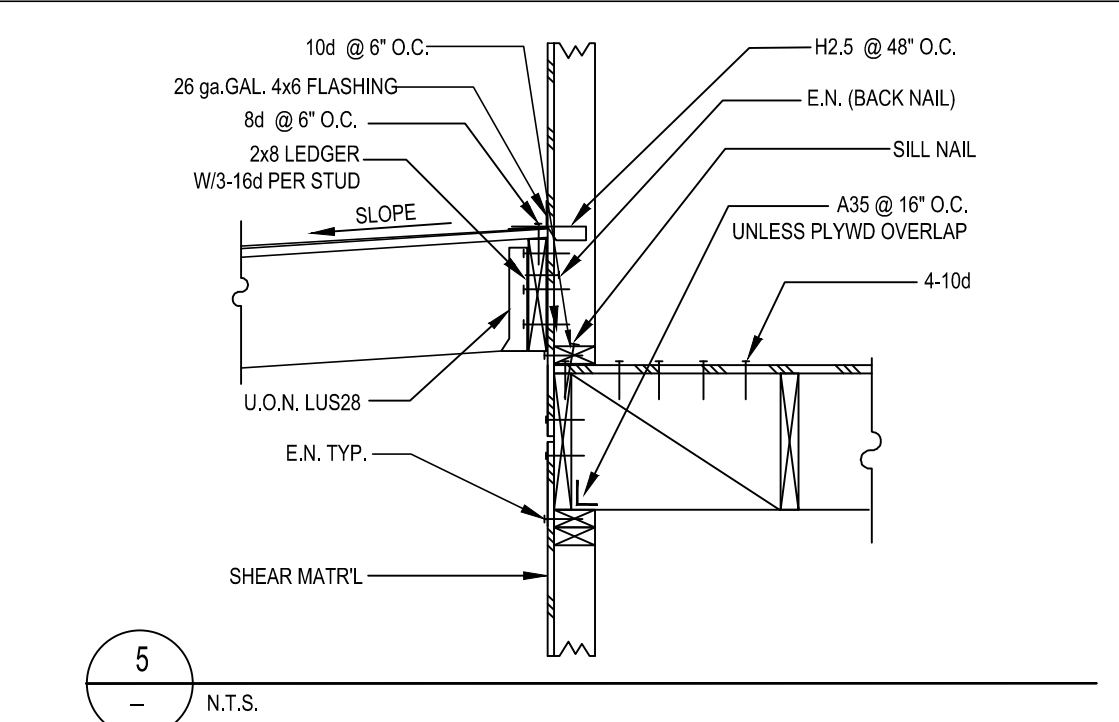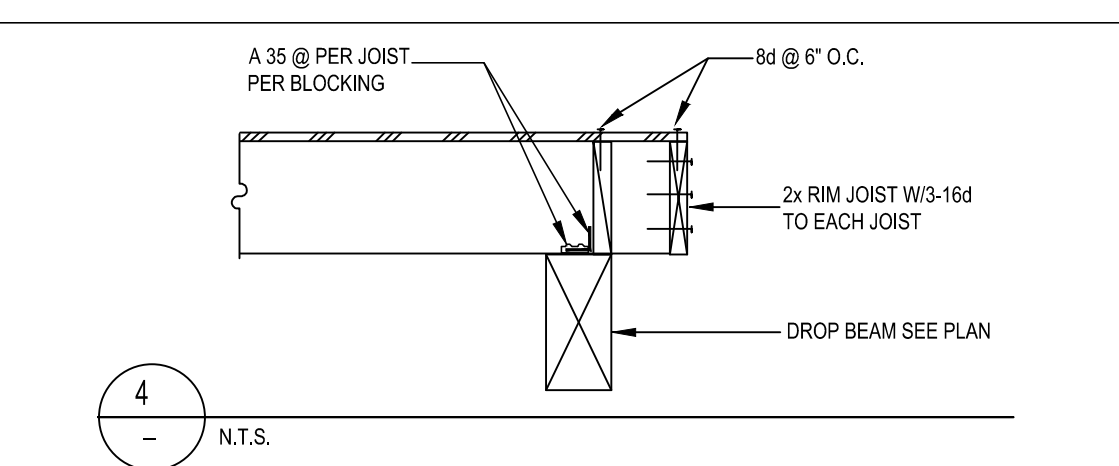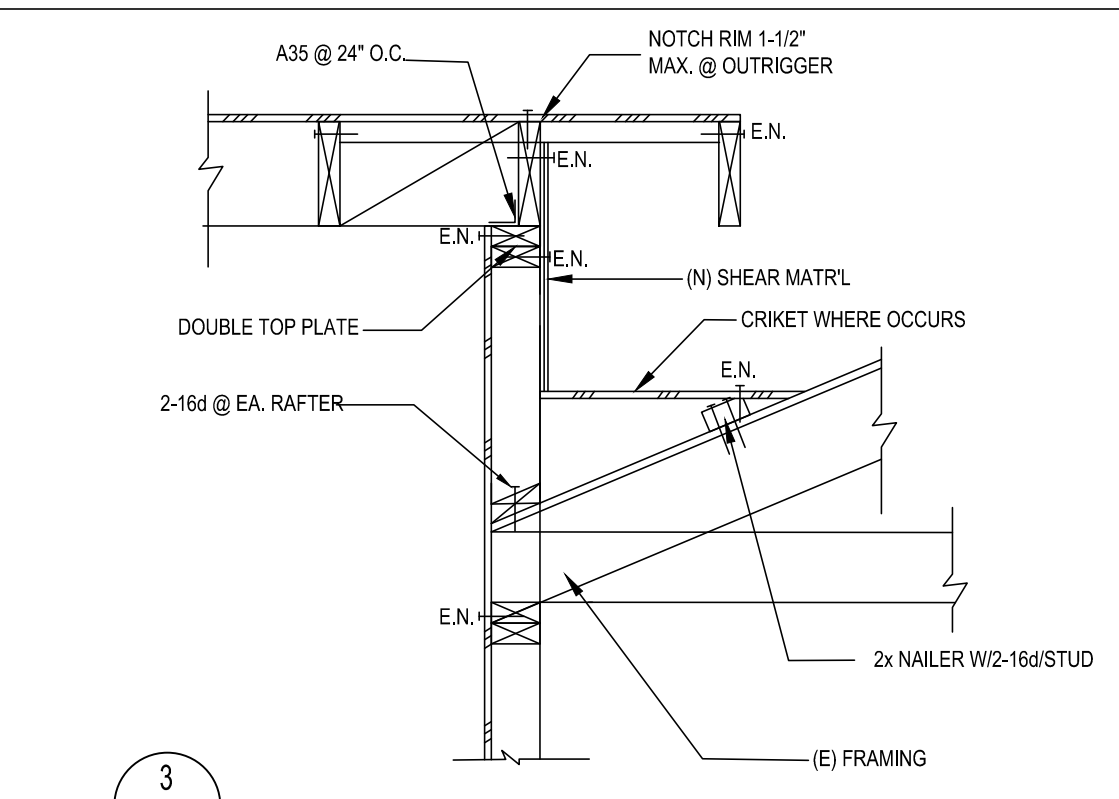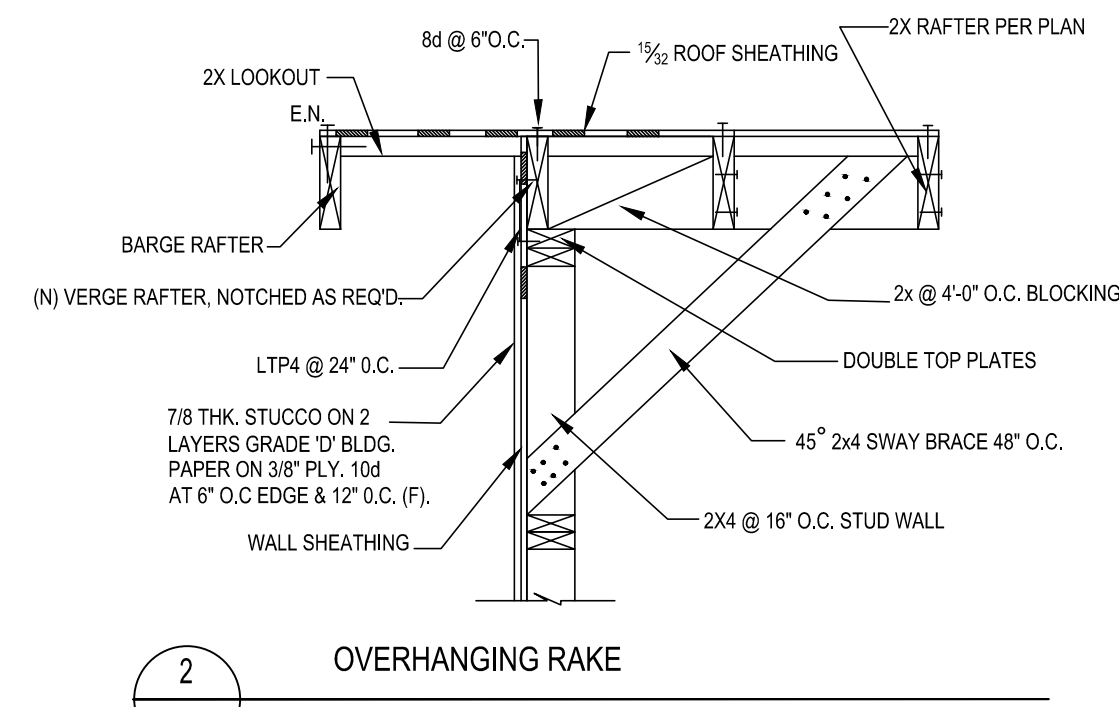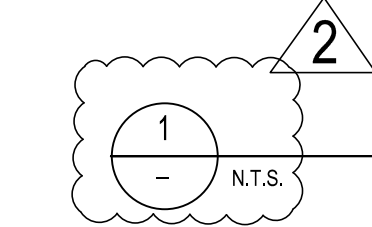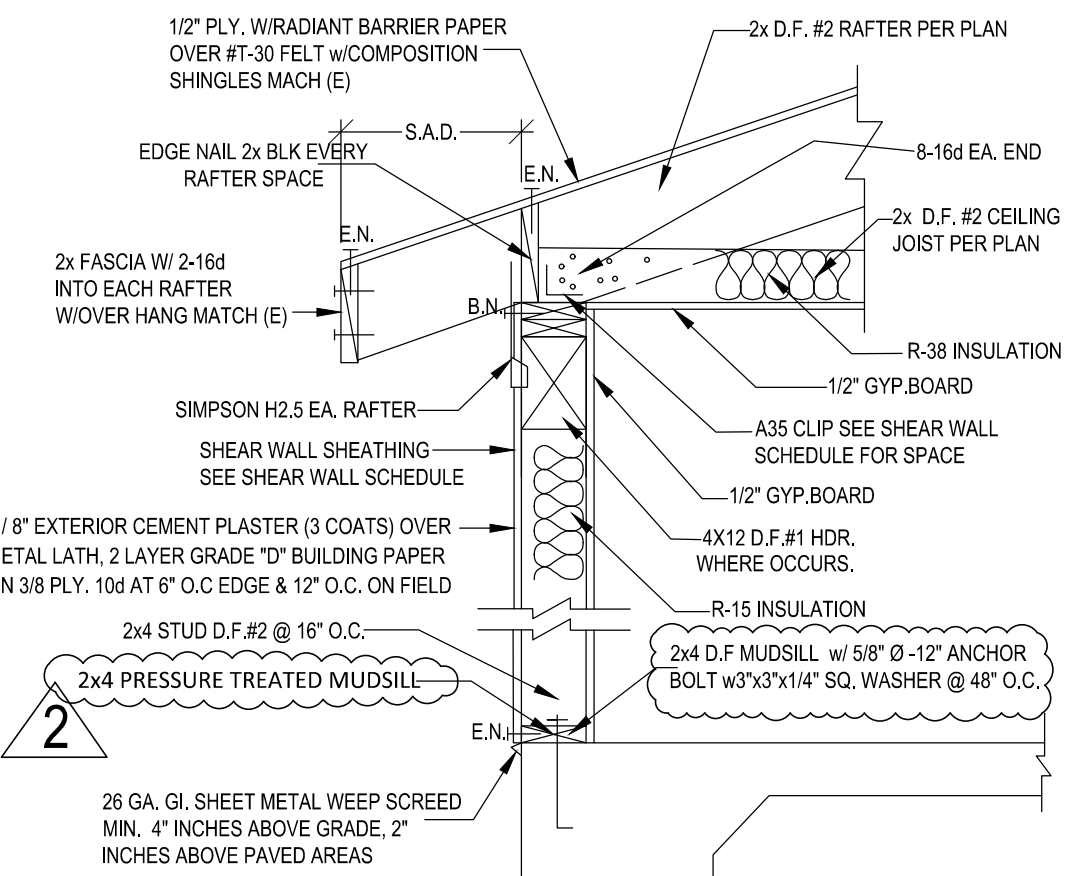









TYP. CA FRAME VALLEY

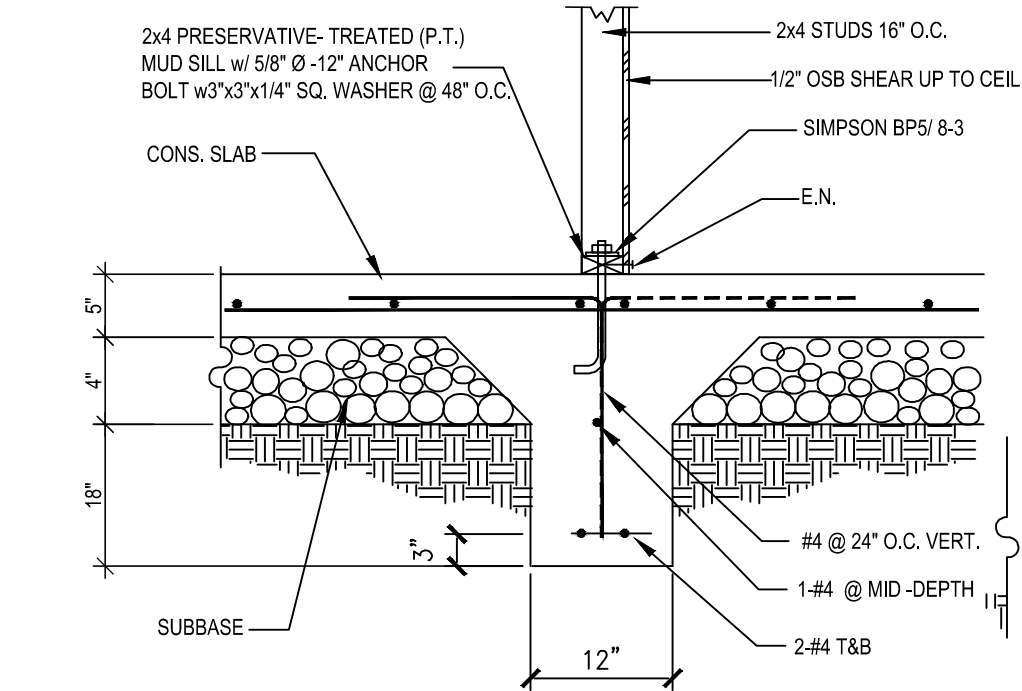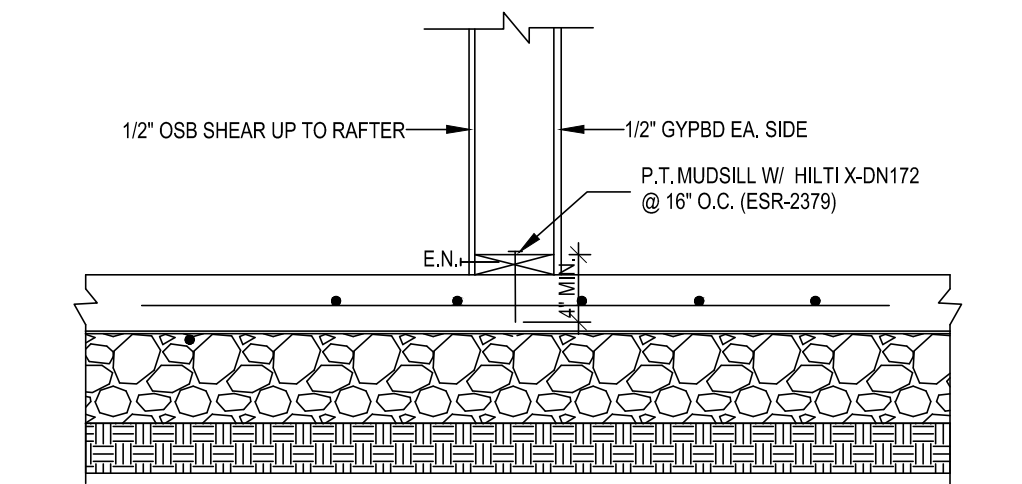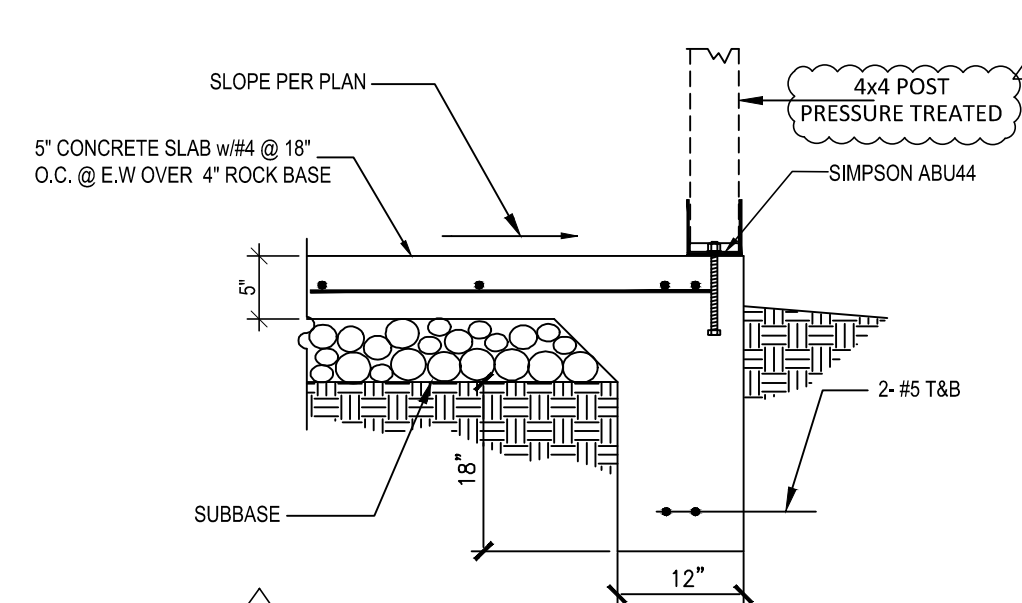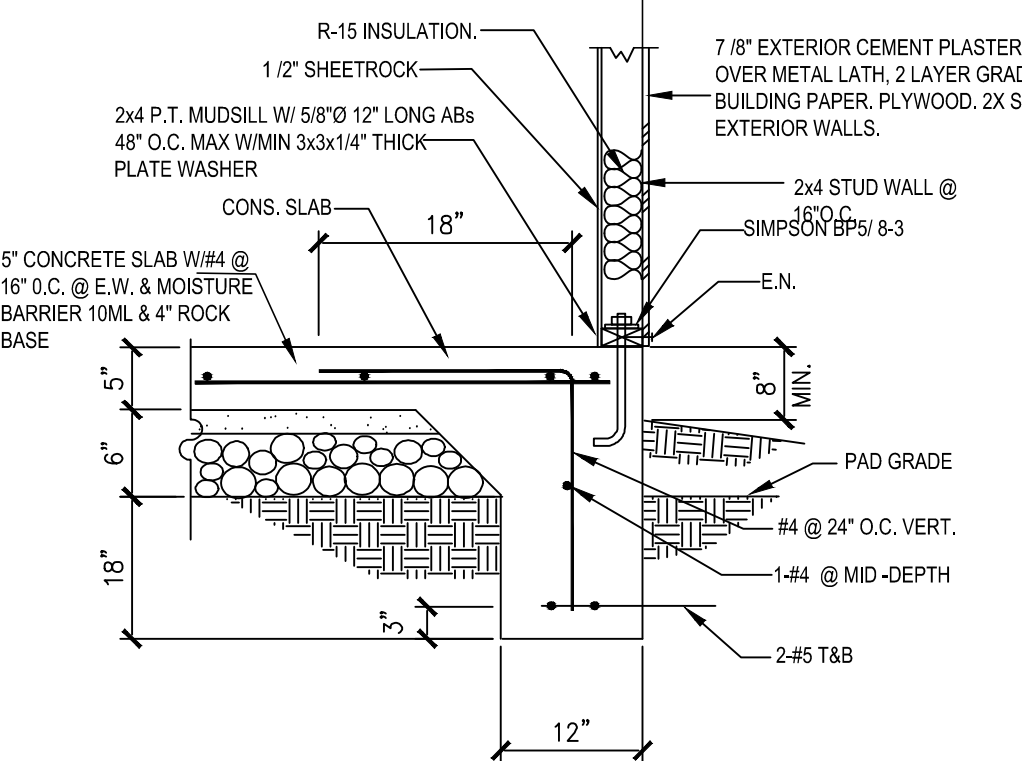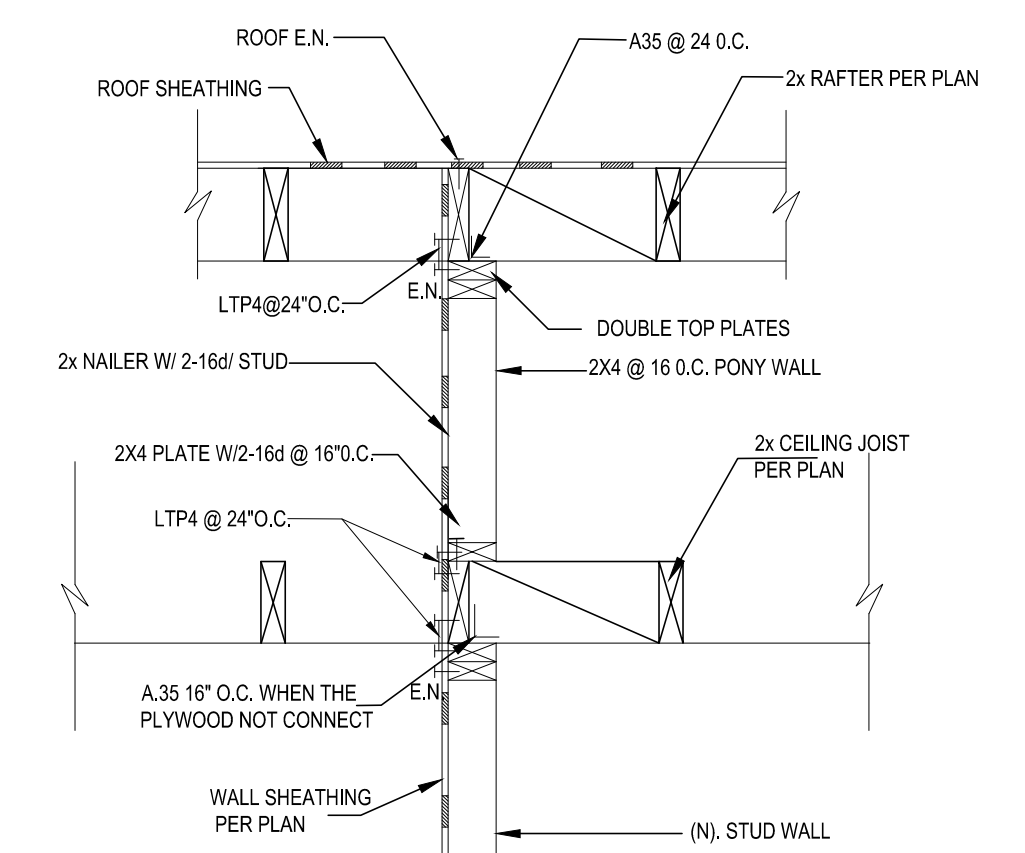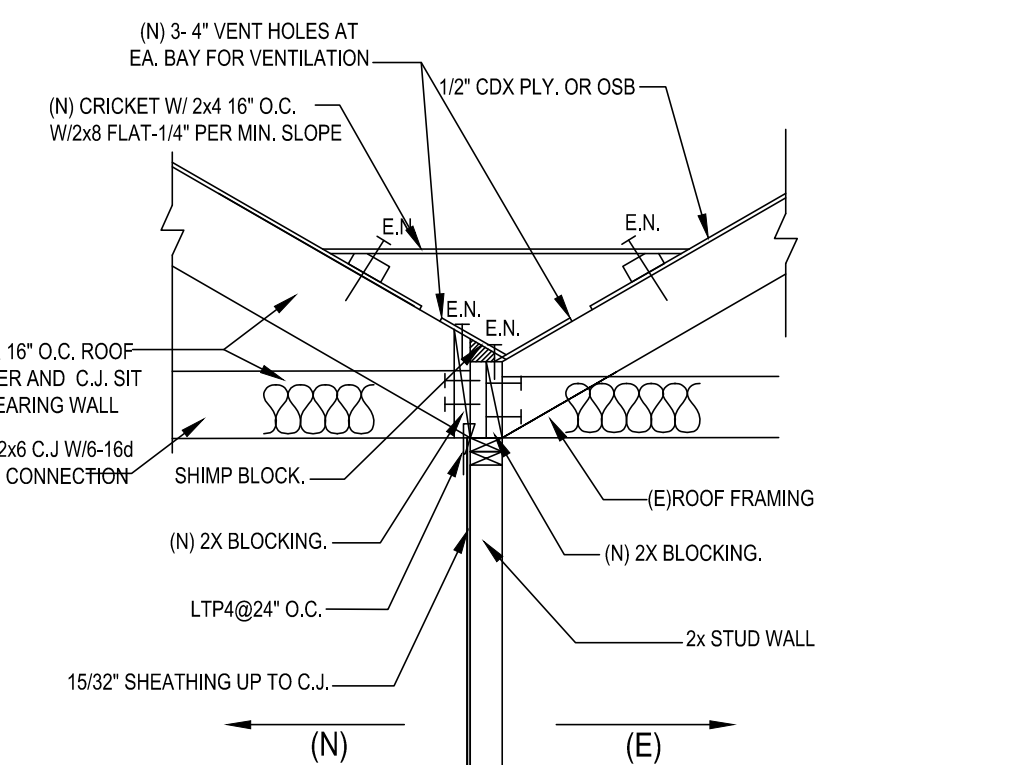


INTERIOR FRONT FOOTING

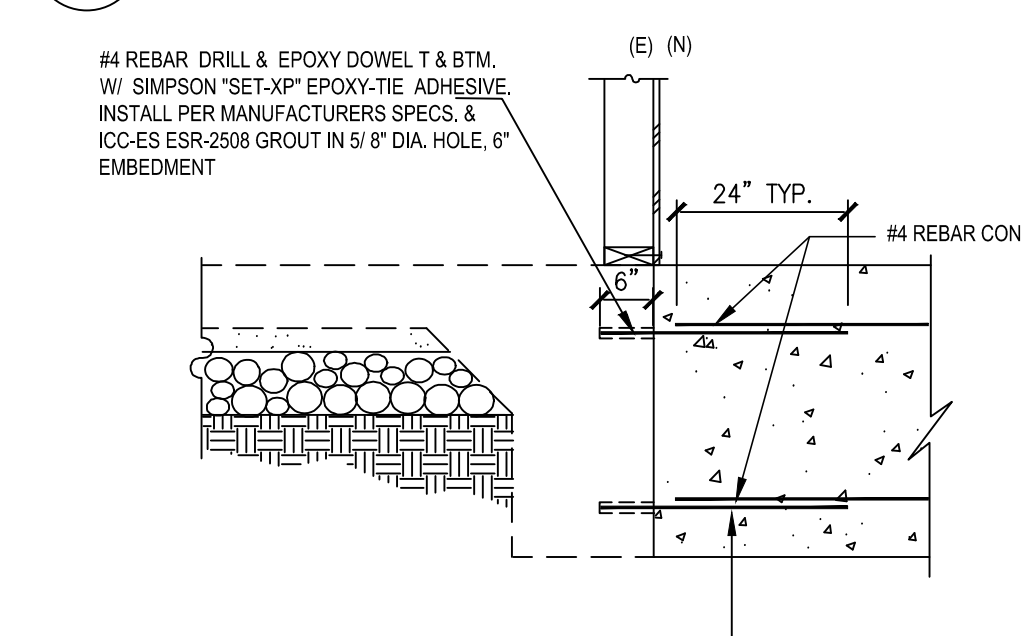

7 EPOXY DOWELS

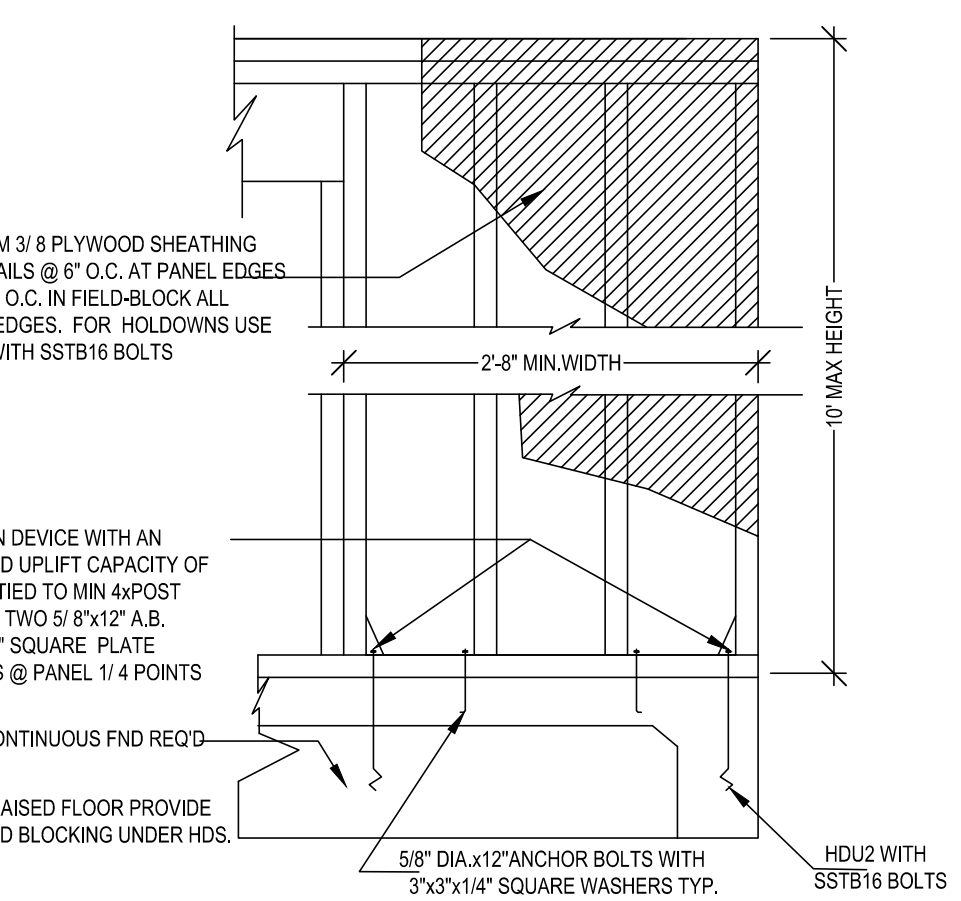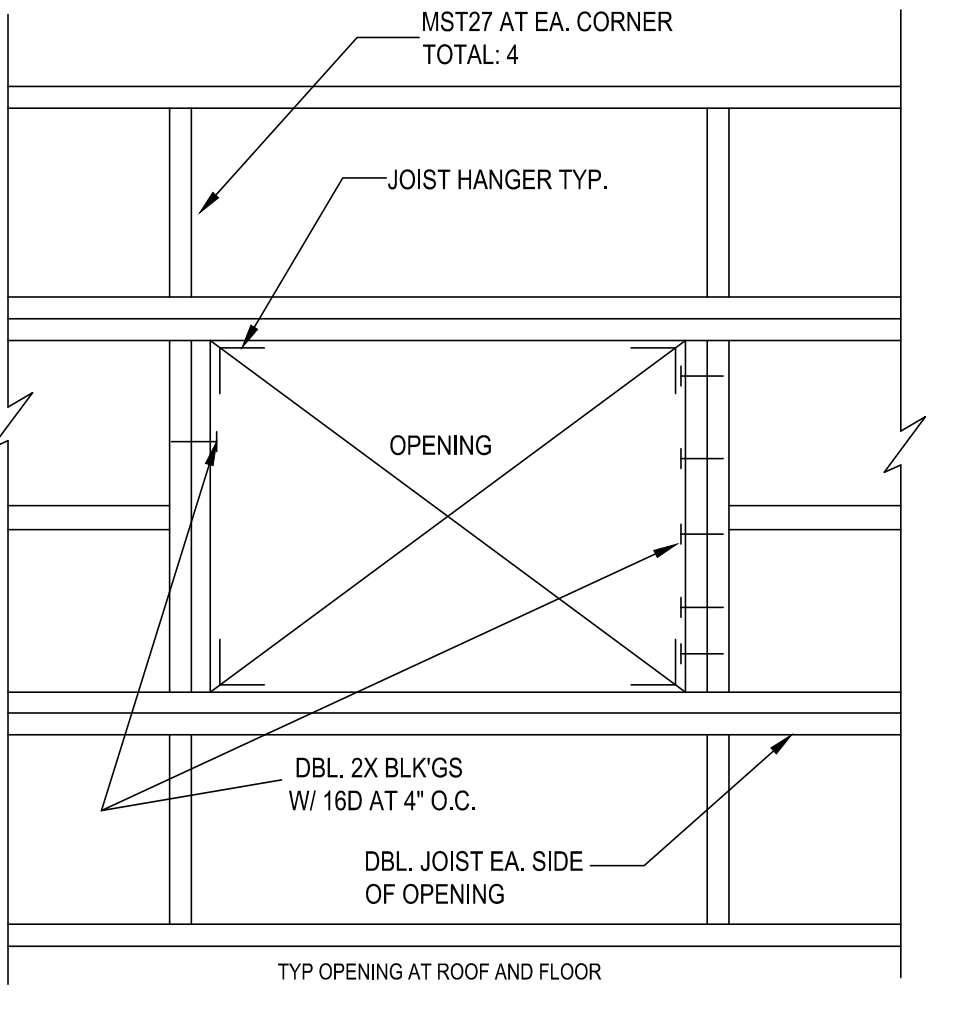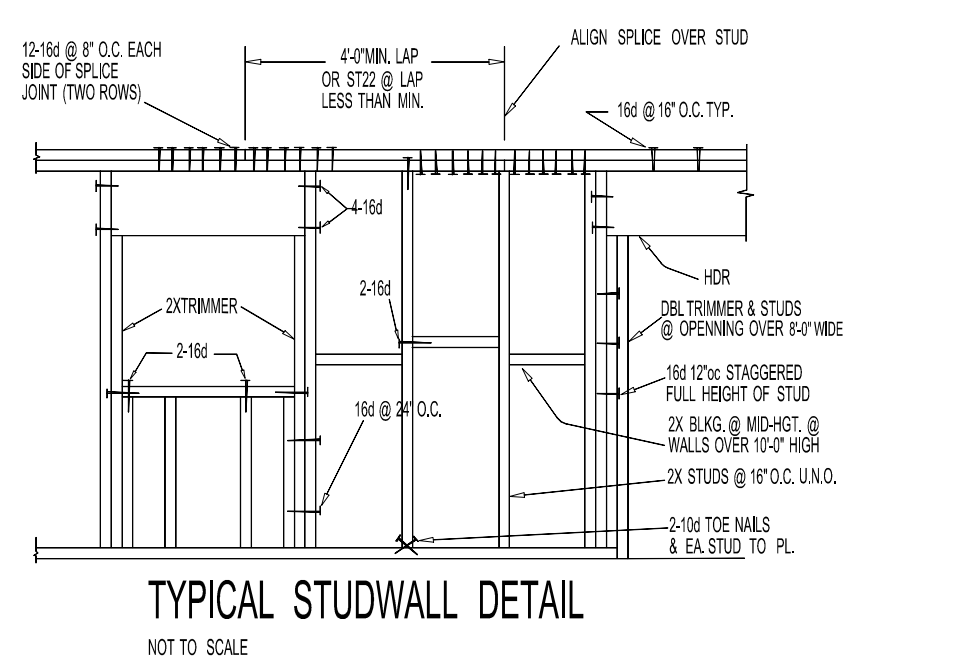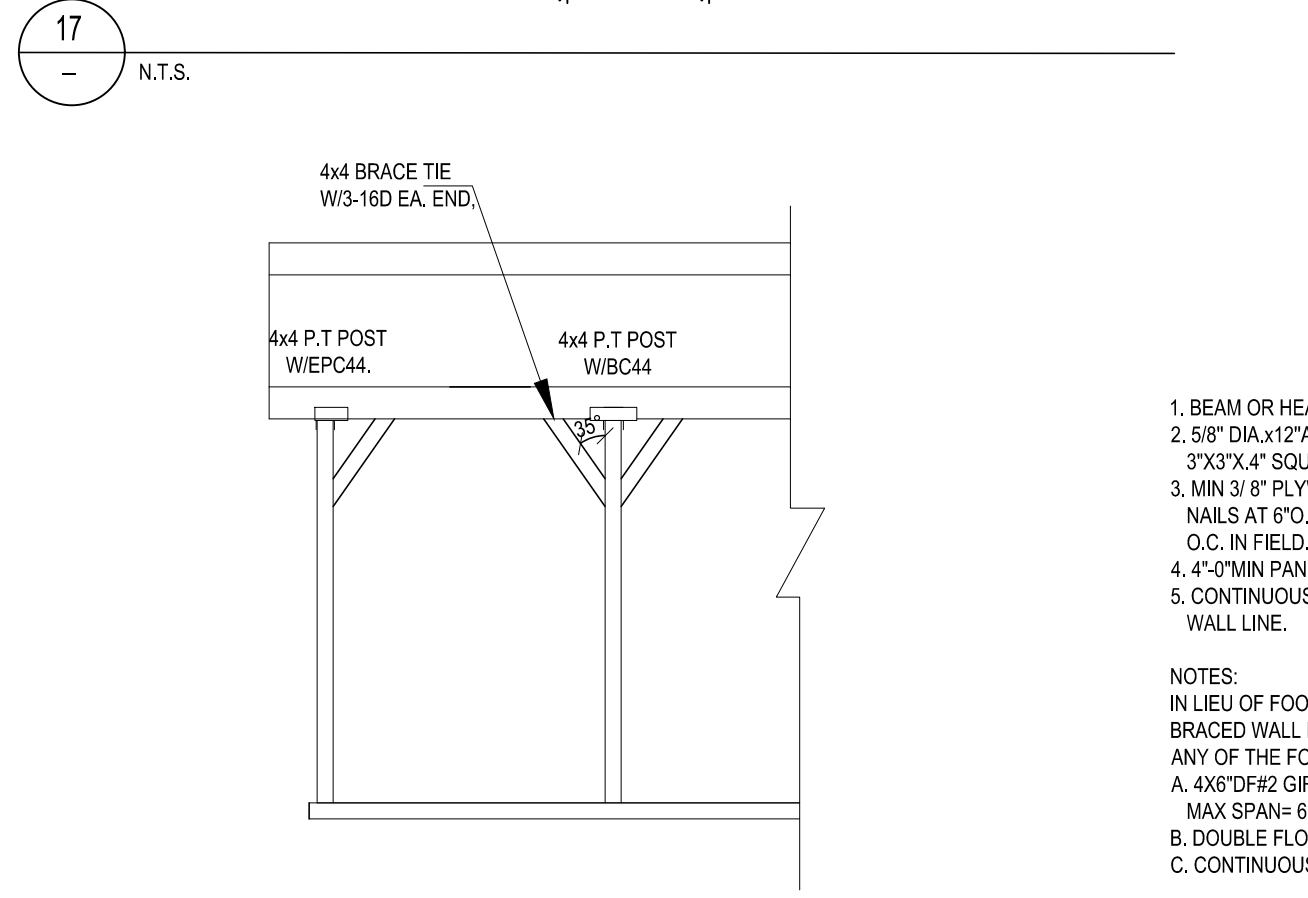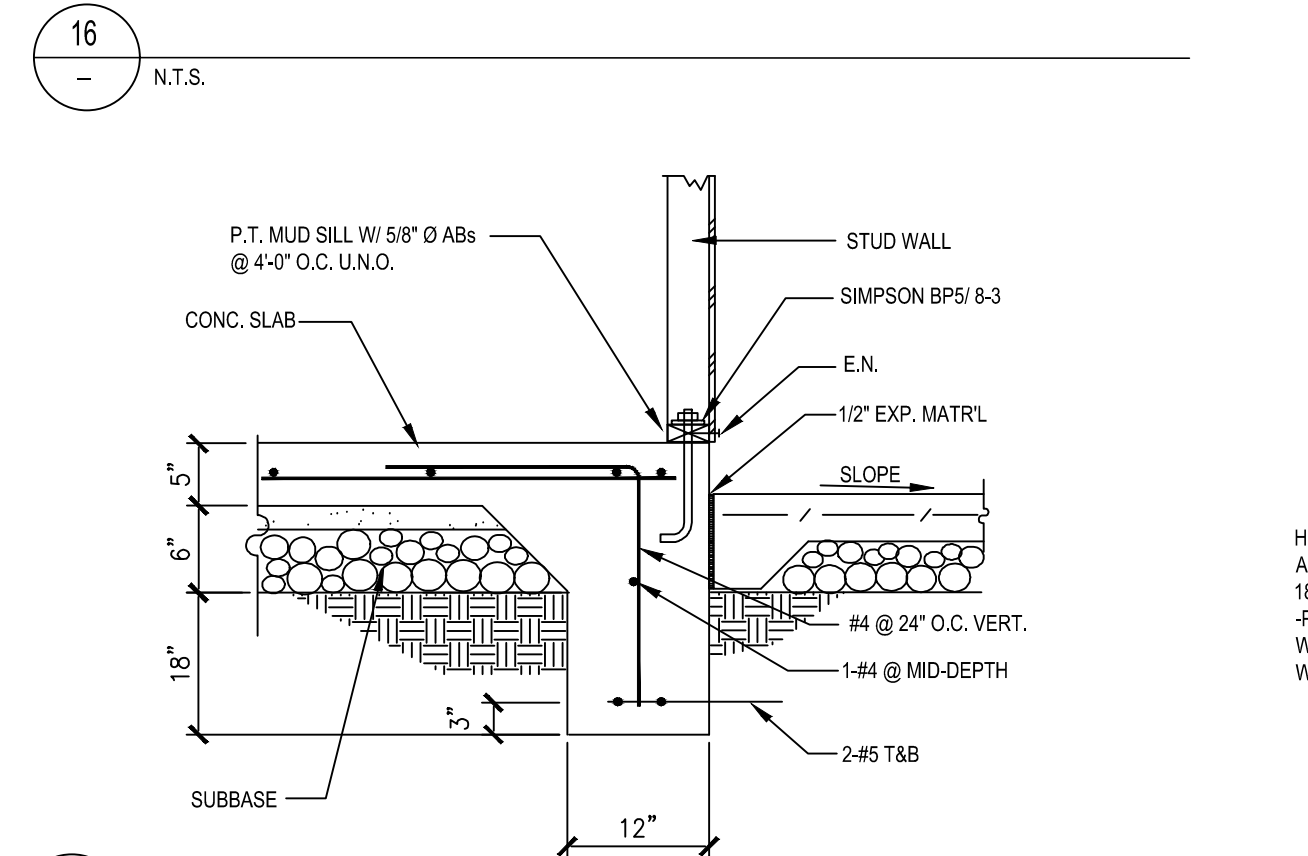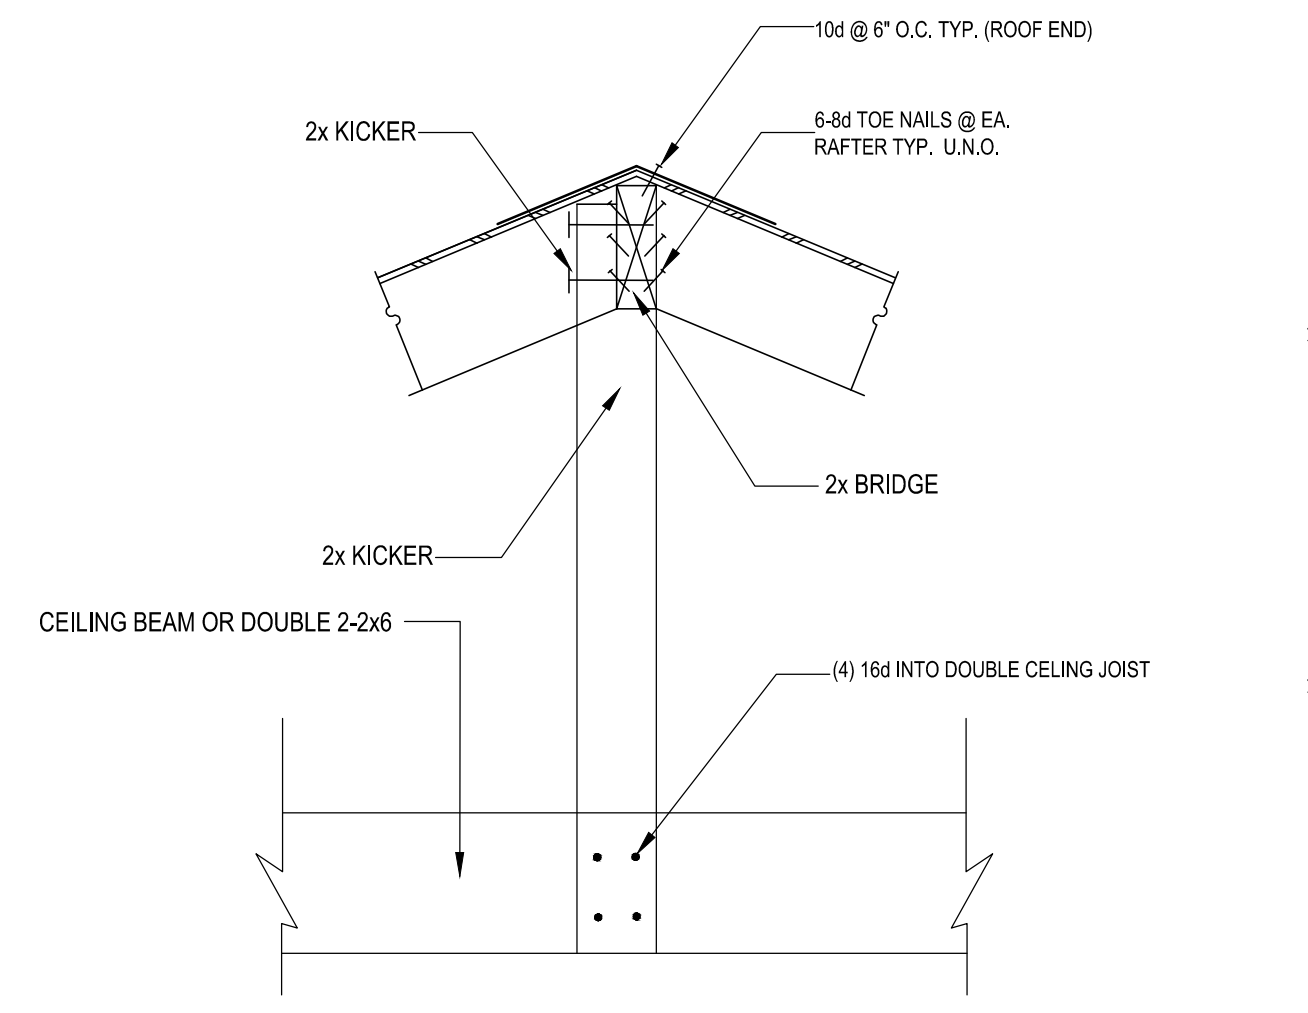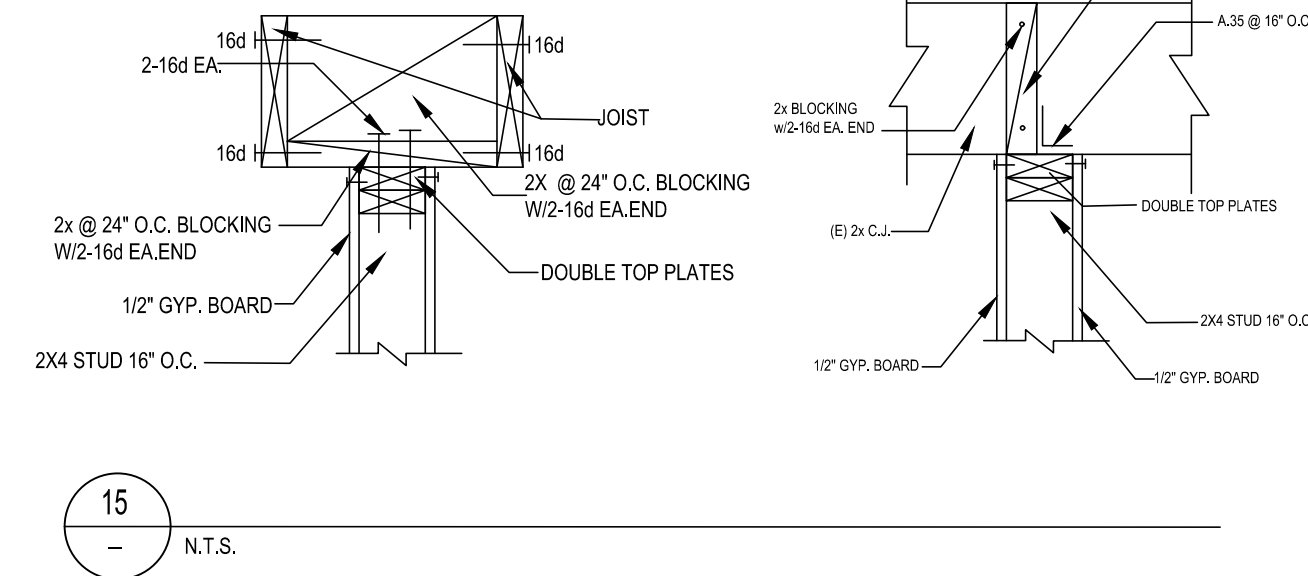

1 ALTERNATE BRACE WALL

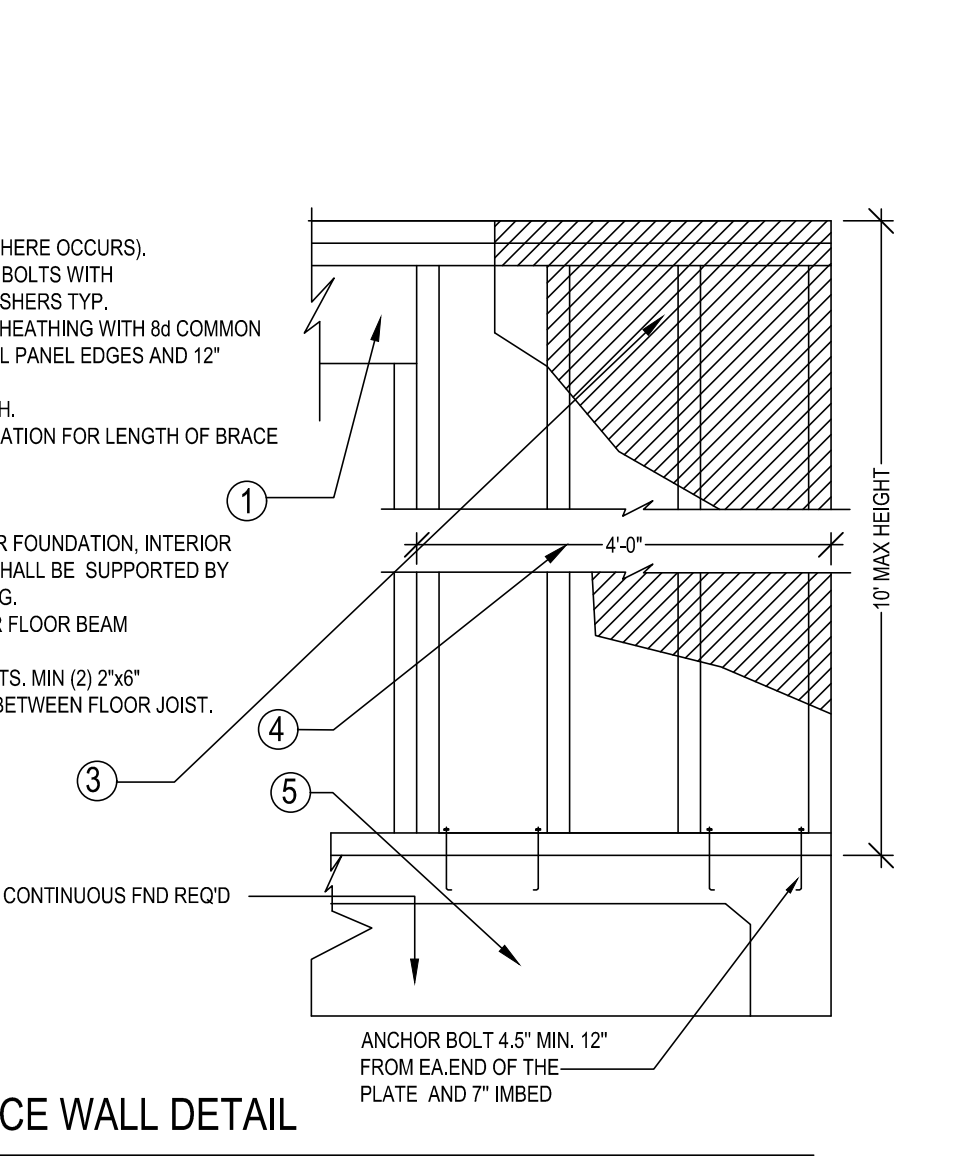

6 BRACE WALL DETAIL



STAMPED FROM CITY

REVIEWED FOR COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email:helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

T-24 ENERGY REPORT

FOR ADU

Unit A

1154 D ST HAYWARD, CA 94541

REVISION	DATE	BY
1	05-19-2025	HL
2	06-13-2025	HL

Scale: AS SHOWN

SHEET NO:

A-6

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 1 of 10)

GENERAL INFORMATION	
01	Project Name: New ADU
02	Site Name: 1154 D ST
03	Project Location: 1154 D ST
04	City: HAYWARD
05	Zip code: 94541
06	Standards Version: 2022
07	Software Version: EnergyPro 9.3
08	Climate Zone: 8B
09	Project Type: Single Family
10	Building Type: Single Family
11	Project Scope: New Construction
12	Number of Bedrooms: 2
13	Number of Bathrooms: 1
14	Number of Stories: 1
15	Conditioned Floor Area (ft²): n/a
16	Unconditioned Floor Area (ft²): n/a
17	Conditioned Floor Area (ft²): 749
18	Conditioned Floor Area (ft²): 749
19	Conditioned Floor Area (ft²): n/a
20	Conditioned Floor Area (ft²): n/a
21	Conditioned Floor Area (ft²): n/a
22	Conditioned Floor Area (ft²): n/a

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that comply with the minimum requirements for a certified HERS Rater as defined in a CEC approved HERS provider.
03	This building incorporates one or more features that comply with the minimum requirements for a certified HERS Rater as defined in a CEC approved HERS provider.

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 5 of 10)

HERS FEATURE SUMMARY	
01	The following is a summary of the features that must be field-verified by a certified HERS Rater for meeting the modeled energy performance for this computer analysis. Additional details are provided in the building tables below. Registered CF1Rs and CF1RAs are not responsible for the accuracy of the information provided in this document.
02	Quality insulation installation (QI)
03	Interior air quality ventilation
04	Verified air leakage
05	Verified air leakage
06	Verified air leakage
07	Verified air leakage
08	Verified air leakage
09	Verified air leakage
10	Verified air leakage
11	Verified air leakage
12	Verified air leakage
13	Verified air leakage
14	Verified air leakage
15	Verified air leakage
16	Verified air leakage
17	Verified air leakage
18	Verified air leakage
19	Verified air leakage
20	Verified air leakage
21	Verified air leakage
22	Verified air leakage

BUILDING - FEATURES INFORMATION	
01	Project Name: New ADU
02	Conditioned Floor Area (ft²): 749
03	Number of Bedrooms: 2
04	Number of Bathrooms: 1
05	Number of Stories: 1
06	Number of Vents: 0
07	Number of Water Heating Systems: 1

ZONE INFORMATION	
01	Zone Name: ADU
02	Zone Type: Conditioned
03	Zone Type: Conditioned
04	Zone Type: Conditioned
05	Zone Type: Conditioned
06	Zone Type: Conditioned
07	Zone Type: Conditioned

OPaque SURFACES	
01	Name: Front Wall
02	Zone: ADU
03	Construction: R-13 Wall
04	Area (ft²): 135
05	Orientation: Front
06	Gross Area (ft²): 208
07	Window and Door Area (ft²): 36
08	TIR (deg): 50
09	Name: Left Wall
10	Zone: ADU
11	Construction: R-13 Wall
12	Area (ft²): 270
13	Orientation: Left
14	Gross Area (ft²): 135
15	Window and Door Area (ft²): 17
16	TIR (deg): 50
17	Name: Rear Wall
18	Zone: ADU
19	Construction: R-13 Wall
20	Area (ft²): 0
21	Orientation: Rear
22	Gross Area (ft²): 208
23	Window and Door Area (ft²): 39
24	TIR (deg): 50

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 9 of 10)

HVAC HEAT PUMPS - HERS VERIFICATION	
01	Name: Heat Pump System 1
02	Verified Airflow: Not Required
03	Airflow Target: 0
04	Verified Airflow: Not Required
05	Airflow Target: 0
06	Verified Airflow: Not Required
07	Airflow Target: 0
08	Verified Airflow: Not Required
09	Airflow Target: 0

VARIABLE CAPACITY HEAT PUMP COMPLIANCE OPTION - HERS VERIFICATION	
01	Name: Heat Pump System 1
02	Certified Low-Static VSP System: Not Required
03	Airflow: Not Required
04	Airflow Target: 0
05	Airflow: Not Required
06	Airflow Target: 0
07	Airflow: Not Required
08	Airflow Target: 0
09	Airflow: Not Required

INDOOR AIR QUALITY (IAQ) FANS	
01	Ducting Unit: SF6m (40)vent
02	Airflow (CFM): 44
03	Fan Efficiency (W/CFM): 0.35
04	IAQ Fan Type: SF6m (40)vent
05	Includes: No
06	Includes: No
07	Includes: No
08	Includes: No
09	Includes: No

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 2 of 10)

ENERGY DESIGN RATINGS	
01	Source Energy (kBtu/ft²-yr): 36.1
02	Source Energy (kBtu/ft²-yr): 36.1
03	Source Energy (kBtu/ft²-yr): 36.1
04	Source Energy (kBtu/ft²-yr): 36.1
05	Source Energy (kBtu/ft²-yr): 36.1
06	Source Energy (kBtu/ft²-yr): 36.1
07	Source Energy (kBtu/ft²-yr): 36.1
08	Source Energy (kBtu/ft²-yr): 36.1
09	Source Energy (kBtu/ft²-yr): 36.1
10	Source Energy (kBtu/ft²-yr): 36.1
11	Source Energy (kBtu/ft²-yr): 36.1
12	Source Energy (kBtu/ft²-yr): 36.1
13	Source Energy (kBtu/ft²-yr): 36.1
14	Source Energy (kBtu/ft²-yr): 36.1
15	Source Energy (kBtu/ft²-yr): 36.1
16	Source Energy (kBtu/ft²-yr): 36.1
17	Source Energy (kBtu/ft²-yr): 36.1
18	Source Energy (kBtu/ft²-yr): 36.1
19	Source Energy (kBtu/ft²-yr): 36.1
20	Source Energy (kBtu/ft²-yr): 36.1
21	Source Energy (kBtu/ft²-yr): 36.1
22	Source Energy (kBtu/ft²-yr): 36.1

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that comply with the minimum requirements for a certified HERS Rater as defined in a CEC approved HERS provider.
03	This building incorporates one or more features that comply with the minimum requirements for a certified HERS Rater as defined in a CEC approved HERS provider.

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 6 of 10)

OPaque SURFACES	
01	Name: Front Wall
02	Zone: ADU
03	Construction: R-13 Wall
04	Area (ft²): 135
05	Orientation: Front
06	Gross Area (ft²): 208
07	Window and Door Area (ft²): 36
08	TIR (deg): 50
09	Name: Left Wall
10	Zone: ADU
11	Construction: R-13 Wall
12	Area (ft²): 270
13	Orientation: Left
14	Gross Area (ft²): 135
15	Window and Door Area (ft²): 17
16	TIR (deg): 50
17	Name: Rear Wall
18	Zone: ADU
19	Construction: R-13 Wall
20	Area (ft²): 0
21	Orientation: Rear
22	Gross Area (ft²): 208
23	Window and Door Area (ft²): 39
24	TIR (deg): 50

ATTC	
01	Name: Attic
02	Construction: Attic
03	Area (ft²): 135
04	Orientation: Attic
05	Gross Area (ft²): 208
06	Window and Door Area (ft²): 36
07	TIR (deg): 50
08	Name: Attic
09	Construction: Attic
10	Area (ft²): 135
11	Orientation: Attic
12	Gross Area (ft²): 208
13	Window and Door Area (ft²): 36
14	TIR (deg): 50

FINISTRATION / GLAZING	
01	Name: Window
02	Type: Window
03	Surface: Window
04	Orientation: Window
05	Area (ft²): 135
06	Orientation: Window
07	Area (ft²): 135
08	Orientation: Window
09	Area (ft²): 135
10	Orientation: Window
11	Area (ft²): 135
12	Orientation: Window
13	Area (ft²): 135
14	Orientation: Window

OPaque DOORS	
01	Name: Door
02	Construction: Door
03	Area (ft²): 135
04	Orientation: Door
05	Gross Area (ft²): 208
06	Window and Door Area (ft²): 36
07	TIR (deg): 50
08	Name: Door
09	Construction: Door
10	Area (ft²): 135
11	Orientation: Door
12	Gross Area (ft²): 208
13	Window and Door Area (ft²): 36
14	TIR (deg): 50

SLAB FLOORS	
01	Name: Slab
02	Construction: Slab
03	Area (ft²): 135
04	Orientation: Slab
05	Gross Area (ft²): 208
06	Window and Door Area (ft²): 36
07	TIR (deg): 50
08	Name: Slab
09	Construction: Slab
10	Area (ft²): 135
11	Orientation: Slab
12	Gross Area (ft²): 208
13	Window and Door Area (ft²): 36
14	TIR (deg): 50

OPaque SURFACES	
01	Name: Front Wall
02	Zone: ADU
03	Construction: R-13 Wall
04	Area (ft²): 135
05	Orientation: Front
06	Gross Area (ft²): 208
07	Window and Door Area (ft²): 36
08	TIR (deg): 50
09	Name: Left Wall
10	Zone: ADU
11	Construction: R-13 Wall
12	Area (ft²): 270
13	Orientation: Left
14	Gross Area (ft²): 135
15	Window and Door Area (ft²): 17
16	TIR (deg): 50
17	Name: Rear Wall
18	Zone: ADU
19	Construction: R-13 Wall
20	Area (ft²): 0
21	Orientation: Rear
22	Gross Area (ft²): 208
23	Window and Door Area (ft²): 39
24	TIR (deg): 50

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 10 of 10)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
01	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
02	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
03	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
04	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
05	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
06	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
07	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
08	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
09	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.

RESPONSIBLE PERSON'S DECLARATION STATEMENT	
01	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
02	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
03	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
04	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
05	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
06	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
07	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
08	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
09	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.

RESPONSIBLE PERSON'S DECLARATION STATEMENT	
01	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
02	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
03	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
04	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
05	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
06	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
07	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
08	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
09	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.

RESPONSIBLE PERSON'S DECLARATION STATEMENT	
01	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
02	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
03	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
04	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
05	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
06	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
07	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
08	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.
09	I, the undersigned, certify that this Certificate of Compliance documentation is accurate and complete.

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 3 of 10)

ENERGY USE SUMMARY	
01	Energy Use: 12.7
02	Energy Use: 12.7
03	Energy Use: 12.7
04	Energy Use: 12.7
05	Energy Use: 12.7
06	Energy Use: 12.7
07	Energy Use: 12.7
08	Energy Use: 12.7
09	Energy Use: 12.7
10	Energy Use: 12.7
11	Energy Use: 12.7
12	Energy Use: 12.7
13	Energy Use: 12.7
14	Energy Use: 12.7
15	Energy Use: 12.7
16	Energy Use: 12.7
17	Energy Use: 12.7
18	Energy Use: 12.7
19	Energy Use: 12.7
20	Energy Use: 12.7
21	Energy Use: 12.7
22	Energy Use: 12.7

Registration Number: 425-P010102086A-000-000-000000-0000  
Registration Date/Time: 06/13/2025 15:49  
HERS Provider: CHEERS  
Report Version: 2022.0.000  
Report Generated: 2025-06-13 15:46:52  
Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD  
Project Name: New ADU  
Calculation Description: Title 24 Analysis  
Calculation Date/Time: 2025-06-13T15:46:37-07:00  
Input File Name: tmp8488-rbc22x

CF1R-PHF-01-E  
(Page 7 of 10)

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Area (ft²)	Initial Coeff	Interior / Exterior Surface Area	U-factor	Assembly name



**REVIEWED FOR  
COMPLIANCE**  
BL-NRES-2024-00033  
**CITY OF HAYWARD  
BUILDING DIVISION**



# ***TOMMY DRAFTING***

Date: MARCH 2025

Drawn: LUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email: [helennguyen3689@gmail.com](mailto:helennguyen3689@gmail.com)  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

# CG-1 CAL GREEN MANDATORY

1154 D ST HAYWARD, CA 94541

# Unit A

REVISION	DATE	BY

Scale: AS SHOWN

SHEET NO.

# A-7




2022 CALGARY RESIDENTIAL OCCUPANCY APPLICATION CHECKLIST						
SECTION A4.602						
Effective January 1, 2023						
HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives*		Enforcing Agency <input type="checkbox"/> All	Installer or Designer <input type="checkbox"/> All	Third-Party <input type="checkbox"/> All
		Tier 1	Tier 2			
<b>A4.103.1</b> A site which complies with at least one of the following characteristics is selected:						
1. An infill site is selected.	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N
2. A greyfield site is selected.	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N
3. An EPA-recognized Brownfield site is selected.	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N	<input checked="" type="checkbox"/> N
<b>A4.103.2</b> Facilitate community connectivity by one of the following methods:						
1. Locate project within a 1/4-mile true walking distance of at least 4 basic services;	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Locate project within 1/2-mile true walking distance of at least 7 basic services;	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3. Other methods increasing access to additional resources.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.104.1</b> An individual with oversight responsibility for the project has participated in an educational program promoting environmentally friendly design or development and has provided training or instruction to appropriate entities.	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.105.2</b> Existing buildings are disassembled for reuse or recycling of building materials. The proposed structure utilizes at least one of the following materials which can be easily reused:						
1. Light fixtures	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Plumbing fixtures	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3. Doors and trim	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4. Masonry	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
5. Electrical devices	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
6. Appliances	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
7. Foundations or portions of foundations	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.2</b> A plan is developed and implemented to manage storm water drainage during construction.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.3</b> Construction plans shall indicate how site grading, or a drainage system will manage all surface water flows to keep water from entering buildings.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

<b>2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST</b>						
<b>SECTION A4.602</b>						
<b>Effective January 1, 2023</b>						
<b>HCD SHL 620C (New 01/23)</b>						
<b>FEATURE OR MEASURE</b>	<b>LEVELS APPLICANT TO SELECT ELEVATIVE MEASURES</b>			<b>VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD</b>		
		<b>Prerequisites and Exclusions<sup>a</sup></b>		<b>Enforcing Agency</b>	<b>Installer or Designer</b>	<b>Third-Party</b>
	<b>Mandatory</b>	<b>Tier 1</b>	<b>Tier 2</b>	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
<b>A.106.4.1</b> Provide capability for electric vehicle charging for one- and two-family dwellings; townhouses with attached private garages; in accordance with Section 4.106.4.1.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A.106.4.2</b> Provide capability for electric vehicle charging for multifamily dwellings and hotels/motels in accordance with Sections 4.106.4.2.1 or 4.106.4.2.2, as applicable.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A.106.4.3</b> Provide capability for electric vehicle charging for existing parking lots or new parking lots for existing residential buildings in accordance with Section 4.106.4.3, as applicable.	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.1 Reserved.</b>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.2.1</b> Soil analysis is performed by a licensed design professional and the findings are utilized in the structural design of the building.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.2.2</b> Soil disturbance and erosion are minimized by at least one of the following:						
1. Natural drainage patterns are evaluated, and erosion controls are implemented to minimize erosion during construction and after occupancy.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Site access is accomplished by minimizing the amount of cut and fill needed to install access roads and driveways.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3. Underground construction activities are coordinated to utilize the same trench, minimize the amount of time the disturbed soil is exposed, and the soil is replaced using accepted compaction methods.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.2.3</b> Topsoil shall be protected or saved for reuse as specified in this section.				<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>Tier 1</b> Displaced topsoil shall be stockpiled for reuse in a designated area and covered or protected from erosion.		<input checked="" type="checkbox"/> <sup>b</sup>	<input checked="" type="checkbox"/> <sup>c</sup>			
<b>Tier 2</b> The construction area shall be identified and delineated by fencing or flagging to limit construction activity to the construction area.			<input checked="" type="checkbox"/> <sup>d</sup>			
<b>A4.106.3</b> Postconstruction landscape designs accomplish one or more of the following:						
1. Areas disrupted during construction are restored to be consistent with native vegetation species and patterns.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Utilize at least 75% native California or drought tolerant plant and tree species appropriate for the climate zone region.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

2022 CALGARY RESIDENTIAL OCCUPANCY COMPLIANCE CHECKLIST						
SECTION A4.602						
Effective January 1, 2023						
HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT EFFECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
		Prerequisites and Exclusions <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
	Mandatory	Tier 1	Tier 2	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
<b>A4.106.4</b> Permeable paving is utilized for the parking, walking or patio surfaces in compliance with the following: Tier 1. Not less than 20% of the total parking, walking or patio surfaces shall be permeable. Tier 2. Not less than 30% of the total parking, walking or patio surfaces shall be permeable.						
		<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
			<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.5</b> Roofing materials shall have a minimum 3-year aged solar reflectance and thermal emittance, or a minimum Solar Reflectance Index (SRI) equal to or greater than the values specified in the applicable tables.						
<b>Low-Rise Residential</b>						
Tier 1. roof covering shall meet or exceed the values contained in Table A4.106.5.1(1).		<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Tier 2. roof covering shall meet or exceed the values contained in Table A4.106.5.1(2).			<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>High-Rise Residential, Hotels and Motels</b>						
Tier 1. roof covering shall meet or exceed the values contained in Table A4.106.5.1(3).		<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Tier 2. roof covering shall meet or exceed the values contained in Table A4.106.5.1(4).			<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.6</b> Install a vegetated roof for at least 50 percent of the roof area. Vegetated roofs shall comply with requirements for roof gardens and landscaped roofs in the <i>California Building Code</i> , Chapters 15 and 16.						
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.7</b> Reduce nonroof heat islands for 50 percent of sidewalks, patios, driveways or other paved areas by using one or more of the methods listed.						
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.8.1</b> Tier 1 and Tier 2 for one- and two-family dwellings and townhouses with attached private garages. Install a dedicated 208/240-volt branch circuit, including an overcurrent protective device rated at 40 amperes minimum per dwelling unit.						
	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.106.8.2.1</b> Provide capability for electric vehicle charging in new multifamily dwellings, as specified.						
Tier 1. 35 percent of the total number of parking spaces shall be electric vehicle (EV) ready with low power Level 2 EV charging receptacles. For projects with 20 or more dwelling units, sleeping units or guest rooms, 10 percent of the total number of parking spaces shall be equipped with Level 2 EVSE.		<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Tier 2. 40 percent of the total number of parking spaces shall be electric vehicle (EV ready) with low power Level 2 EV charging receptacles. For projects with 20 or more dwelling units, sleeping units or guest rooms, 15 percent of the total number of parking spaces shall be equipped with Level 2 EVSE.			<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

<b>2022 CALGARY RESIDENTIAL OCCUPANCY LICENSING CHECKLIST</b> <b>SECTION A4.602</b> <b>Effective January 1, 2023</b> <b>HCD SHL 620C (New 01/23)</b>						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisite and Elective <sup>a</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
<b>A4.203.1.2 Prerequisite options.</b> In addition, a minimum of two of the efficiency measures specified in Sections A4.203.1.2.1 through A4.203.1.2.8 will be required to be met. <ul style="list-style-type: none"> <li>• Roof Deck Insulation or Ducts in Conditioned Space.</li> <li>• High performance Walls.</li> <li>• Compact Hot Water Distribution System.</li> <li>• Drain Water Heat Recovery.</li> <li>• High Performance Vertical Fenestration.</li> <li>• Heat Pump Water Heater Demand Management.</li> <li>• Battery Storage System Controls.</li> <li>• Heat Pump Space and Water Heating.</li> </ul>		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.203.1.3 Consultation with local electric service provider.</b> Local jurisdictions considering adoption of reduced EDR targets based on using solar photovoltaic (PV) systems larger than required by the <i>California Energy Code</i> shall consult with the local electric service provider to ensure that the PV system sizing required to comply with the EDR targets will be acceptable to the local electric service provider.		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>4.303.1 Plumbing fixtures (water closets and urinals) and fittings</b> (showersheads, faucets and pre-rinse spray valves) installed in residential buildings shall comply with the prescriptive requirements of Sections 4.303.1.1 through 4.303.1.4.5.	<input checked="" type="checkbox"/>			<input type="checkbox"/>		<input type="checkbox"/>
<b>4.303.2 Submeters for multi-family building and dwelling units in mixed-use residential/commercial buildings.</b> Submeters shall be installed to measure water usage of individual rental dwelling units in accordance with the <i>California Plumbing Code</i> .	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>4.303.3 Plumbing fixtures and fittings required in Section 4.303.1</b> shall be installed in accordance with the <i>California Plumbing Code</i> and shall meet the applicable referenced standards.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

2022 CALGREN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST						
SECTION A4.602						
Effective January 1, 2023						
HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives*		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
<b>A4.303.1</b> The maximum flow rate of kitchen faucets shall not exceed 1.5 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi and must default to a maximum flow rate of 1.5 gallons per minute at 60 psi.  <b>Note:</b> Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>4.303.1.4.3</b> Metering faucets in residential buildings shall not deliver more than 0.2 gallons per cycle.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.303.2</b> Alternate water source for nonpotable applications. Alternate nonpotable water sources are used for indoor potable water reduction. Alternate nonpotable water sources shall be installed in accordance with the California Plumbing Code.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.303.3</b> Install at least one qualified ENERGY STAR dishwasher or clothes washer.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.303.4</b> Nonwater urinals or waterless toilets are installed.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.303.5</b> One- and two-family dwellings shall be equipped with a demand hot water recirculation system.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>4.304.1</b> Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWEL0), whichever is more stringent.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.304.1 A</b> Rainwater capture, storage and re-use system is designed and installed.		<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.304.2 A</b> A landscape design is installed, which does not utilize potable water.		<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.304.3</b> For new water service connections, landscaped irrigated areas less than 5,000 square feet shall be provided with separate submeters or metering devices for outdoor potable water uses.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.305.1</b> Piping is installed to permit future use of a graywater irrigation system served by the clothes washer or other fixtures.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.305.2</b> Recycled water piping is installed.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<b>A4.305.3</b> Recycled water is used for landscape irrigation.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST						
SECTION A4.602						
Effective January 1, 2023						
HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
<b>A4.106.9</b> Provide bicycle parking facilities as noted below or meet a local ordinance, whichever is more stringent. Number of bicycle parking spaces may be reduced, as approved by the enforcing agency, due to building site characteristics, including but not limited to, isolation from other development.				<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
1. Provide short-term bicycle parking, per Section A4.106.9.1.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Provide long-term bicycle parking for multifamily buildings, per Section A4.106.9.2.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3. Provide long-term bicycle parking for hotel and motel buildings, per Section A4.106.9.3.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
						
<b>A4.108.1</b> Items in this section are necessary to address innovative concepts or local environmental conditions.						
Item 1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 2	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 3	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
						
<b>4.201.1</b> Building meets or exceeds the requirements of the California Building Energy Efficiency Standards <sup>2</sup> .	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
						
<b>A4.203.1.1.</b> Hourly Source Energy Design Ratings (EDR1). EDR ratings for building design shall be computed by Energy Compliant software and shall reduce the EDR1 required by the software by the compliance margins specified in Table A4.203.1.1.		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>



2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
				<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
A4.306.1 Items in this section are necessary to address innovative concepts or local environmental conditions.						
Item 1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 2	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 3	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.403.1 A Frost-Protected Shallow Foundation (FPSF) is designed and constructed.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.403.2 Cement use in foundation mix design is reduced. Tier 1. Not less than a 20 percent reduction in cement use. Tier 2. Not less than a 25 percent reduction in cement use.		<input checked="" type="checkbox"/> <sup>2</sup>	<input checked="" type="checkbox"/> <sup>2</sup>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.404.1 Beams and headers and trimmers are the minimum size to adequately support the load.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.404.2 Building dimensions and layouts are designed to minimize waste.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.404.3 Use premanufactured building systems to eliminate solid sawn lumber whenever possible.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.404.4 Material lists are included in the plans which specify material quantity and provide direction for on-site cuts.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.405.1 One or more of the following building materials, that do not require additional resources for finishing are used: 1. Exterior trim not requiring paint or stain. 2. Windows not requiring paint or stain. 3. Siding or exterior wall coverings which do not require paint or stain.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

7

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
A4.405.2 Floors that do not require additional coverings are used including but not limited to stained, natural or stamped concrete floors.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.405.3 Postconsumer or preconsumer recycled content value (RCV) materials are used on the project. Tier 1. Not less than a 10% RCV. Tier 2. Not less than a 15% RCV.		<input checked="" type="checkbox"/> <sup>2</sup>	<input checked="" type="checkbox"/> <sup>2</sup>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.405.4 Renewable source building products are used.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.406.1 Annular spaces around pipes, electric cables, conduits or other openings in plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.		<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.1 Install foundation and landscape drains.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.2 Install gutter and downspout systems to route water at least 5 foot away from the foundation or connect to landscape drains which discharge to a dry well, sump, bioswale, rainwater capture system or other approved on-site location.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.3 Provide flashing details on the building plans and comply with accepted industry standards or manufacturer's instructions.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.4 Protect building materials delivered to the construction site from rain and other sources of moisture.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.5 In Climate Zone 16, an ice/water barrier is installed at roof valleys, eaves and wall to roof intersections.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.6 Exterior doors to the dwelling are protected to prevent water intrusion.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.407.7 A permanent overhang or awning at least 2 feet in depth is provided at all exterior walls.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

8

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
				<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
4.408.1 Recycle and/or salvage for reuse a minimum of 65% of the nonhazardous construction and demolition waste in accordance with one of the following: 1. Comply with a more stringent local construction and demolition waste management ordinance; or 2. A construction waste management plan, per Section 4.408.2; or 3. A waste management company, per Section 4.408.3; or 4. The waste stream reduction alternative, per Section 4.408.4.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.408.1 Construction waste generated at the site is diverted to recycle or salvage in compliance with one of the following: Tier 1. At least a 65% reduction with a third-party verification. Tier 2. At least a 75% reduction with a third-party verification. Exception: Equivalent waste reduction methods are developed by working with local agencies.		<input checked="" type="checkbox"/> <sup>2</sup>	<input checked="" type="checkbox"/> <sup>2</sup>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.410.1 An operation and maintenance manual shall be provided to the building occupant or owner.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.410.2 Where 5 or more multifamily dwelling units are constructed on a building site, provide readily accessible areas that serve the entire building and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals or meet a lawfully enacted local recycling ordinance, if more restrictive. Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42549.62(a)(2)(A) et seq. will also be exempt from the organic waste portion of this section.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.411.1 Items in this section are necessary to address innovative concepts or local environmental conditions.						

9

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
				<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
Item 1	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 2	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 3	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.503.1 Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable and shall have a permanent label indicating they are certified to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with applicable local ordinances.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.1 Duct openings and other related air distribution component openings shall be covered during construction.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.2.1 Adhesives, sealants and caulks shall be compliant with VOC and other toxic compound limits.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.2.2 Paints, stains and other coatings shall be compliant with VOC limits.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.2.3 Aerosol paints and coatings shall be compliant with product-weighted MIR Limits for ROC and other toxic compounds.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.2.4 Documentation shall be provided to verify that compliant VOC limit finish materials have been used.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.3 Carpet and carpet systems shall be compliant with VOC limits.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.4 80% of floor area receiving resilient flooring shall comply with specified VOC criteria.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.504.5 Particleboard, medium density fiberboard (MDF) and hardwood plywood used in interior finish systems shall comply with low formaldehyde emission standards.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

10

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
A4.504.1 Use composite wood products made with either California Air Resources Board approved no-added formaldehyde (NAF) resins or ultra-low emitting formaldehyde (ULEF) resins.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.504.2 Install VOC compliant resilient flooring systems. Tier 1. At least 90% of the resilient flooring installed shall comply. Tier 2. 100% of the resilient flooring installed shall comply.		<input checked="" type="checkbox"/> <sup>2</sup>	<input checked="" type="checkbox"/> <sup>2</sup>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.504.3 Thermal insulation installed in the building shall meet the following requirements: Tier 1. Install thermal insulation in compliance with VOC limits. Tier 2. Install insulation which contains no-added formaldehyde (NAF) and is in compliance with Tier 1.		<input checked="" type="checkbox"/> <sup>2</sup>	<input checked="" type="checkbox"/> <sup>2</sup>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.505.2 Vapor retarder and capillary break is installed at slab-on-grade foundations.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.505.3 Moisture content of building materials used in wall and floor framing is checked before enclosure.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4.506.1 Each bathroom shall be provided with the following: 1. ENERGY STAR fans ducted to terminate outside the building. 2. Fans must be controlled by a humidity control (separate or built-in); OR functioning as a component of a whole-house ventilation system. 3. Humidity controls with manual or automatic means of adjustment, capable of adjustment between a relative humidity range of ≤ 50% to a maximum of 80%.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.506.1 Reserved.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.506.2 [HR] Provide filters on return air openings rated MERV 8 or higher during construction when it is necessary to use HVAC equipment.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
A4.506.3 Direct-vent appliances shall be used when equipment is located in conditioned space; or the equipment must be installed in an isolated mechanical room.		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

11

2022 CALGREEN RESIDENTIAL OCCUPANCIES APPLICATION CHECKLIST SECTION A4.602 Effective January 1, 2023 HCD SHL 620C (New 01/23)						
FEATURE OR MEASURE	LEVELS APPLICANT TO SELECT ELECTIVE MEASURES			VERIFICATIONS ENFORCING AGENCY TO SPECIFY VERIFICATION METHOD		
	Mandatory	Prerequisites and Electives <sup>1</sup>		Enforcing Agency	Installer or Designer	Third- Party
		Tier 1	Tier 2			
				<input type="checkbox"/> All	<input type="checkbox"/> All	<input type="checkbox"/> All
4.507.2 Duct systems are sized, designed, and equipment is selected using the following methods: 1. Establish heat loss and heat gain values according to ANSI/ACCA 2 Manual J - 2016 or equivalent. 2. Size duct systems according to ANSI/ACCA 1 Manual D - 2016 or equivalent. 3. Select heating and cooling equipment according to ANSI/ACCA 3 Manual S - 2014 or equivalent.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Outdoor Air Quality Reserved						
Innovative Concepts and Local Environmental Conditions						
A4.509.1 Items in this section are necessary to address innovative concepts or local environmental conditions.						
Item 1		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 2		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Item 3		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
702.1 HVAC system installers are trained and certified in the proper installation of HVAC systems.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
702.2 Special inspectors employed by the enforcing agency must be qualified and able to demonstrate competence in the discipline they are inspecting.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
703.1 Verification of compliance with this code may include construction documents, plans, specifications builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which show substantial conformance.	<input checked="" type="checkbox"/>			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

<sup>1</sup>Green building measures listed in this table may be mandatory if adopted by a city, county, or city and county as specified in Section 101.7  
<sup>2</sup> Required prerequisite for this Tier.

12

STAMPED FROM CITY

REVIEWED FOR  
COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email:helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

CG-2 CAL GREEN MANDATORY

1154 D ST HAYWARD, CA 94541

Unit A

REVISION DATE BY

Scale: AS SHOWN

SHEET NO:

A-8







STAMPED FROM CITY

REVIEWED FOR COMPLIANCE  
BL-NRES-2024-00033  
CITY OF HAYWARD  
BUILDING DIVISION



TOMMY DRAFTING

Date: MARCH 2025

Drawn: LUYEN HONG NGUYEN

Tells: (916) 526-5881  
(408) 876-8402

Signed: *Thuy*

Email:helennguyen3689@gmail.com  
9743 WHITE PINE WAY, ELK GROVE, CA 95624

FASTENING SCHEDULE PER  
CRC TABLE R602.3 (1)

1154 D ST HAYWARD, CA 94541

Unit A

REVISION	DATE	BY

Scale: AS SHOWN

SHEET NO:

A-10

RESIDENTIAL NAILING SCHEDULE

TABLE R602.3(1) FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER	SPACING OF FASTENERS
<b>Roof</b>			
1	Blocking between ceiling joists, rafters or trusses to top plate or other framing below	4-8d box (2 1/2" x 0.131") or 3-8d (2 1/2" x 0.131") or 3-10d box (2 3/4" x 0.128") or 3-7d x 0.131" nails	Toe nail
	Blocking between rafters or truss not at the wall top plates, to rafter or truss	2-8d common (2 1/2"x0.131") or 2-3"x0.131" nails	Each end toe nail
	Flat blocking to truss and web filler	1-6d common (3 1/2"x0.162") or 2"x0.131" nails	End nail
2	Ceiling joists to plate	4-8d box (2 1/2" x 0.131") or 3-8d (2 1/2" x 0.131") or 3-10d box (2 3/4" x 0.128") or 3-7d x 0.131" nails	Per joist, toe nail
3	Ceiling joist not attached to parallel rafter, laps over perpendicular, face (see Section R602.5.2 and Table R602.5.2(1))	4-10d box (3"x0.128") or 3-16d common (3 1/2" x 0.162") or 4-7d x 0.131" nails	Face nail
4	Ceiling joist attached to parallel rafter (heel side) (see Section R602.5.2 and Table R602.5.2(1))	Table R602.5.2(1)	Face nail
5	Collar tie to rafter, face nail	4-10d box (3"x0.128") or 3-10d common (3" x 0.148") or 4-7d x 0.131" nails	Face nail each rafter
6	Rafter or roof truss to plate	3-16d box nails (3 1/2" x 0.135") or 3-10d common nails (3" x 0.148") or 4-10d box (3"x0.128") or 4-7d x 0.131" nails	2 toe nails on one side and 1 toe nail on opposite side of each rafter or truss
7	Roof rafters to ridge, valley or hip rafters or roof rafter to minimum 2" ridge beam	4-16d (3 1/2" x 0.135") or 3-10d common (3" x 0.148") or 4-10d box (3"x0.128") or 4-7" x 0.131" nails	Toe nail
		3-16d box (3 1/2" x 0.135") or 3-16d common (3 1/2" x 0.148") or 3-10d box (3"x0.128") or 3-7" x 0.131" nails	End nails
<b>Wall</b>			
8	Stud to stud (not at braced wall panels)	1-6d common (3 1/2" x 0.162") or 10d box (3" x 0.128") or 2"x0.131" nails	24" o.c. face nail
9	Stud to stud and abutting studs at intersecting wall corners (at braced wall panels)	1-6d box (3 1/2" x 0.135") or 3" x 0.131" nails	16" o.c. face nail
10	Build-up header (2" to 2" header with 1/2" space)	1-6d common (3 1/2" x 0.162")	16" o.c. each edge face nail
11	Continuous header to stud	5-8d box (2 1/2" x 0.131") or 4-8d common (2 1/2" x 0.131") or 4-10d box (3" x 0.128")	Toe nail
12	Adjacent full-height stud to end of header	4-16d box (3 1/2" x 0.135") or 3-16d common (3 1/2" x 0.162") or 4-10d box (3" x 0.128") or 4-7" x 0.131" nails	End nail
13	Top plate to top plate	1-6d common (3 1/2" x 0.162")	16" o.c. face nail

Page 1 of 4

		10d box (3" x 0.128"); or 3" x 0.131" nails	24" o.c. face nail at top and bottom staggered on opposite sides.	
		Foot: 2-20d common (4" x 0.192); or 1-6d box (3 1/2" x 0.128"); or 3-3" x 0.131" nails	Face nail at ends and at each splice	
29	Ledger strip supporting joists	4-6d box (3 1/2" x 0.135"); or 4-6d common (3 1/2" x 0.162); or 4-10d box (3" x 0.128); or 4-7 x 0.131 nails	At each joist or rafter, face nail	
30	Bridging or blocking to joists, rafter or truss	1-10d (3" x 0.128"); or 1-8d common (2 1/2" x 0.131"); or 3-3" x 0.131" nails	Each end, toe nail	
ITEM	DESCRIPTION OF BUILDING MATERIALS	DESCRIPTION OF FASTENER <sup>a, b, c</sup>	SPACING OF FASTENERS	
			Edges (inches)	Intermediate supports <sup>a, b</sup> (inches)
Wood structural panels, subfloor, roof and interior wall sheathing to framing and particleboard wall sheathing to framing (see Table R602.3(1) for wood structural panel exterior wall sheathing to wall framing)				
31	7/8", 1 1/2"	1-6d common or deformed (2" x 0.113" x 0.266" head); or 2 3/4" x 0.113" x 0.266" head nail (subfloor, wall) or 1-6d common nail (2 1/2" x 0.131"); or RSRS-01, (25d" x 0.113") nail (roof)	6	6
		1-6d common nail (2 1/2" x 0.131"); or RSRS-01, (25d" x 0.113") nail (roof)	6	12
32	7/8", 1 1/2"	1-6d common (2-20d" x 0.131") nail (subfloor, wall) or RSRS-01, (25d" x 0.113") nail (roof) or Deformed 25d" x 0.113" x 0.266" head (wall or subfloor)	6	6
		Deformed 25d" x 0.113" x 0.266" head (wall or subfloor)	6	12
33	1 1/2", 1 1/4"	1-6d common (3" x 0.148") nail; or (2 1/2" x 0.131" x 0.266" head) deformed nail	6	12
Other wall sheathings				
34	1/2" structural cellulose fiberboard sheathing	1 1/2" x 0.120" galvanized roofing nail, 7/16" head diameter or 1 1/4" long 16 ga. Staple with 7/16" or 1" crown	3	6
35	25/32" structural cellulose fiberboard sheathing	1 1/4" x 0.120" galvanized roofing nail, 7/16" head diameter or 1 1/4" long 16 ga. Staple with 7/16" or 1" crown	3	6
36	1/2" gypsum sheathing	1 1/2" x 0.120" galvanized roofing nail, 7/16" head diameter, or 1 1/4" long 16 ga. staple galvanized, 1 1/2" long 7/16" or 1" crown or 1 1/4" screws, Type W or S	7	7
37	5/8" gypsum sheathing	1 1/2" x 0.120" galvanized roofing nail, 7/16" head diameter, or 1 1/4" long 16 ga. staple galvanized, 1 1/2" long 7/16" or 1" crown or 1 1/4" screws, Type W or S	7	7
Wood structural panels, combination subfloor underlayment to framing				
38	7/8" and less	Deformed (2" x 0.113") or Deformed (2" x 0.120") nail; or 8d common (2 1/2" x 0.131") nail	6	12
39	7/8", 1"	8d common (2 1/2" x 0.131") nail or Deformed (2" x 0.113") or Deformed (2 1/2" x 0.120") nail	6	12
40	1 1/4", 1 1/2"	10d common (3" x 0.148") nail or Deformed (2" x 0.113") or Deformed (2 1/2" x 0.120") nail	6	12

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s; 1 ksi = 6.895 MPa.

a. Nails are smooth-common, box or deformed shanks except where otherwise stated. Nails used for framing and sheathing connections shall have minimum average bending yield strengths as shown: 80 ksi for shank diameter of 0.192 inch (20d common nail), 90 ksi for shank diameters larger than 0.142 inch but not larger than 0.177 inch, and 100 ksi for shank diameters of 0.142 inch or less. Connections using nails and staples of other materials such as stainless steel, shall be designed by accepted engineering practice or approved under Section R104.11

b. RSRS-01 is a Roof Sheathing Ring Shank nail meeting the specifications in ASTM F1667.

c. Nails shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater.

d. Four-foot by 8-foot or 4-foot by 8-foot panels shall be applied vertically.

e. Spacing of fasteners not included in this table shall be based on Table R602.3(2).

Page 3 of 4

		10d box (3" x 0.128"); or 2" x 0.131" nails	12" o.c. face nail
14	Double top plate splice	8-16d common (3 1/2" x 0.162"); or 2-16d box (3 1/2" x 0.135"); or 2-10d box (3" x 0.128"); or 2-3" x 0.131" nails	Face nail on each side of end joint (minimum 24" lap splice length each side of end joint)
15	Bottom plate to joist, rim joist, band joist or blocking (not at braced wall panels)	1-6d common (3 1/2" x 0.162")	16" o.c. face nail
		1-6d box (3 1/2" x 0.135") or 2" x 0.131" nails	12" o.c. face nail
<b>Roof</b>			
ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER	SPACING OF FASTENERS
16	Bottom plate to joist, rim joist, band joist or blocking (at braced wall panels)	3-16d box (3 1/2" x 0.135"); or 2-16d common (3 1/2" x 0.162"); or 2-7" x 0.131" nails	16" o.c. face nail
17	Top or bottom plate to stud	4-8d box (2 1/2" x 0.113"); or 3-16d box (3 1/2" x 0.135"); or 4-8d common (2 1/2" x 0.131"); or 4-10d box (3" x 0.128"); or 4-3" x 0.131" nails	Toe nail
		4-3" x 0.131" nails	End nail
18	Top plates, laps at corners and intersections	3-16d box (3 1/2" x 0.135"); or 2-16d common (3 1/2" x 0.162"); or 2-3" x 0.131" nails	Face nail
19	1" brace to each stud and plate	3-8d box (2 1/2" x 0.113"); or 2-8d common (2 1/2" x 0.131"); or 20/0d box (3" x 0.128"); or 2 staples 1 1/2" x 6"	Face nail
20	1" x 6" sheathing to each bearing	3-8d box (2 1/2" x 0.113"); or 2-8d common (2 1/2" x 0.131"); or 2-10d box (3" x 0.128"); or 2 staples, 1" crown, 16 ga., 1 3/4" long	Face nail
21	1" x 8" and wider sheathing to each bearing	3-8d box (2 1/2" x 0.113"); or 3-8d common (2 1/2" x 0.131"); or 3-10d box (3" x 0.128"); or 3 staples 1" crown, 16 ga., 1 3/4" long	Face nail
		Wider than 1" x 8": 4-8d box (2 1/2" x 0.113"); or 3-8d common (2 1/2" x 0.131"); or 3-10d common (3" x 0.128"); or 4 staples, 1" crown, 16 ga., 1 3/4" long	
<b>Floor</b>			
22	Joist to sill, top plate or girder	4-8d box (2 1/2" x 0.113"); or 3-8d common (2 1/2" x 0.131"); or 3-10d box (3" x 0.128"); or 3-3" x 0.131" nails	Toe nail
23	Rim joist, band joist or blocking to sill or top plate (roof application also)	8d box (2 1/2" x 0.113"); or 8d common (2 1/2" x 0.131"); or 10d box (3" x 0.128"); or 2" x 0.131" nails	4" o.c. toe nail 6" o.c. toe nail
24	1" x 6" subfloor or less to each joist	3-8d box (2 1/2" x 0.113"); or 2-8d common (2 1/2" x 0.131"); or 3-10d box (3" x 0.128"); or 2 staples, 1" crown, 16 ga., 1 3/4" long	Face nail
25	2" subfloor to joist or girder	3-16d box (3 1/2" x 0.135") or 2-16d common (3 1/2" x 0.162")	Blind and face nail
26	2" particle (plywood & beam - floor & roof)	3-16d box (3 1/2" x 0.135") or 2-16d common (3 1/2" x 0.162")	At each bearing
27	Band or rim joist to joist	3-16d common (3 1/2" x 0.162") or 4-10 box (3" x 0.128"); or 4-3" x 0.131" nails, or 4-3" x 14 ga. staples, 7/16" crown	End nail
28	Build-up girders and beams, 2-inch lumber joists	20d common (4" x 0.192"); or	Nail each layer as follows: 32" o.c. at top and bottom and staggered.

Page 2 of 4

f. For wood structural panel roof sheathing attached to gable end roof framing and to intermediate supports within 48 inches of roof edges and ridges, nails shall be spaced at 4 inches on center where the ultimate design wind speed is greater than 130 mph in Exposure B or greater than 110 mph in Exposure C. g. Gypsum sheathing shall conform to ASTM C 1396 and shall be installed in accordance with ASTM C 1280 or GA 353. Fiberboard sheathing shall conform to ASTM C 508.

h. Spacing of fasteners on floor sheathing panel edges applies to panel edges supported by framing members and required blocking and at floor perimeters only. Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and required blocking. Blocking of roof or floor sheathing panel edges perpendicular to the framing members need not be provided except as required by other provisions of this code. Floor perimeter shall be supported by framing members or solid blocking.

j. Where a rafter is fastened to an adjacent parallel ceiling joist in accordance with this schedule, provide two toe nails on one side of the rafter and toe nails from the ceiling joist to top plate in accordance with this schedule. The toe nail on the opposite side of the rafter shall not be required.

☞ The fastener schedule provides minimum nailing requirements (i.e. size, spacing) for connecting building elements used in wood framed construction. For wood structural panels, both edge nailing and intermediate (field) nailing are specified. In addition to the nailing for wood structural panels, fasteners are specified for gypsum wall sheathing, cellulose fiberboard wall sheathing and combination subfloor underlayment.

Page 4 of 4