

Building Permits & Inspections is now doing Drywall nail inspections and Insulation inspections.  
Inspection code 114 for Insulation. Inspection code 111 for Drywall nail. Please schedule these inspections prior to installing drywall or finishing drywall.

# VINCENT VONG'S RESIDENCE

## 6920 53RD AVE, SACRAMENTO, CA 95828



**BAJ  
GRAPHIC DESIGN**

9743 WHITE PINE WAY, ELK GROVE, CA 95624  
Email: helennguyen3689@gmail.com  
Tel: (916) 526-5881 & (408) 876-8402

Date: MAY 2024

Scale: AS SHOWN

Drawn: LUYEN HONG NGUYEN

Signed: *Thuy*

STAMPED FROM CITY

**JOB**  
**06/07/2024**

APPROVED  
By Tony Nguyen at 11:46 am, Jun 07, 2024

PROJECT DATA - SITE PLAN  
VINCENT VONG'S RESIDENCE  
TELL: (916) 807-0998  
EMAIL: VINCENTVONG06@GMAIL.COM

REVISION	DATE	BY
	05-30-2024	HL

SHEET NO:


A-1

### ENERGY COMPLIANCE FEATURES

	Yes	No	
HERS Rater	<input checked="" type="checkbox"/>	<input type="checkbox"/>	AFUE / HSPF 7.5
Radiant Barrier	<input checked="" type="checkbox"/>	<input type="checkbox"/>	EER / ACSEER 14.3/11.7
Cool Roof	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Wall Insulation R: R-15
House Wrap	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Ceiling Insulation R: R-38
Pipe Insulation	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Floor Insulation R:
W.H. Blanket	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Glass U Factor .3
W.H. Energy Factor HPWH			Glass SHGC .23
Duct Insulation R:			Windows:
Other: SOLARSHARES PROGRAM			

### STRUCTURAL GENERAL NOTES

- DESIGNATE ONE AREA OF THE CONSTRUCTION SITE FOR THE STAGING OF VEHICLES, MATERIAL DELIVERIES, AUTOS AND EQUIPMENT. CONSTRUCTION RELATED ITEMS STORED ON-SITE SHALL BE CONFINED TO THIS AREA. REFUELING AND ROUTINE VEHICLE AND EQUIPMENT MAINTENANCE SHALL BE PERFORMED IN THE DESIGNATED AREA. THE DESIGNATED AREA SHALL BE WELL AWAY FROM STREAMS OR OTHER SURFACE STORM DRAINAGE SYSTEMS, SO AS TO AVOID POTENTIAL CONTAMINATION OF THE RUN-OFF. THE LOCATION SHALL BE COORDINATED WITH THE BUILDING OWNER.
- EQUIPMENT UTILIZED ON THE PROJECT SHALL BE WELL MAINTAINED AND IN GOOD WORKING ORDER. INSPECT ALL EQUIPMENT REGULARLY, WITH ANY MAJOR REPAIRS NECESSITATED PERFORMED OFF-SITE. EQUIPMENT SHALL NOT REMAIN STORED ON-SITE FOR PERIODS LONGER THAN THAT NEEDED FOR THE INTENDED FUNCTION, BASED UPON THE WORK BEING PERFORMED. WASHING OF EQUIPMENT SHALL NOT BE PERFORMED ON-SITE.
- MAINTAIN A DUMPSTER FOR CONSTRUCTION DEBRIS. PLACE DUMPSTER UNDER A ROOF OR COVERED BY TARP SECURED AROUND THE OUTSIDE OF THE DUMPSTER. DO NOT CLEAN OUT A DUMPSTER BY HOISING DOWN ONTO THE CONSTRUCTION SITE.
- MAINTAIN PORTABLE TOILETS ON-SITE FOR THE USE OF THE CONSTRUCTION PERSONNEL. CHECK FOR LEAKS TO ENSURE THAT THEY ARE IN GOOD WORKING ORDER.
- SCHEDULE EXCAVATION AND GRADING ACTIVITIES FOR DRY WEATHER PERIODS. COVER EXPOSED PILES OF SOIL OR STOCKPILES OF CONSTRUCTION MATERIALS WITH PLASTIC SHEETING OR TEMPORARY ROOFS AND PROTECT FROM WIND. SWEEP OR CLEAN DUST AND DEBRIS ACCUMULATED ON PAVING OR SIMILAR SURFACES THAT DRAIN INTO STORM WATER SYSTEMS PRIOR TO THE ONSET OF INCLEMENT WEATHER. DO NOT HOSE-DOWN SUCH SURFACES WHERE MATERIALS HAVE SPILLED.
- AVOID CREATING EXCESSIVE AMOUNTS OF DUST WHEN BREAKING AND REMOVING ASPHALT OR CONCRETE PAVING. SHOVEL OR VACUUM SAW-CUT SLURRY AND REMOVE FROM SITE. COVER OR BARRICADE STORM DRAIN INLETS DURING SAW-CUTTING AS NECESSARY. DO NOT HOSE-DOWN STREETS TO CLEAN UP DEBRIS.
- AVOID PAVING AND SEAL COATING IN WET WEATHER, OR IF RAIN IS IMMINENT BEFORE FRESH PAVEMENT WILL HAVE TIME TO CURE. COVER AND SEAL CATCH BASINS AND MANHOLES WHEN APPLYING SLURRY OR SEAL COATS.
- WHEN CLEANING UP AFTER CONCRETE PAVING WORK, WASH FINES AND EXCESS MATERIALS INTO DIRT AREAS. WASH OUT CONCRETE MIXERS ONLY IN DESIGNATED AREAS WHERE WATER WILL FLOW INTO CONTAMINANT PONDS OR ONTO DIRT AREAS. DISPOSAL OF WASHOUT INTO THE STREET OR STORM DRAINAGE SYSTEM IS PROHIBITED BY LAW.
- MAKE EVERY EFFORT TO RECYCLE WASTE PRODUCTS WHERE POSSIBLE. TYPICALLY, SOLVENTS, WATER BASED PAINTS, VEHICLE FLUIDS, BROKEN ASPHALT AND CONCRETE, WOOD AND CLEARED VEGETATION CAN BE RECYCLED. THOSE MATERIALS WHICH ARE NOT RECYCLABLE SHALL BE DISPOSED OF AT AN APPROPRIATE LANDFILL SITE OR TREATED AS HAZARDOUS WASTE AS REQUIRED. IN NO CASE SHALL WASTE PRODUCTS BE BURIED ON-SITE.
- KEEP POLLUTANTS OFF OF EXPOSED SURFACES. CLEANUP SPILLED MATERIALS IMMEDIATELY. CLEAN UP SPILLS ON DIRT AREAS BY REMOVING AND PROPERLY DISPOSING OF CONTAMINATED SOIL. SURFACES WHERE MATERIALS HAVE BEEN SPILLED SHALL NOT BE HOSED-DOWN, USE DRY CLEANUP METHODS WHENEVER POSSIBLE. WHERE WATER MUST BE USED, USE IT SPARINGLY. SIGNIFICANT HAZARDOUS SPILLS SHALL BE REPORTED TO THE APPROPRIATE SPILL AGENCY IMMEDIATELY AND/OR DIAL 911 AS NECESSARY.
- CONSTRUCTION SITE SHALL COMPLY WITH APPLICABLE PROVISIONS OF THE CFC CHAPTER 33 AND COUNTY STANDARD DETAIL AND SPECIFICATION SI-7
- ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL CONFORM TO THE CITY OF SACRAMENTO STANDARD SPECIFICATION, DATED JUNE 2007.
- THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE EXACT LOCATION OF ALL EXISTING UTILITIES AND FOR THE PROTECTION OF AND REPAIR OF DAMAGE TO THEM. CONTACT UNDERGROUND SERVICE ALERT 1-800-642-2444, 48 HOURS BEFORE WORK IS TO BEGIN.
- THE CONTRACTOR SHALL PROVIDE EROSION, SEDIMENT, AND POLLUTION CONTROL BEST MANAGEMENT PRACTICES (BMPs) WHEN AND WHERE APPLICABLE PER THE CITY OF SACRAMENTO STANDARD SPECIFICATIONS SECTION 16-3.
- DIRECT ALL NEW DOWNSPOUTS ONTO NATURAL GROUND OR LANDSCAPED AREAS WHERE FEASIBLE.
- FLOOD ZONE X PANEL 0302
- NO PERMANENT STRUCTURE (INCLUDING WITHOUT LIMITATION GARAGES, PATIOS, CONCRETE SLABS, TOOL SHED, ROOF OVERHANGS AND SIMILAR STRUCTURES) SHALL BE CONSTRUCTED ON TOP OF WATER, SEWER OR DRAINAGE PIPELINES OR ANYWHERE WITHIN THE ASSOCIATED UTILITY EASEMENTS. (ORD. 2001-033)
- CONTRACTOR IS RESPONSIBLE FOR DETERMINING EXACT LOCATIONS AND PROTECTION OF ALL EXISTING MAINS AND LINES. YOU CAN CONTACT CITY CREWS AT 311 TO LOCATE SERVICES. IT IS THE RESPONSIBILITY OF THE PROPERTY OWNER TO DETERMINE THE LOCATION OF ANY EASEMENTS OF RECORD ENCUMBERED WITHIN THE PROPERTY

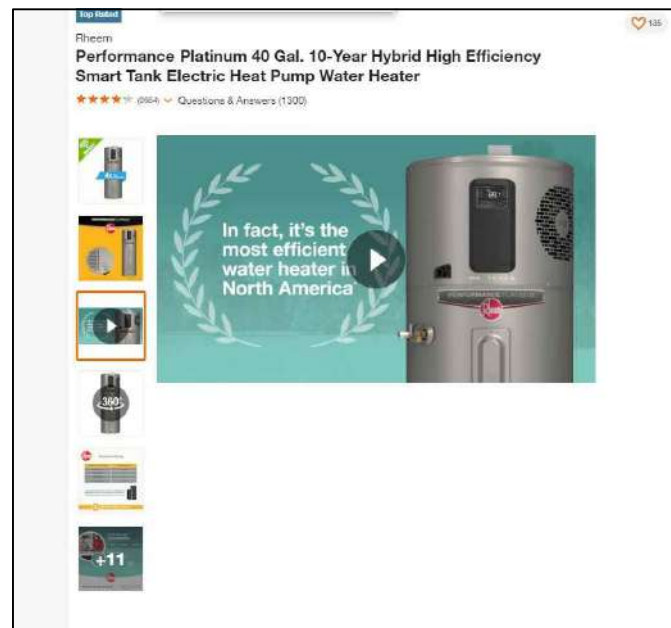

ADDITIONAL CLEANOUTS REQUIRED IF LENGTHS EXCEED 100-FT

PLANNING APPROVAL				
05/13/2024	Young Choi			
Date	Planner			
Use Zone	Front Yt	Side Yt	Side Yt	Rear
RD-5	20'	N/A	4'	4'
SPECIAL CONDITIONS/COMMENTS				



TECHNICAL RESOURCES CONFIRMS THE PROPOSED STRUCTURE(S) ON THE SITE PLAN IS OUTSIDE KNOWN PUBLIC EASEMENTS AND THE PROPERTY LAYOUT IS CONSISTENT WITH THE ASSESSOR'S PARCEL PAGE.

NAME: LAI MAN CHEUNG DATE: May 15, 2024  
ENCROACHMENT OF STRUCTURES INCLUDING OVERHANGS IS NOT PERMITTED WITHIN PUBLIC AND PRIVATE EASEMENTS.  
ANY WORK WITHIN THE ROAD RIGHT-OF-WAY REQUIRES AN APPROVED ENCROACHMENT PERMIT OR APPROVED IMPROVEMENT PLAN. TECHNICAL RESOURCES DOES NOT APPROVE BUILDING SETBACKS FROM ROADWAYS AND PROPERTY LINES.

**PLANS APPROVED  
FOR PERMIT**  
Sacramento County Department of  
Community Development

Building Permits and Inspection Division  
The approval of this plan is in conformity with the requirements of the County ordinance, and the County does not assume any responsibility for the structural design. Permittee is required to contact the local Fire Authority where this project is located for their requirements prior to construction.

NAME: Tony Nguyen  
DATE: 06/07/2024

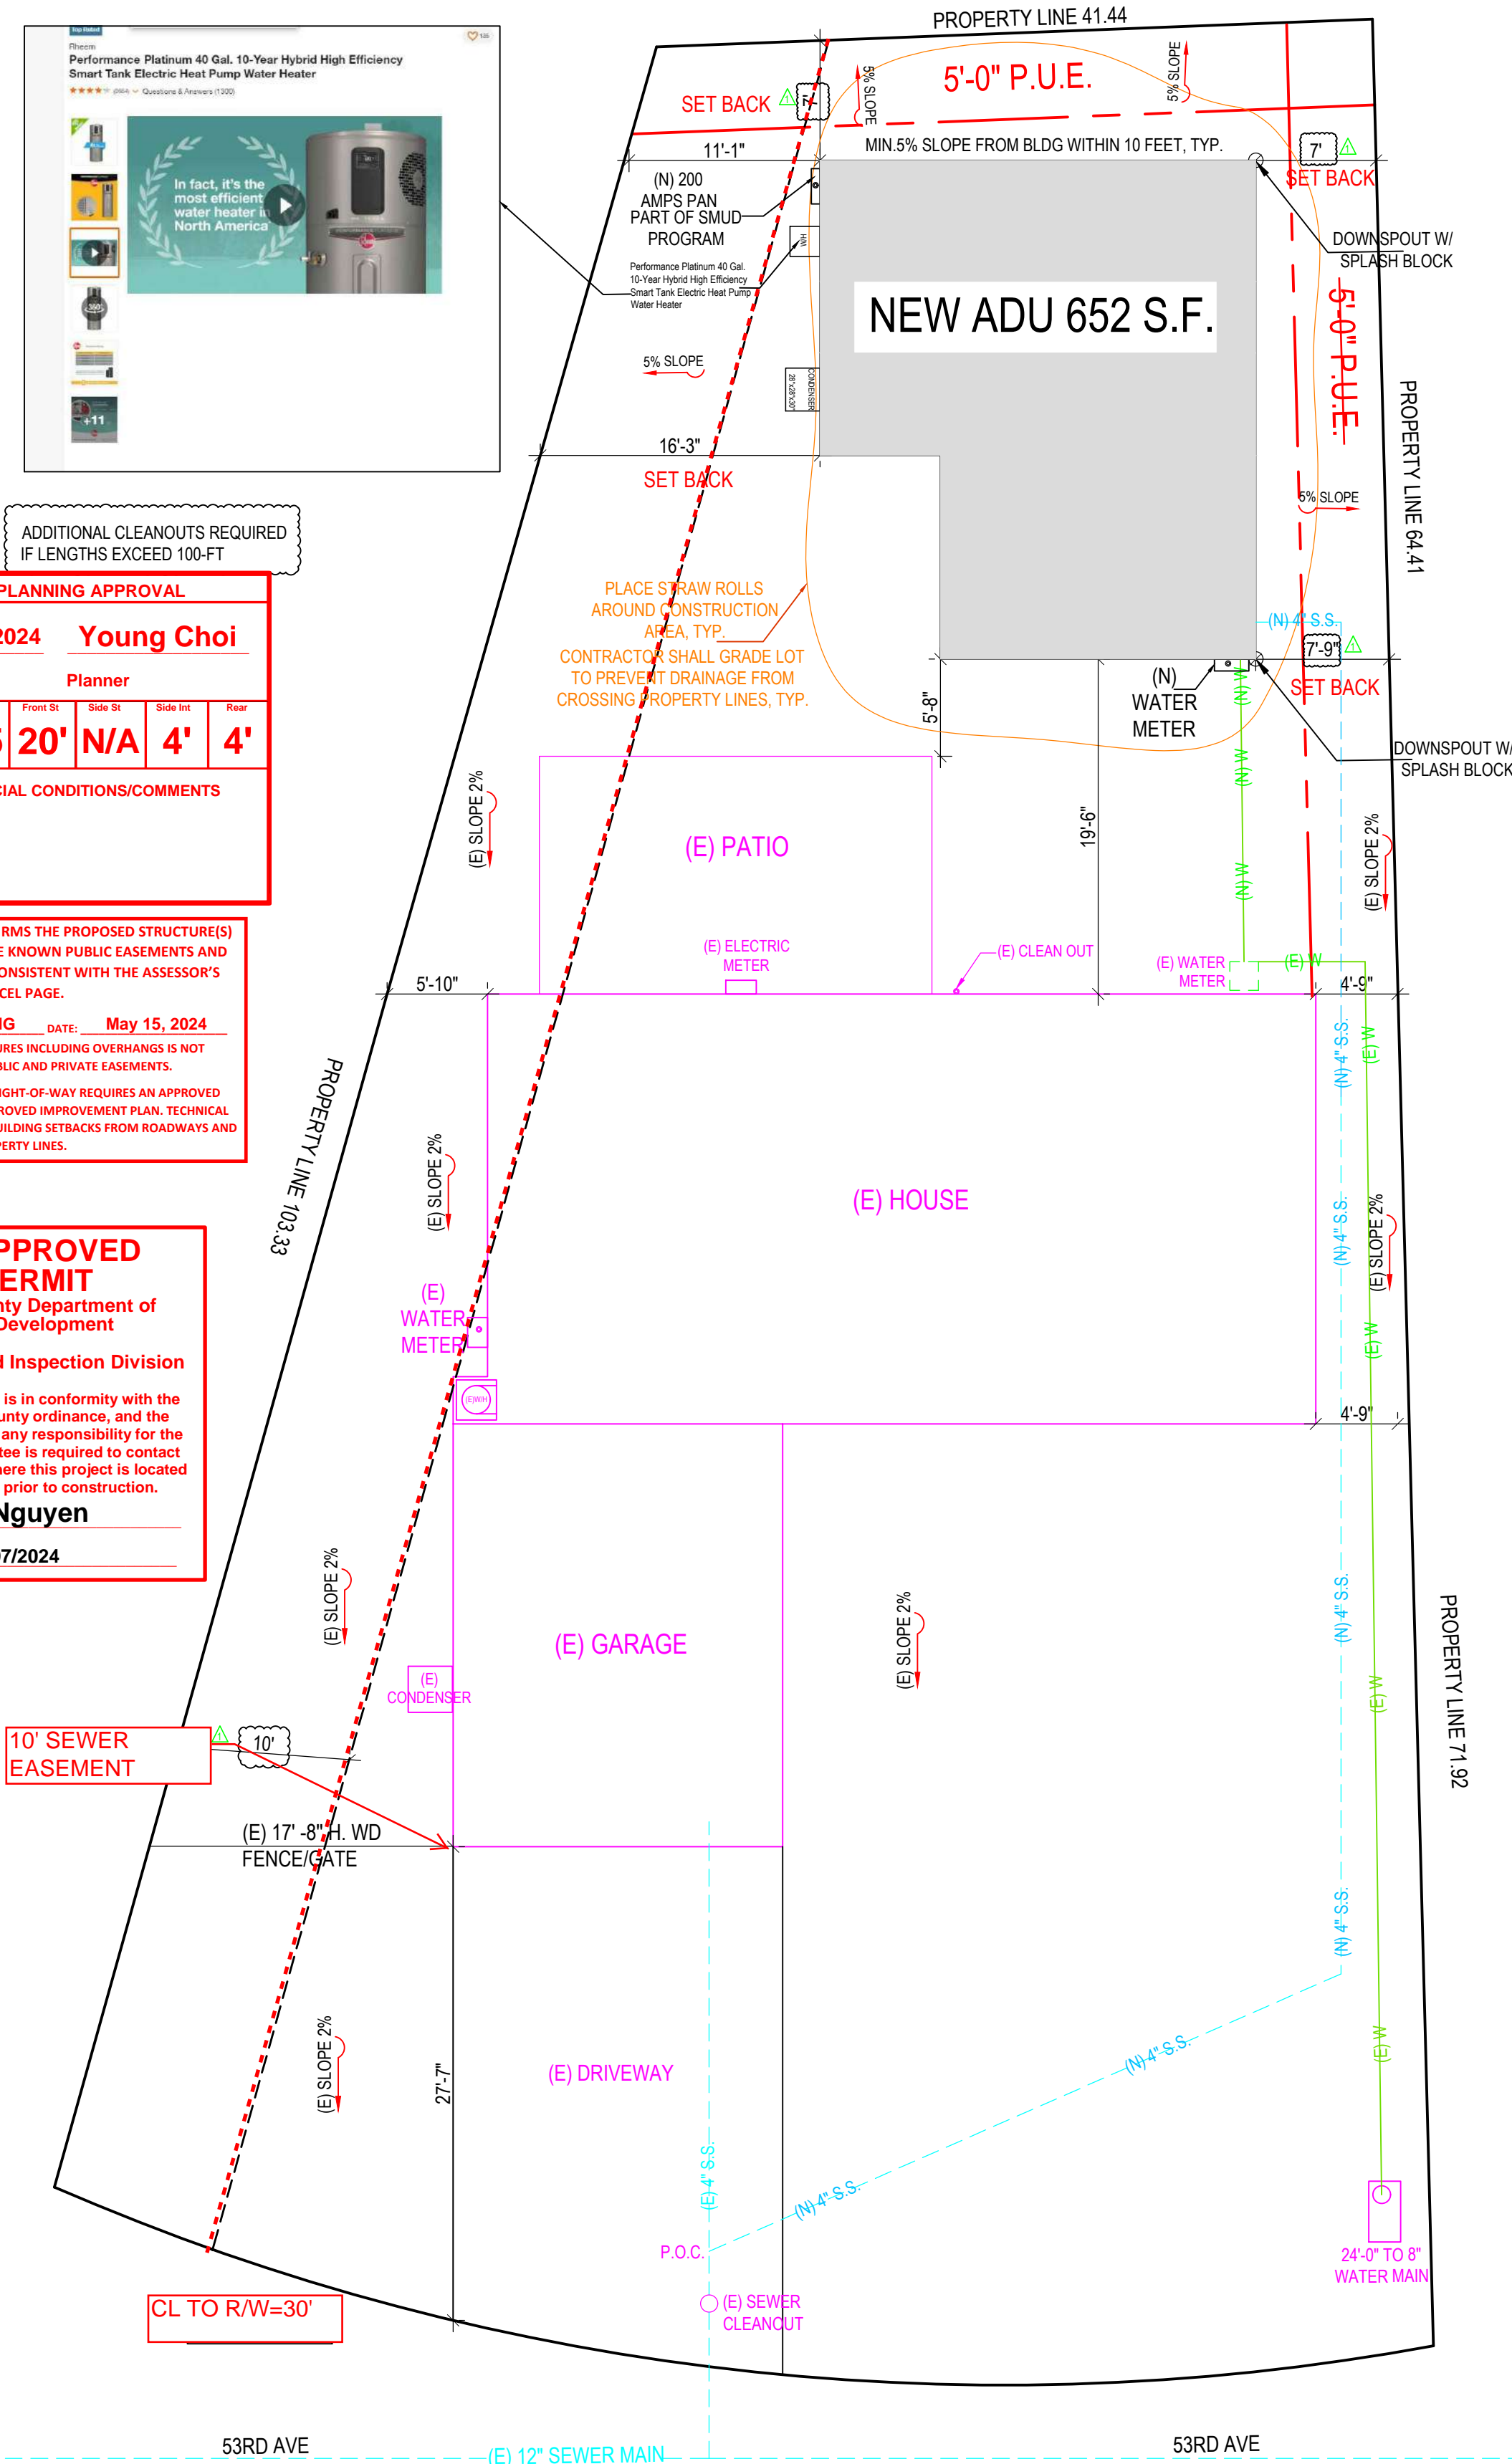

SITE PLAN - SCALE: 1 / 8" = 1'-0"

### PROJECT DATA

OWNER: VINCENT VONG  
EXISTING USE: SINGLE FAMILY RESIDENCE  
LOCATION: 6920 53RD AVE, SACRAMENTO, CA 95828  
APN: 040-0164-002  
ZONING: R1  
LOT GROSS SIZE: 8,712 S.F.  
OCCUPANCY GROUP: R-3U  
TYPE OF CONSTRUCTION: V-B  
FIRE SPRINKLER: NONE  
YEAR BUILT: 1963  
ALLOWABLE FLOOR AREA: 3,920 S.F.  
LOT AVERAGE SLOPE: (FLAT)  
FLOOR AREA: EXISTING PROPOSAL TOTAL  
DWELLING: 1,146 S.F. 652 S.F. 1,798 S.F.  
GARAGE: 471 S.F. 471 S.F.  
TOTAL FOOTPRINT: 1,798S.F.  
FAR: 21.0 %

### SCOPE OF WORK

DETACHED ADU IN THE BACK 652 S.F. (INCLUDING 2 BEDROOMS, 1 LIVING ROOM, 2 BATHROOMS AND 1 KITCHEN)

- BUILDING-LEVEL VERIFICATIONS AND PV: None required, SMUD program
- QUALITY INSULATION INSTALLATION (QI)
- INDOOR AIR QUALITY VENTILATION

COOLING SYSTEM VERIFICATIONS:

- MINIMUM AIRFLOW
- VERIFIED EER
- VERIFIED SEER
- FAN EFFICACY WATTS/HPM

SPECIFICATION SUMMARY:

Water Heater: New 40 Gal Heat Pump Water Heater (HPWH) (Rheem XE40T10H4SU) – 13k BTU/Hr – Uniform Energy Factor (UEF) 3.1  
HVAC: New Mini Split – Heating, 7.5 HSPF2 – Cooling, 14.3 SEER2, 11.7 EER2 – Ductless – Variable Capacity Heat Pump (VCHP) credit requires  
HVAC: additional HERS Testing  
Quality Insulation Installation (QI): Yes  
Walls: R-15 in 2x4 – Windows & Glass Doors: U-Factor 0.30 – SHGC 0.23  
Roof: Attic: R-38 w/ Radiant Barrier

### STRUCTURAL GENERAL NOTES

#### G. NAIL SCHEDULE

- WOOD MEMBERS SHALL BE CONNECTED WITH NAILING INDICATED IN TABLE 2304.9.1 OF 2022 CBC UNLESS GREATER SIZES AND NUMBER OF NAILS ARE SHOWN OR NOTED ON DRAWINGS; NAILS EXPOSED TO WEATHER SHALL BE GALVANIZED; NAILS SHALL BE COMMON WIRE NAILS; HOLES FOR NAILS SHALL BE PROVIDED WHERE THE WOOD TENDS TO SPLIT; SPLIT WOOD MEMBERS SHOULD BE REPLACED AND REMOVED FROM THE JOB PROMPTLY. SHORT PLYWOOD NAILS FOR EQUIVALENT SHEAR VALUE MAY BE USED. SEE PLANS FOR NAIL SPACING. NAIL ROOF SHEATHING 8d @ 6" O.C. AT SUPPORTED EDGES. 8d @ 10" INCHES O.C. AT INTERMEDIATE SUPPORTS. FLOOR SHEATHING 8d @ 6" O.C. AT BOUNDARIES AND PANEL EDGES AND 8d @ 10" O.C. AT INTERMEDIATE SUPPORTS. PLYWOOD WALL SHEATHING SHALL BE NAILED PER SHEAR WALL SCHEDULE AT SHEAR WALLS, AND AT A MINIMUM OF 8d @ 6" O.C. ALL OTHER EDGES.
- AT PRESSURE TREATED LUMBER USE HOT-DIPPED GALVANIZED, STAINLESS STEEL, SILICON BRONZE, OR COPPER.

### APPLICABLE CODES


#### CODE COMPLIANCE

ALL CONSTRUCTION SHALL CONFORM TO ALL GOVERNING LAWS, CODES AND ORDINANCES INCLUDING BUT NOT LIMITED TO THE FOLLOWING:  
-2022 CALIFORNIA BUILDING CODES: CBC, CMC, CPC, CFC & CEC, CRC.  
-2022 CA ENERGY CODE  
-COUNTY SACRAMENTO MUNICIPAL CODE  
-ALL LOCAL ORDINANCES

PERMIT NUMBER

CBNR2024-00219

### VICINITY MAP

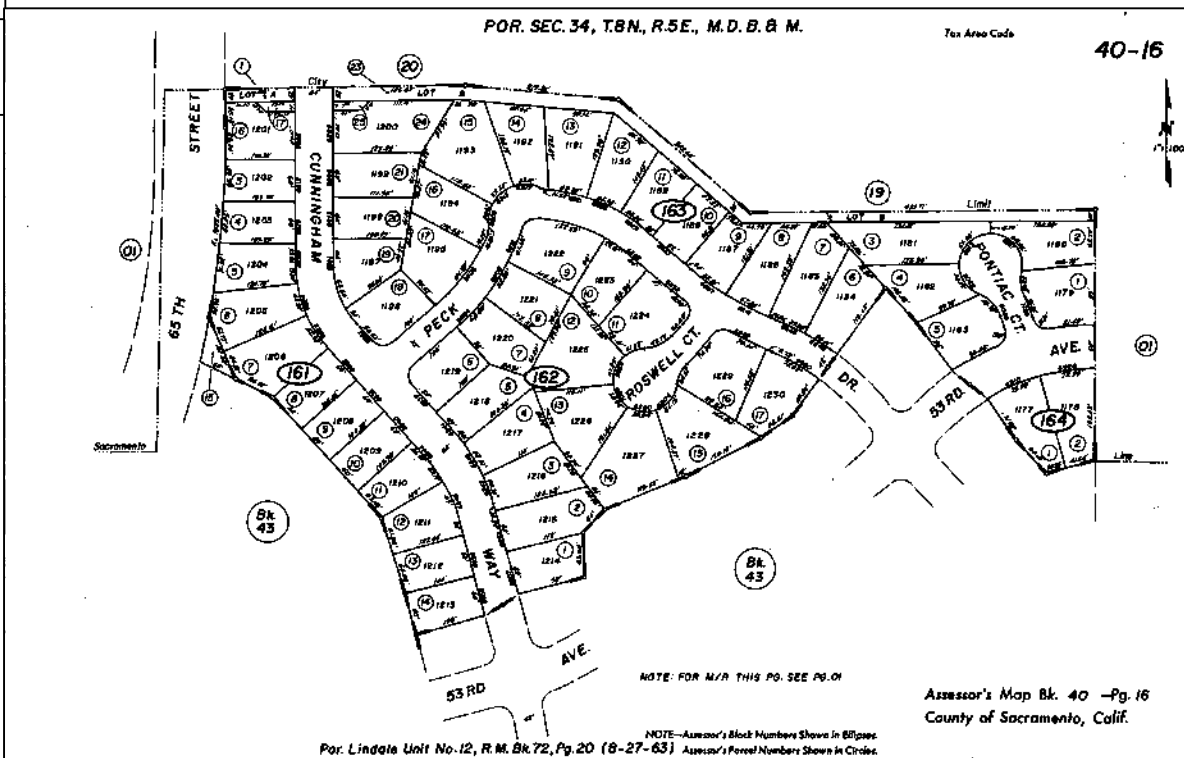

### INDEX

A-1	SITE PLAN, SUMMARY, NOTES, AREA A-2
A-2	PROPOSAL FLOOR AND ELECTRIC PLAN
A-3	ELEVATIONS PLANS
A-4	FOUNDATION & DETAILS AND ROOF PLAN
A-5	TRUST ROOF BY COMPANY, INC
A-6	T-24 ENERGY REPORT
A-7	CG-1 CAL GREEN MANDATORY
A-8	CG-2 CAL GREEN MANDATORY
A-9	LOW - RISE - MANDATORY- MEASURES- SUMMARY
A-9	FASTENING SCHEDULE PER CRC TABLE R602.3 (1)

Smoke and Carbon Monoxide Alarms are required to be installed and operational at Final Inspection.

The Building Inspector will need to have access to verify location and operation before permit is final.

### NOTES

a) Please note that a Building Permit cannot be issued until all clearances by all reviewing departments ( listed above) have been approved on the project. Check the status of your permit by visiting www.sjpermits.org and contact the individual departments directly with any questions.  
b) Revised plans, when required, must be clouded with delta number with a revision mark at each location where revision has occurred and be noted that additional comments may be triggered once revised plan are reviewed.  
c) When comments cite a section of code and require a revision, correction or amendment to plans, required information shall be specifically & directly provided on plans. Generic references to code section(s) is not acceptable.



FLOOR PLAN NOTES:

- ALL CONCRETE TO BE POURED ON UNDISTURBED SOIL.
- ALL LUMBER IN CONTACT WITH CONCRETE SHALL BE FOUNDATION GRADE RWD OR PRESSURE TREATED.
- ALL LUMBER USED IN CONSTRUCTION LOCATED NEARER THAN 8" TO EARTH SHALL BE F.G. RWD OR P.T.
- PROVIDE SOLID BLOCKING FOR ALL PONY WALLS LESS THAN 14" HIGH
- PROVIDE FIRESTOPS @ CONCEALED DRAFT OPENING, CEILING LINES, FLOOR LINES, FURRED AREAS, SUSPENDED CEILINGS, STAIR STRINGERS, SHOWERS, CHIMNEY ENCLOSURES, & MID HEIGHT OF WALLS OVER 10' IN HEIGHT.
- VERIFY MIN. 22"x30" FLOOR ACCESS. ATTIC ACCESS WITH 30" CLEARING ABOVE OPENING.
- DOORS, WINDOWS, & SHOWER DOORS WITHIN HAZARDOUS AREAS TO BE TEMPERED.
- ALL POSTS, BEAMS & WALLS SUPPORTING THE FLOOR/ CEILING SHALL HAVE ONE-HOUR FIRE PROTECTION.
- ALL NEW WINDOWS AND GLASS SLIDING DOOR SHALL BE LOW-E DUAL GLAZED U.N.O.
- MATERIAL GRADE STAMPS WILL BE CHECKED ON FRAME INSPECTION.
- ALL CONSTRUCTION SHALL COMPLY WITH THE 2022 EDITION OF THE CBC, CMC, CPC, CEC, CRC AND CFC AND THE 2022 CALIFORNIA ENERGY CODE.
- CHANGES FROM THE APPROVED PLANS DURING CONSTRUCTION OTHER THAN 1) CABINET CHANGES WHEN NOT BEING SUPPORTED ENTIRELY BY THE ROOF STRUCTURE, APPROVED PLAN, 2.) INTERIOR NON-STRUCTURAL WALL FINISHES; SHALL CAUSE PLAN APPROVAL AND CONSTRUCTION TO BE SUSPENDED. A NEW PLAN CHECK (FOR A NEW PLAN) SHOWING CHANGES WILL BE SUBMITTED FOR REVIEW AND APPROVAL THROUGH THE NORMAL PLAN CHECK PROCESS.
- FIREBLOCKING WITH NON-COMBUSTIBLE MATERIAL SHALL BE PROVIDED IN OPENINGS AROUND VENTS, PIPES, DUCTS, FIREPLACES, AND SIMILAR OPENINGS PER CBC 708.2.1 (4).
- PROVIDE SMOKE DETECTORS (HARDWIRED 110V W/BATT BACK-UP) IN EVERY BEDROOMS, THE HALL WAY TO THE BEDROOM, PROVIDE CARBON MONOXIDE SMOKE ALARM DETECTOR IN ALL SLEEPING ROOM.
- IN EACH NEW BEDROOM, THERE IS AT LEAST ONE WINDOW, FOR EMERGENCY ESCAPE OR RESCUE: REQUIRE OPENING OF MINIMUM NET CLEAR AREA, 5.7 SQ. FT. HEIGHT 24", WIDTH 20", AND MAXIMUM FINISHED OPENING HEIGHT 44" ABOVE FINISH FLOOR
- NEW 3'x3' MIN. CONCRETE LANDING AT ALL NEW EXTERIOR DOOR. LANDING SHALL NOT BE LOWER THAN 7'-1/2" FROM FLOOR LEVEL.
- BATHROOM SLIDING DOOR MUST BE TEMPERED GLASS.
- ALL NEW BEDROOM MUST BE AFCI CIRCUIT.
- PRESSURE OR THERMOSTATIC MIXING VALVE AT THE SHOWERS AND TUBS, WHICH LIMIT WATER TEMPERATURE TO 120 DEGREES F
- THE SHOWERS MUST HAVE INSIDE DEMENSION OF AT LEAST 30 INCHES, THE TOTAL FLOOR AREA OF A SHOWER MUST BE AT LIST 1,024 SQUARE INCHES, OPENING TO SHOWER MUST BE MIN. 24 INCHES WIDE, THE DOOR MUST BE TEMPERED GLASS.(SEE DETAILS)

ELECTRICAL NOTES:





- MOTION SENSOR WITH INTEGRAL PHOTOCONTROL
2. ALL HARDWIRED LIGHTING IN BATHROOMS, GARAGES, LAUNDRY AND UTILITY ROOMS MUST BE HIGH EFFICACY OR CONTROLLED BY A MANUAL-ON MOTION SENSOR
3. ALL HARDWIRED LIGHTING IN OTHER ROOMS (HALLWAYS, DINING ROOMS, FAMILY ROOMS AND BEDROOMS) SHALL BE HIGH EFFICACY OR CONTROLLED BY A MANUAL-ON OCCUPANT SENSOR OR A DIMMER MUST CONTROL IT
4. ALL SWITCHES ON A MULTIPLE SWITCHED CIRCUIT SHALL BE CONTROLLED BY THE DIMMER SWITCH ON THAT CIRCUIT
5. ALL RECESSED FIXTURES SHALL BE LABELED AS BEING CERTIFIED TO HAVE A LEAKAGE RATING OF LESS THAN 2.0 AT 75 PASCAL
6. ALL HIGH EFFICACY FIXTURES AND NON-HIGH EFFICACY FIXTURES SHALL BE SWITCHED SEPARATELY
7. SMOKE DETECTOR SYSTEM SHALL BE HARD-WIRED, INTERCONNECTED TO SOUND SIMULTANOUSLY AND EQUIPED WITH BATTERY BACK UP.
8. MIN. 50% OF WATTAGE OF LIGHTS IN KITCHEN SHALL BE HIGH EFFICACY AND THOSE THAT ARE NOT SHALL BE SWITCHED SEPARATELY
9. LIGHTS MOUNTED TO EXTERIOR OF BUILDING SHALL BE HIGH EFFICACY OR ON A PHOTO CONTROL/MOTION SENSOR COMBINATION

LAMP POWER RATING:	MINIMUM LAMP EFFICACY:
15 watts or less	40 lumens per watt
over 15 watts to 40 watts	50 lumens per watt
over 40 watts	60 lumens per watt

NOTES:







NOTE: WATER-RESISTANT GYPSUM BACKING BOARD SHALL NOT BE USED WHERE THERE WILL BE DIRECT EXPOSURE TO WATER, OR IN AREAS SUBJECT TO CONTINUOUS HIGH HUMIDITY. R702.3.7.1

Note: on plan the fire-resistance-rated floor/ceiling and wall assemblies shall extend to and be tight against the exterior wall, and wall assemblies shall extend from the foundation to the underside of the roof sheathing or rated floor/ceiling assembly.

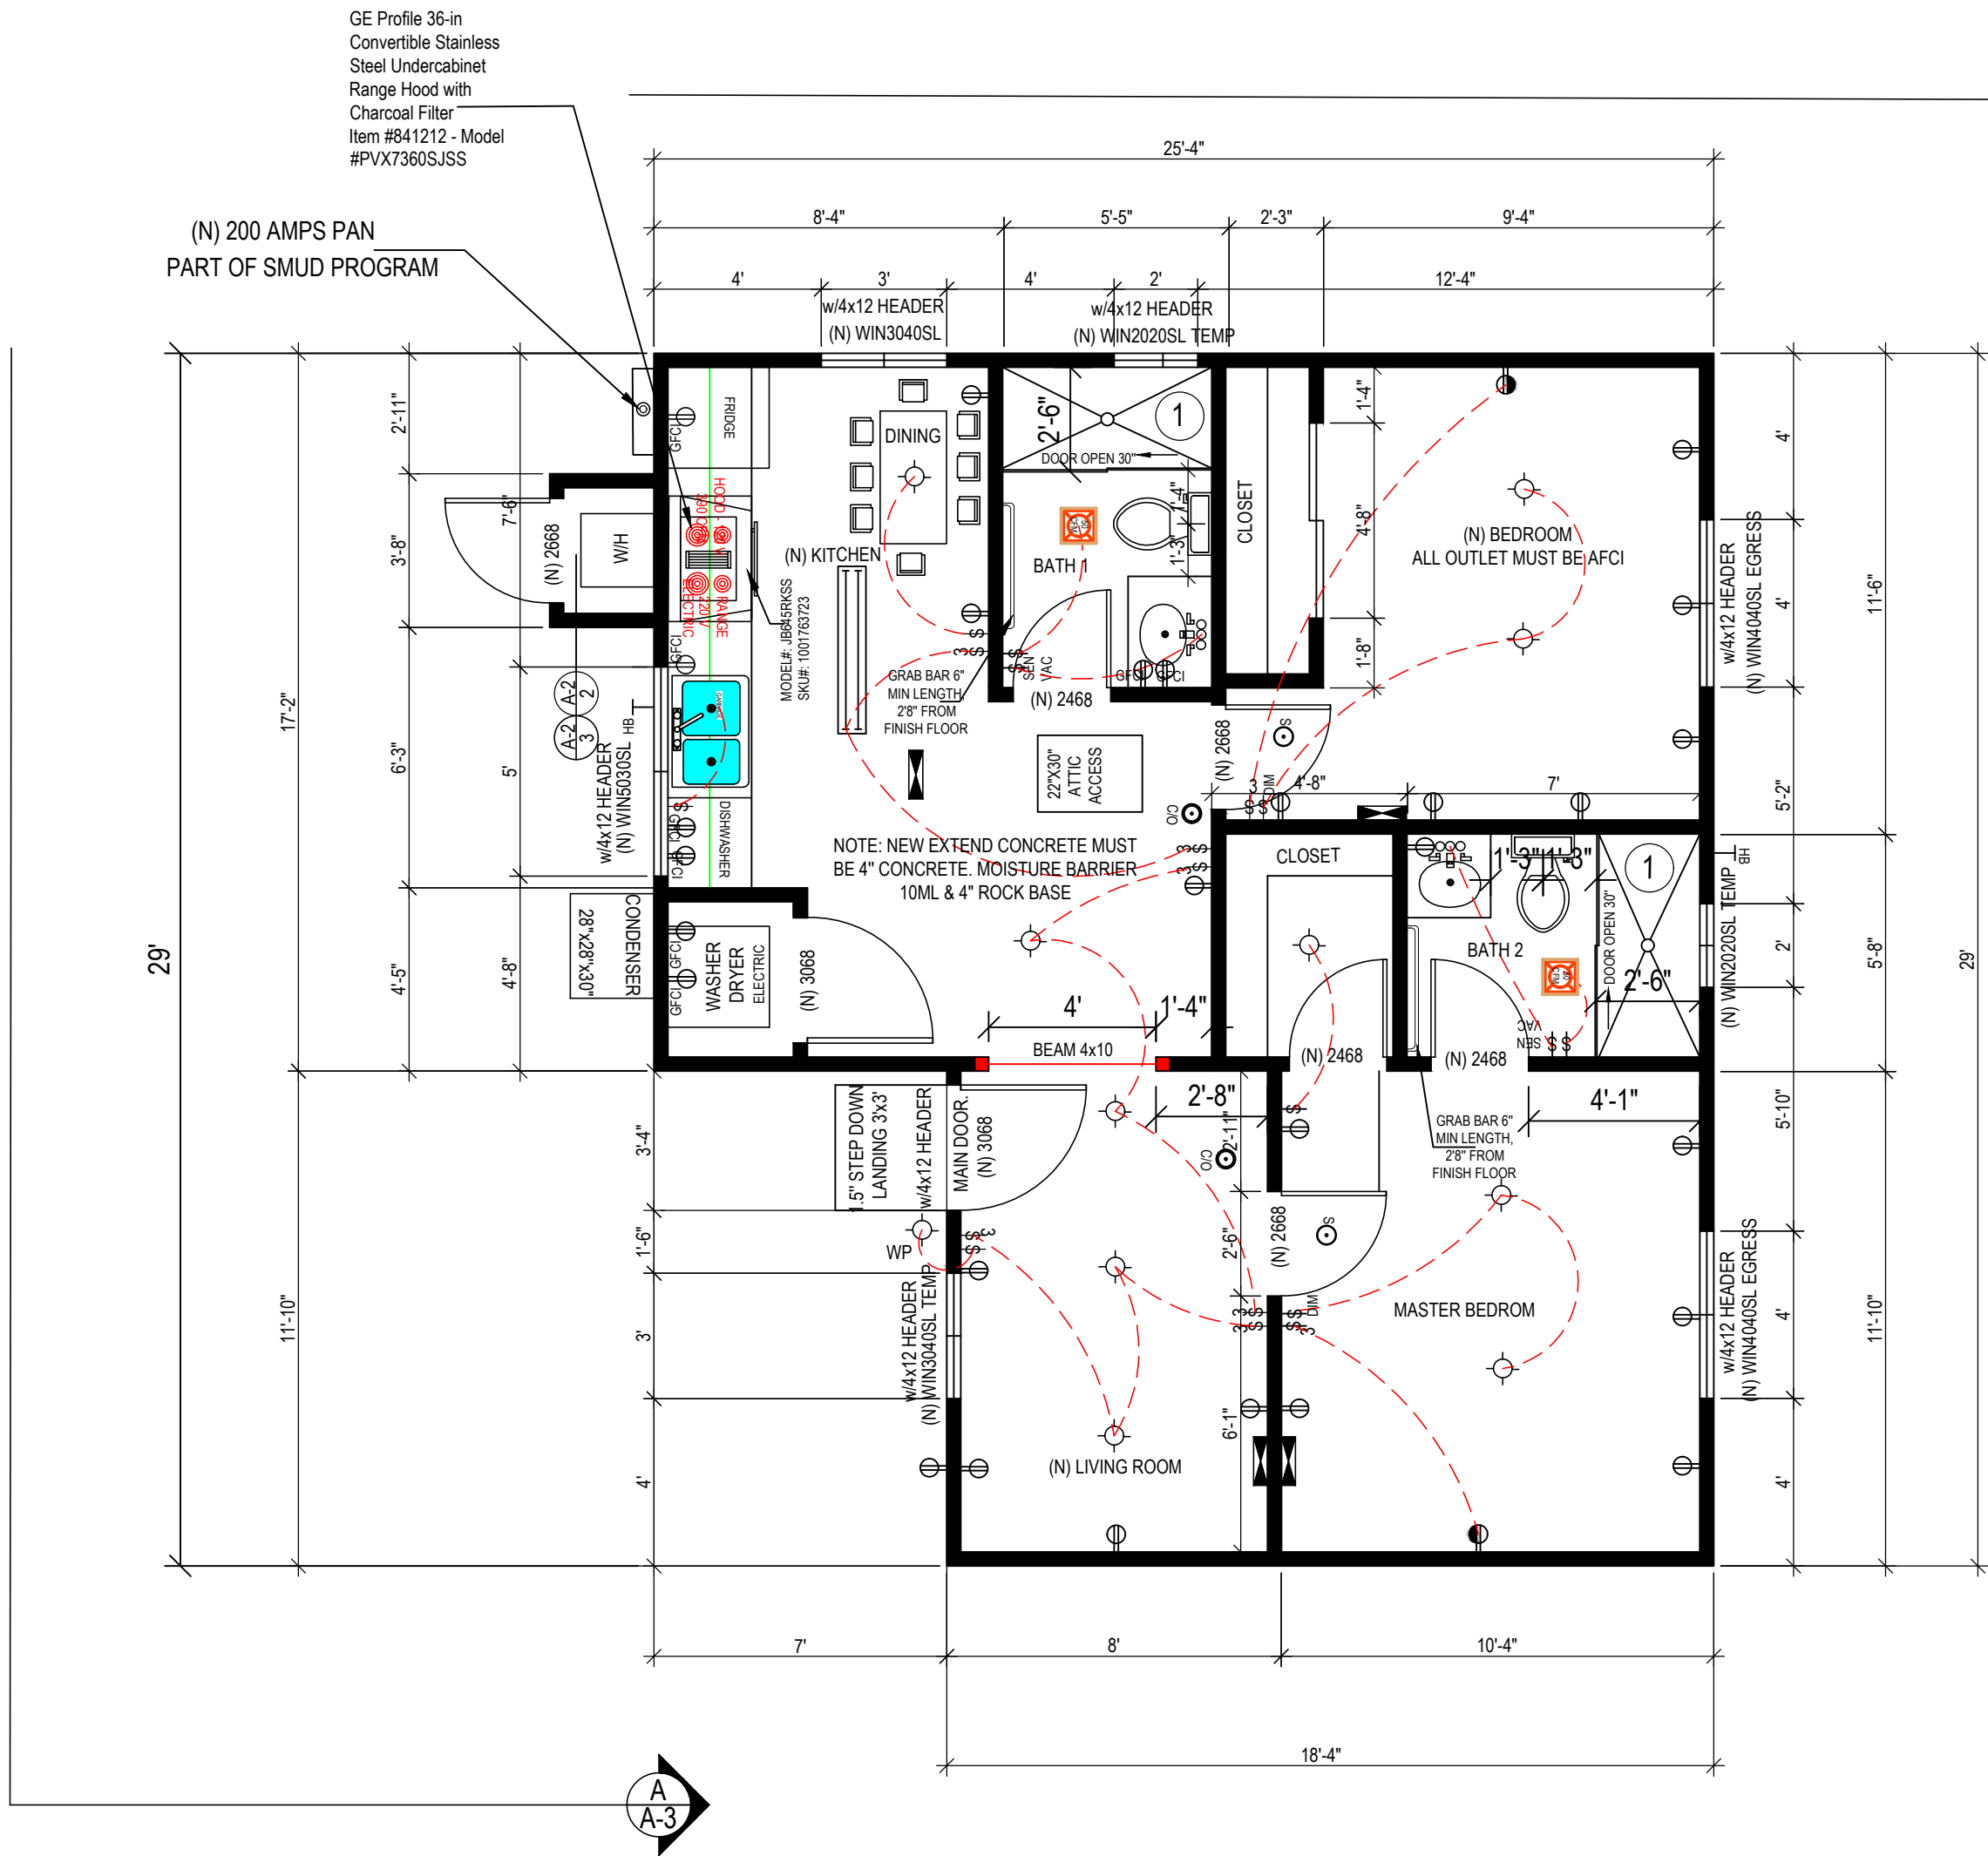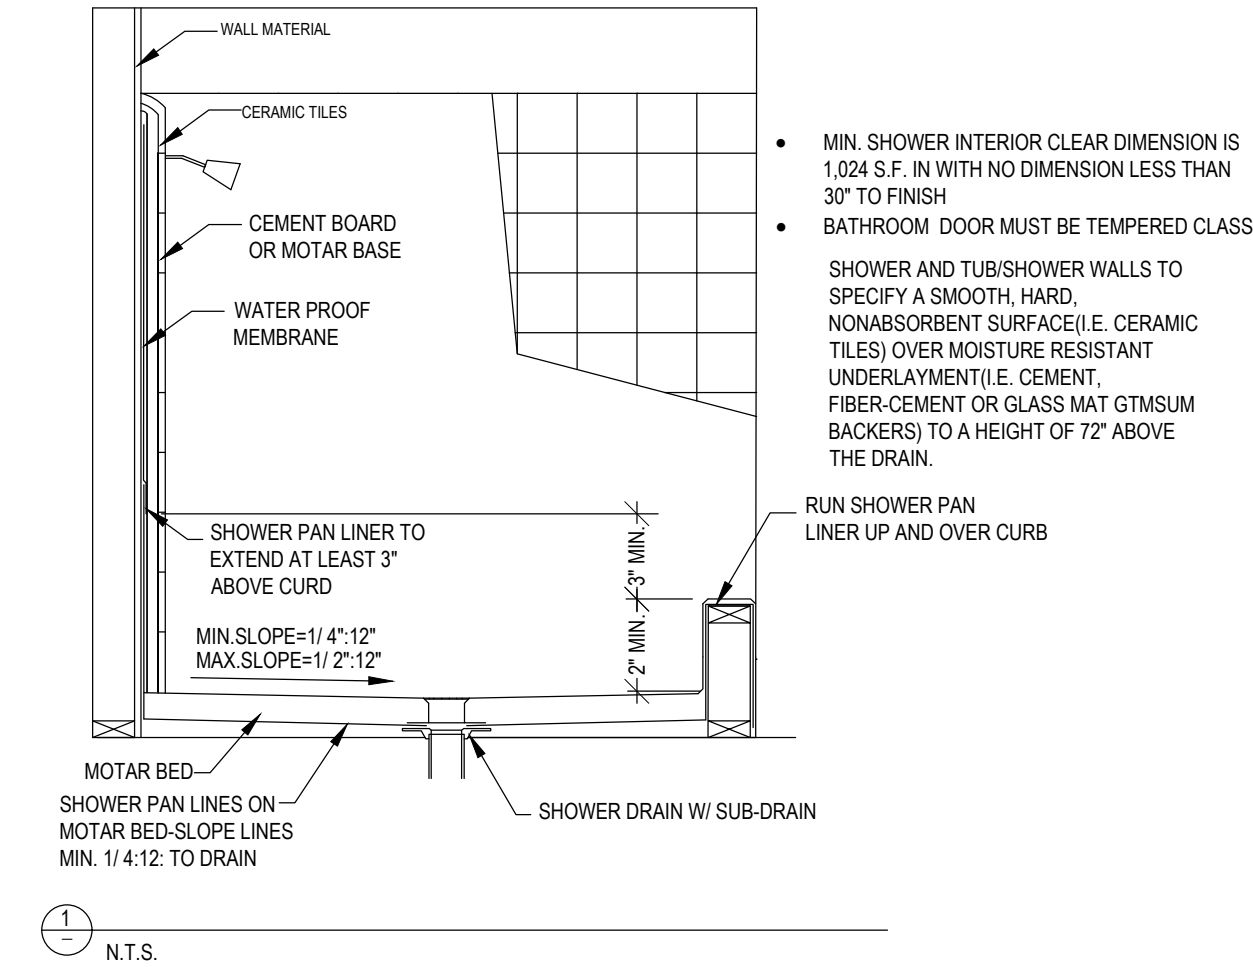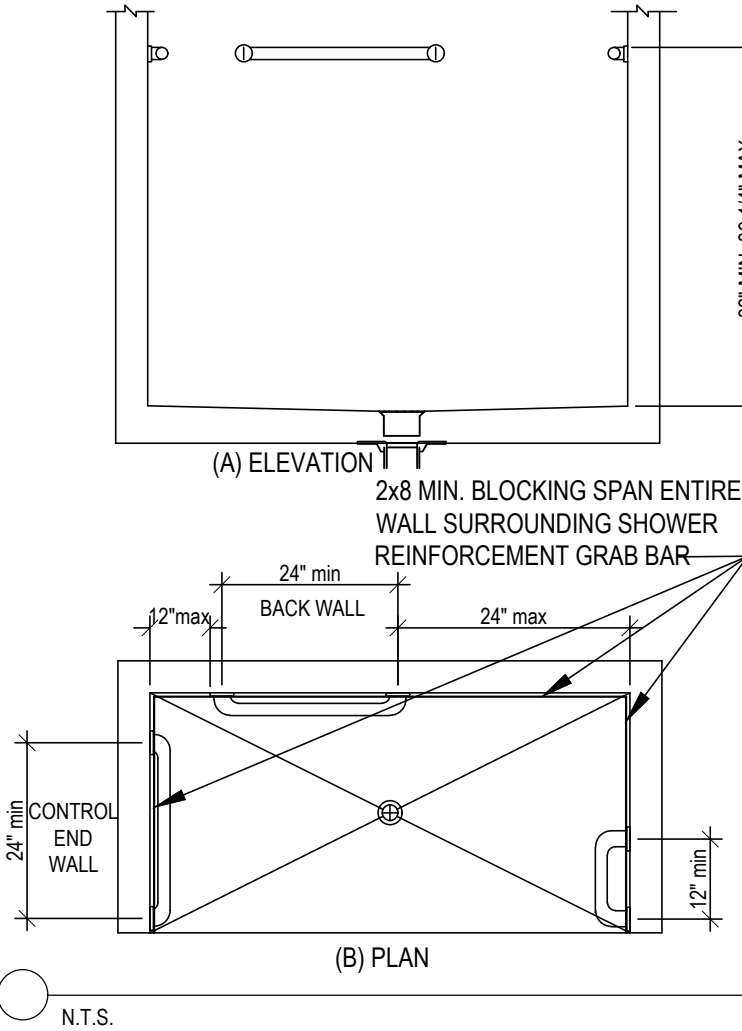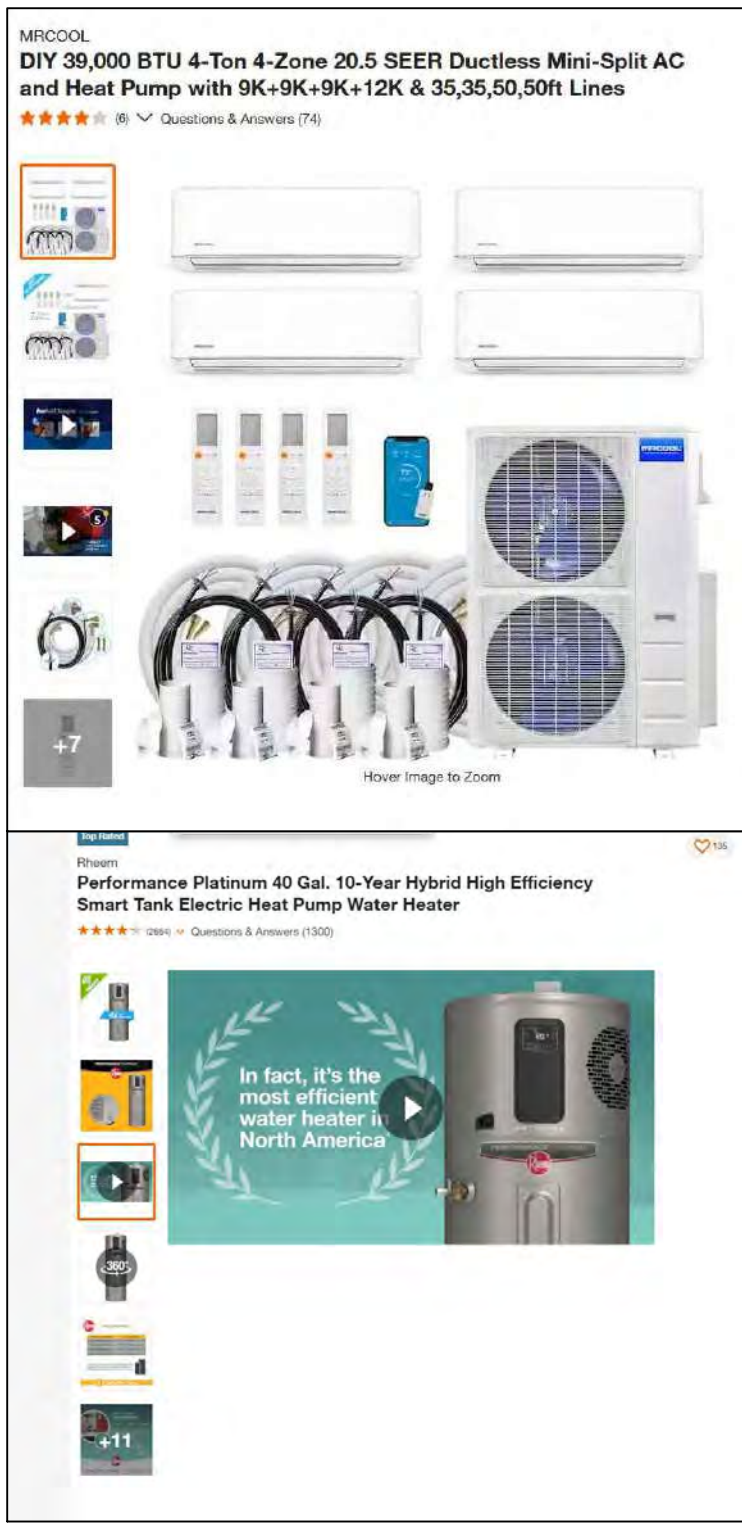



ROOF VENTILATION:  
REQUIRED: ADU 626 S.I.  
652 SF/150 = 4.35 SF/144= 626 S.I.  
PROPOSED: 724 S.I.  
PROVIDE 2 "12X18 NOVIK" 2 GABLE VENTS, 2x12 S.I. = 24 S.I.  
7 EYE BROWNS: 7x24x12 = 7x100 = 700 S.I.  
TOTAL = 724 S.I.

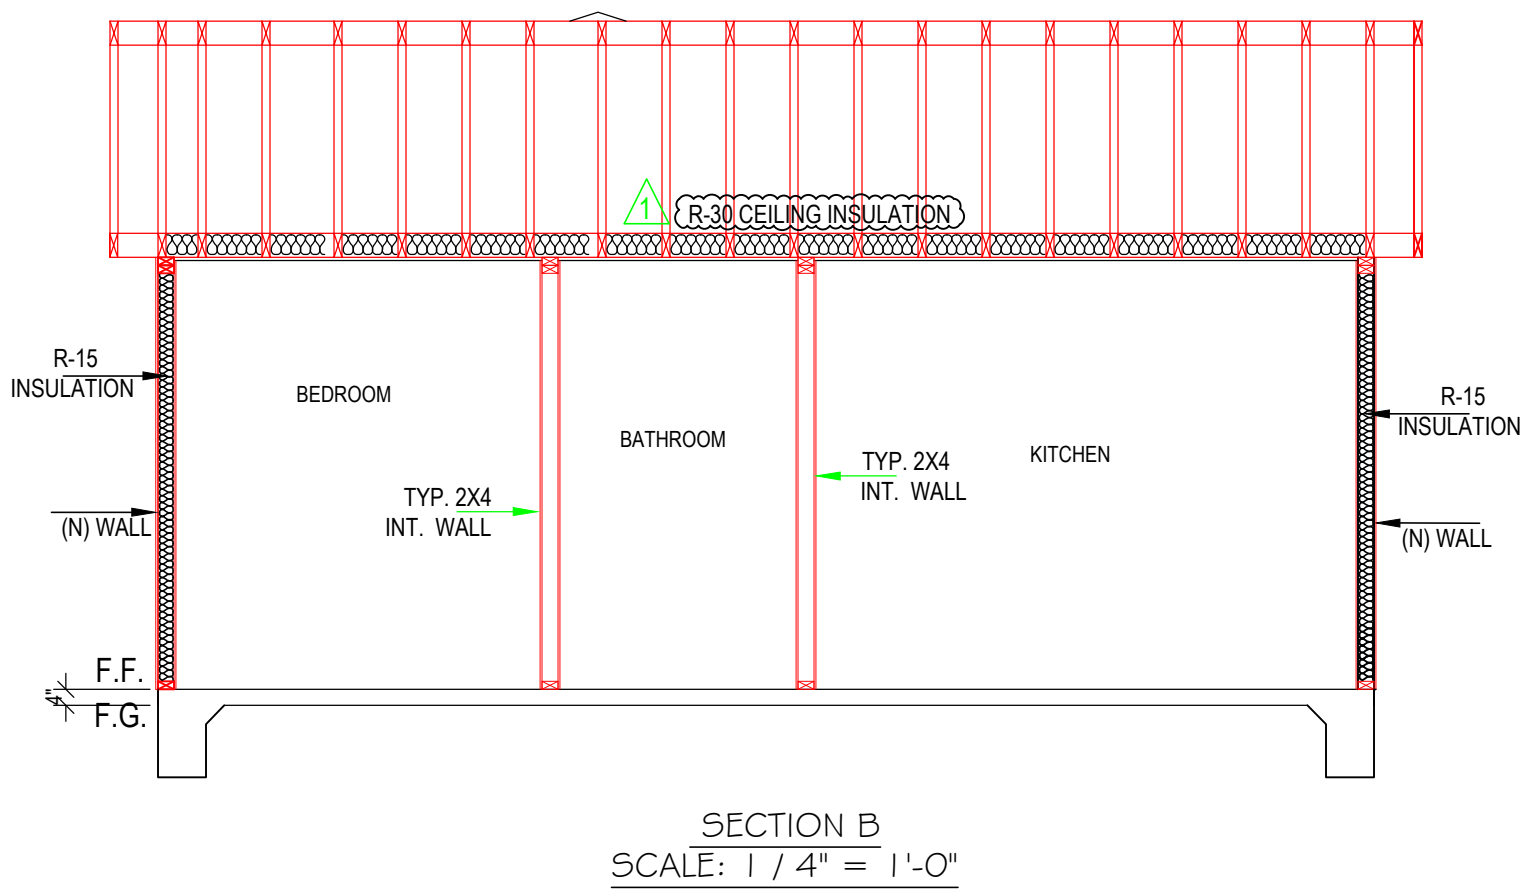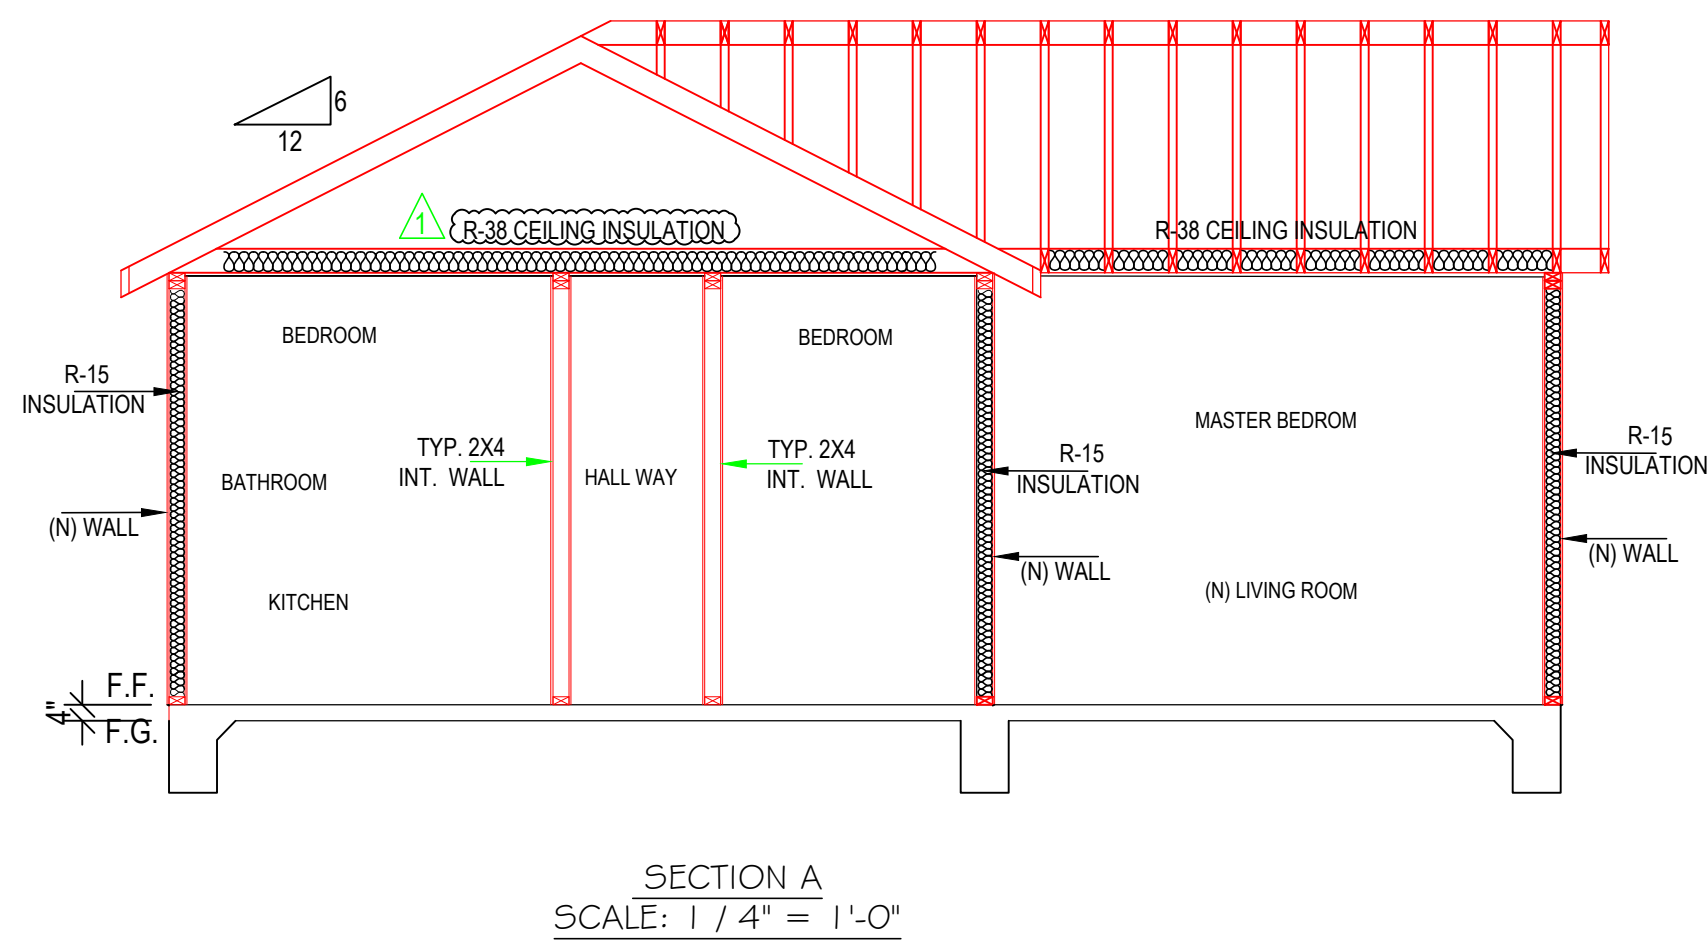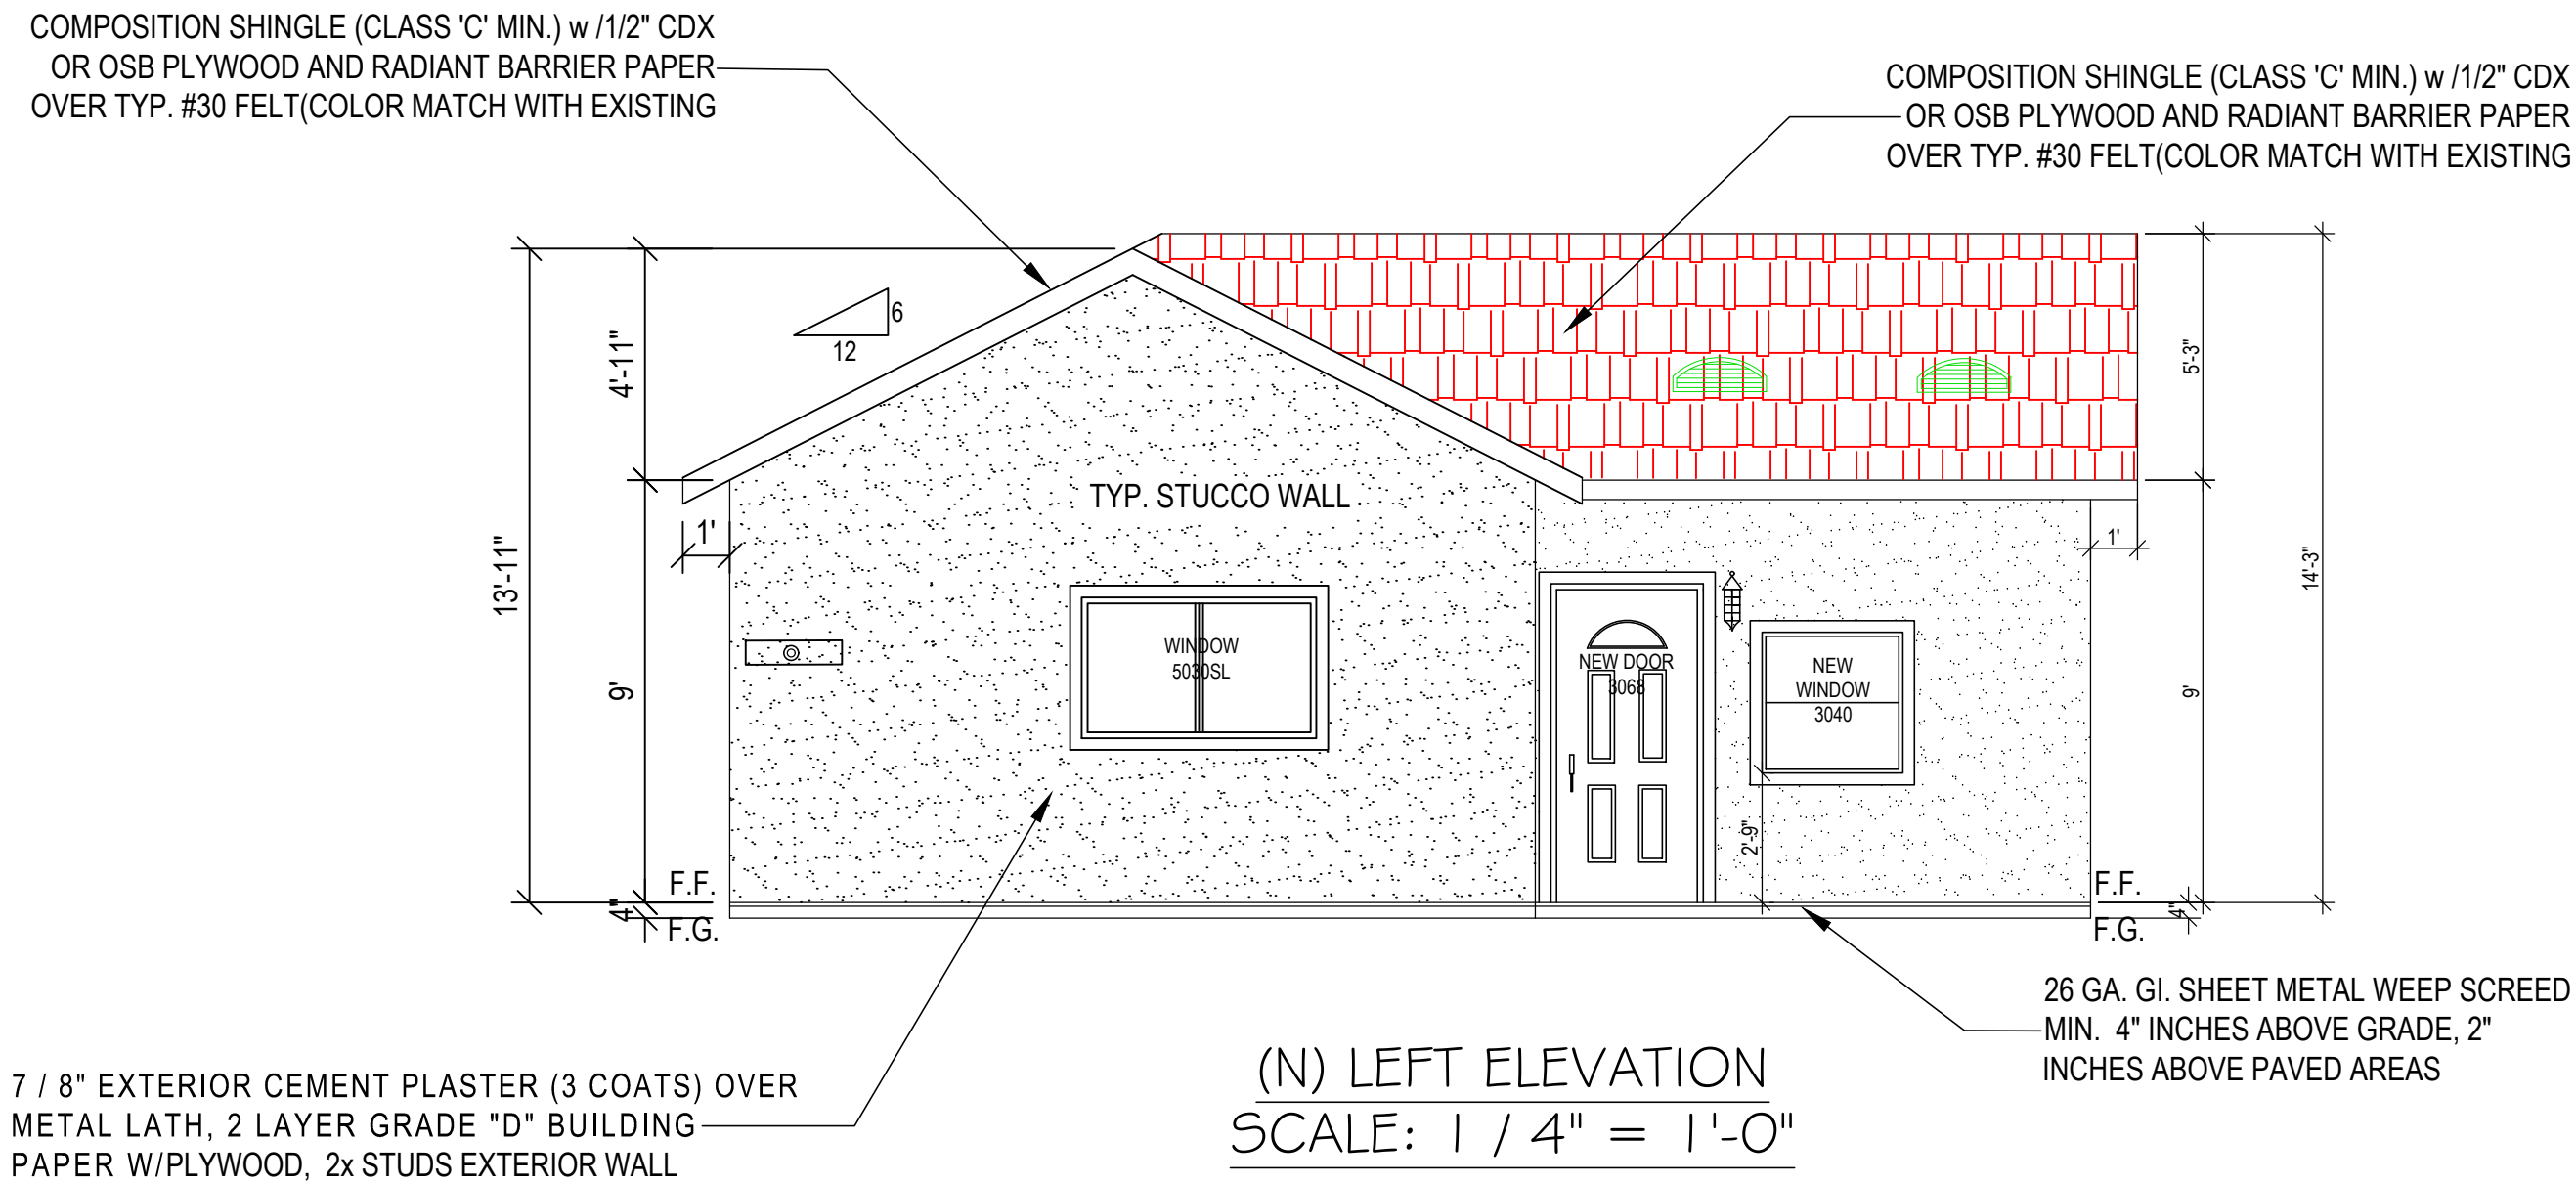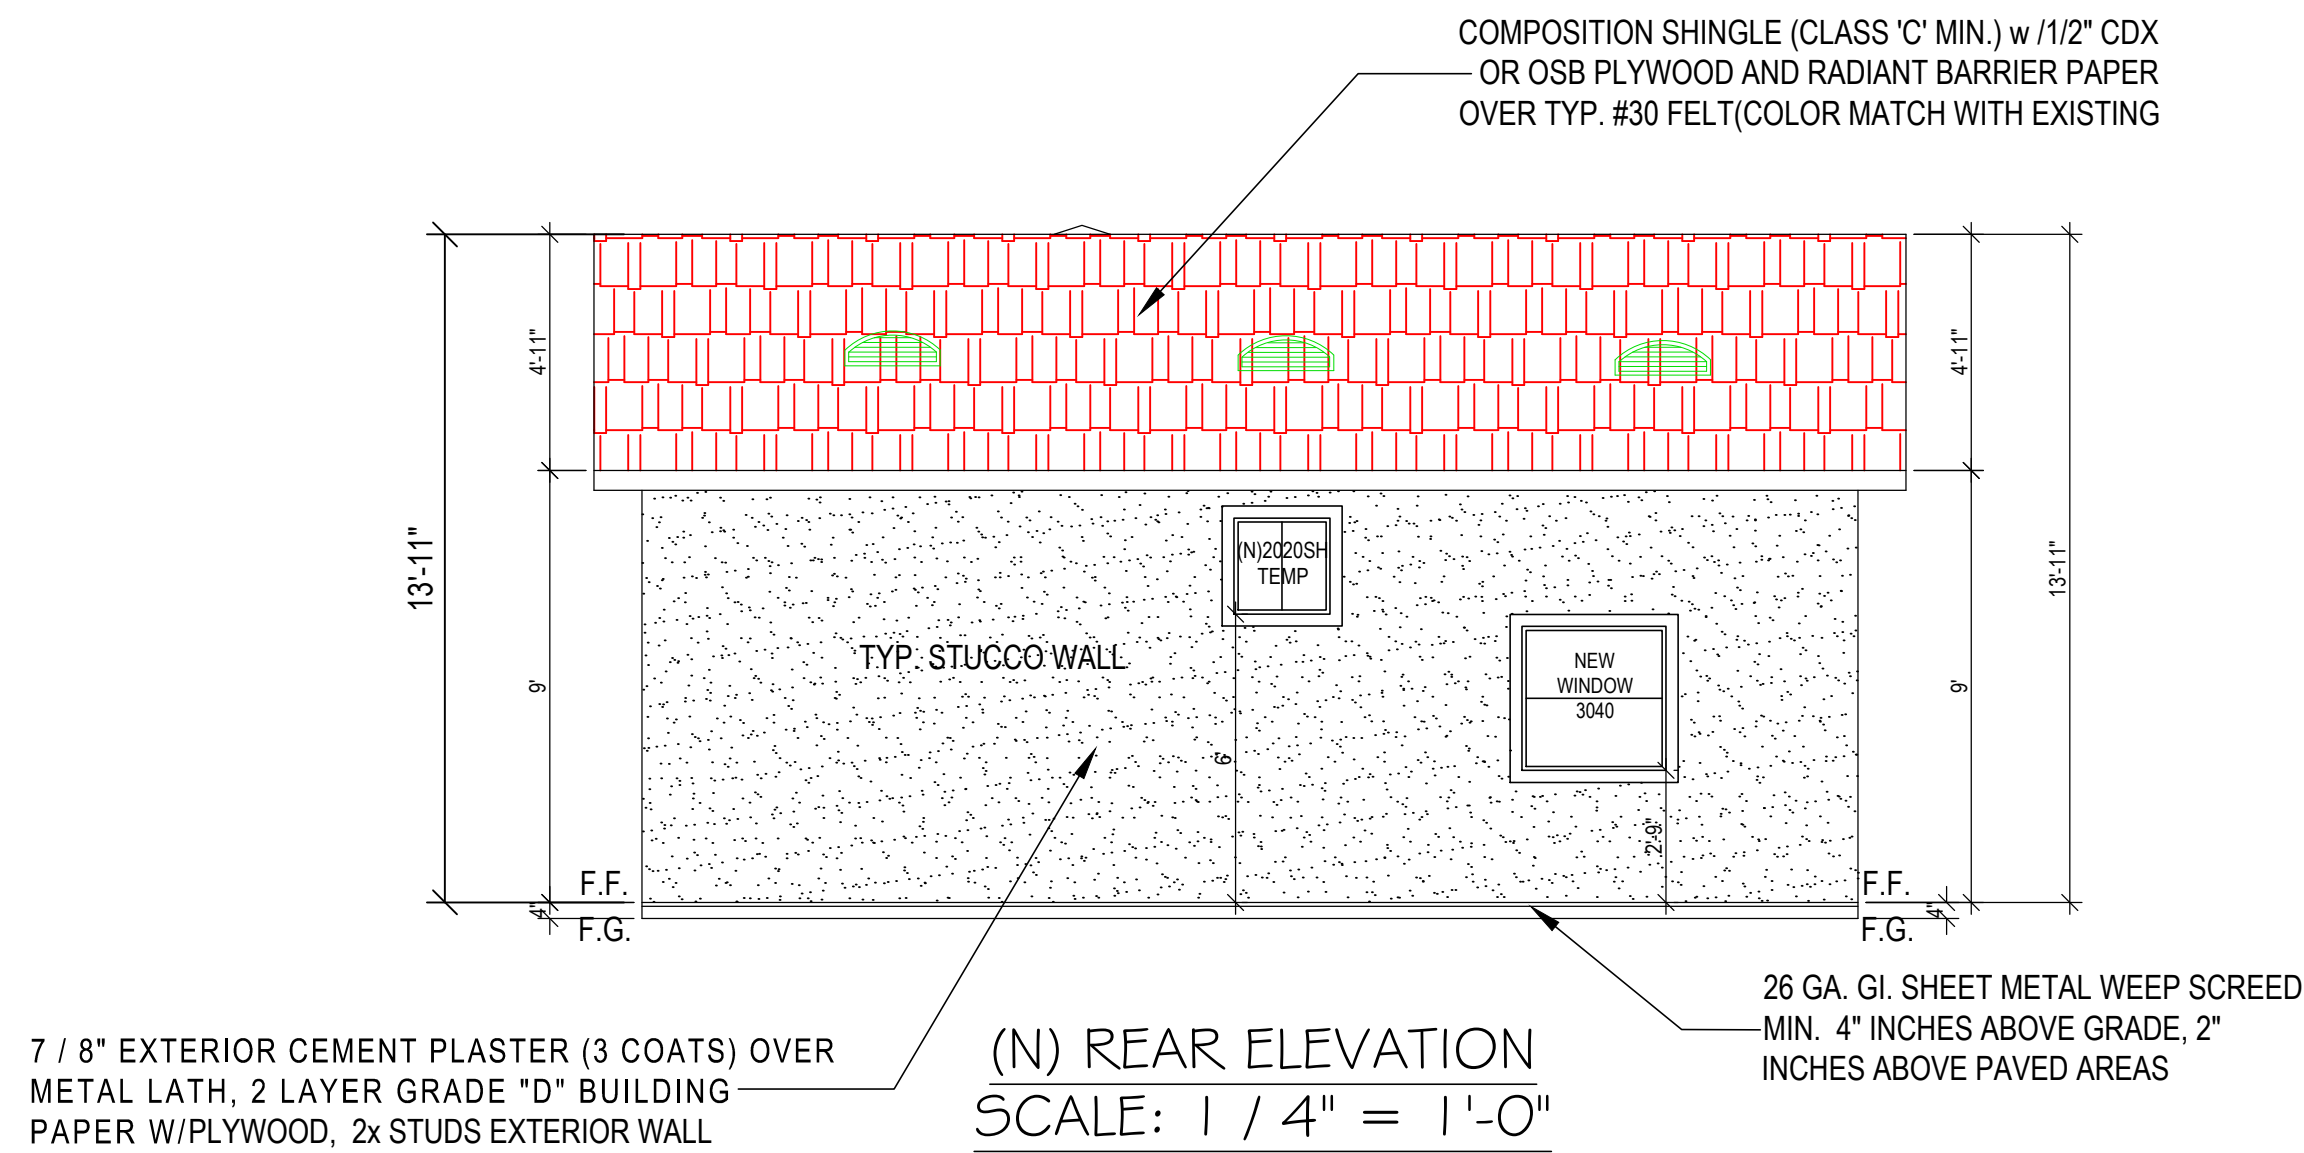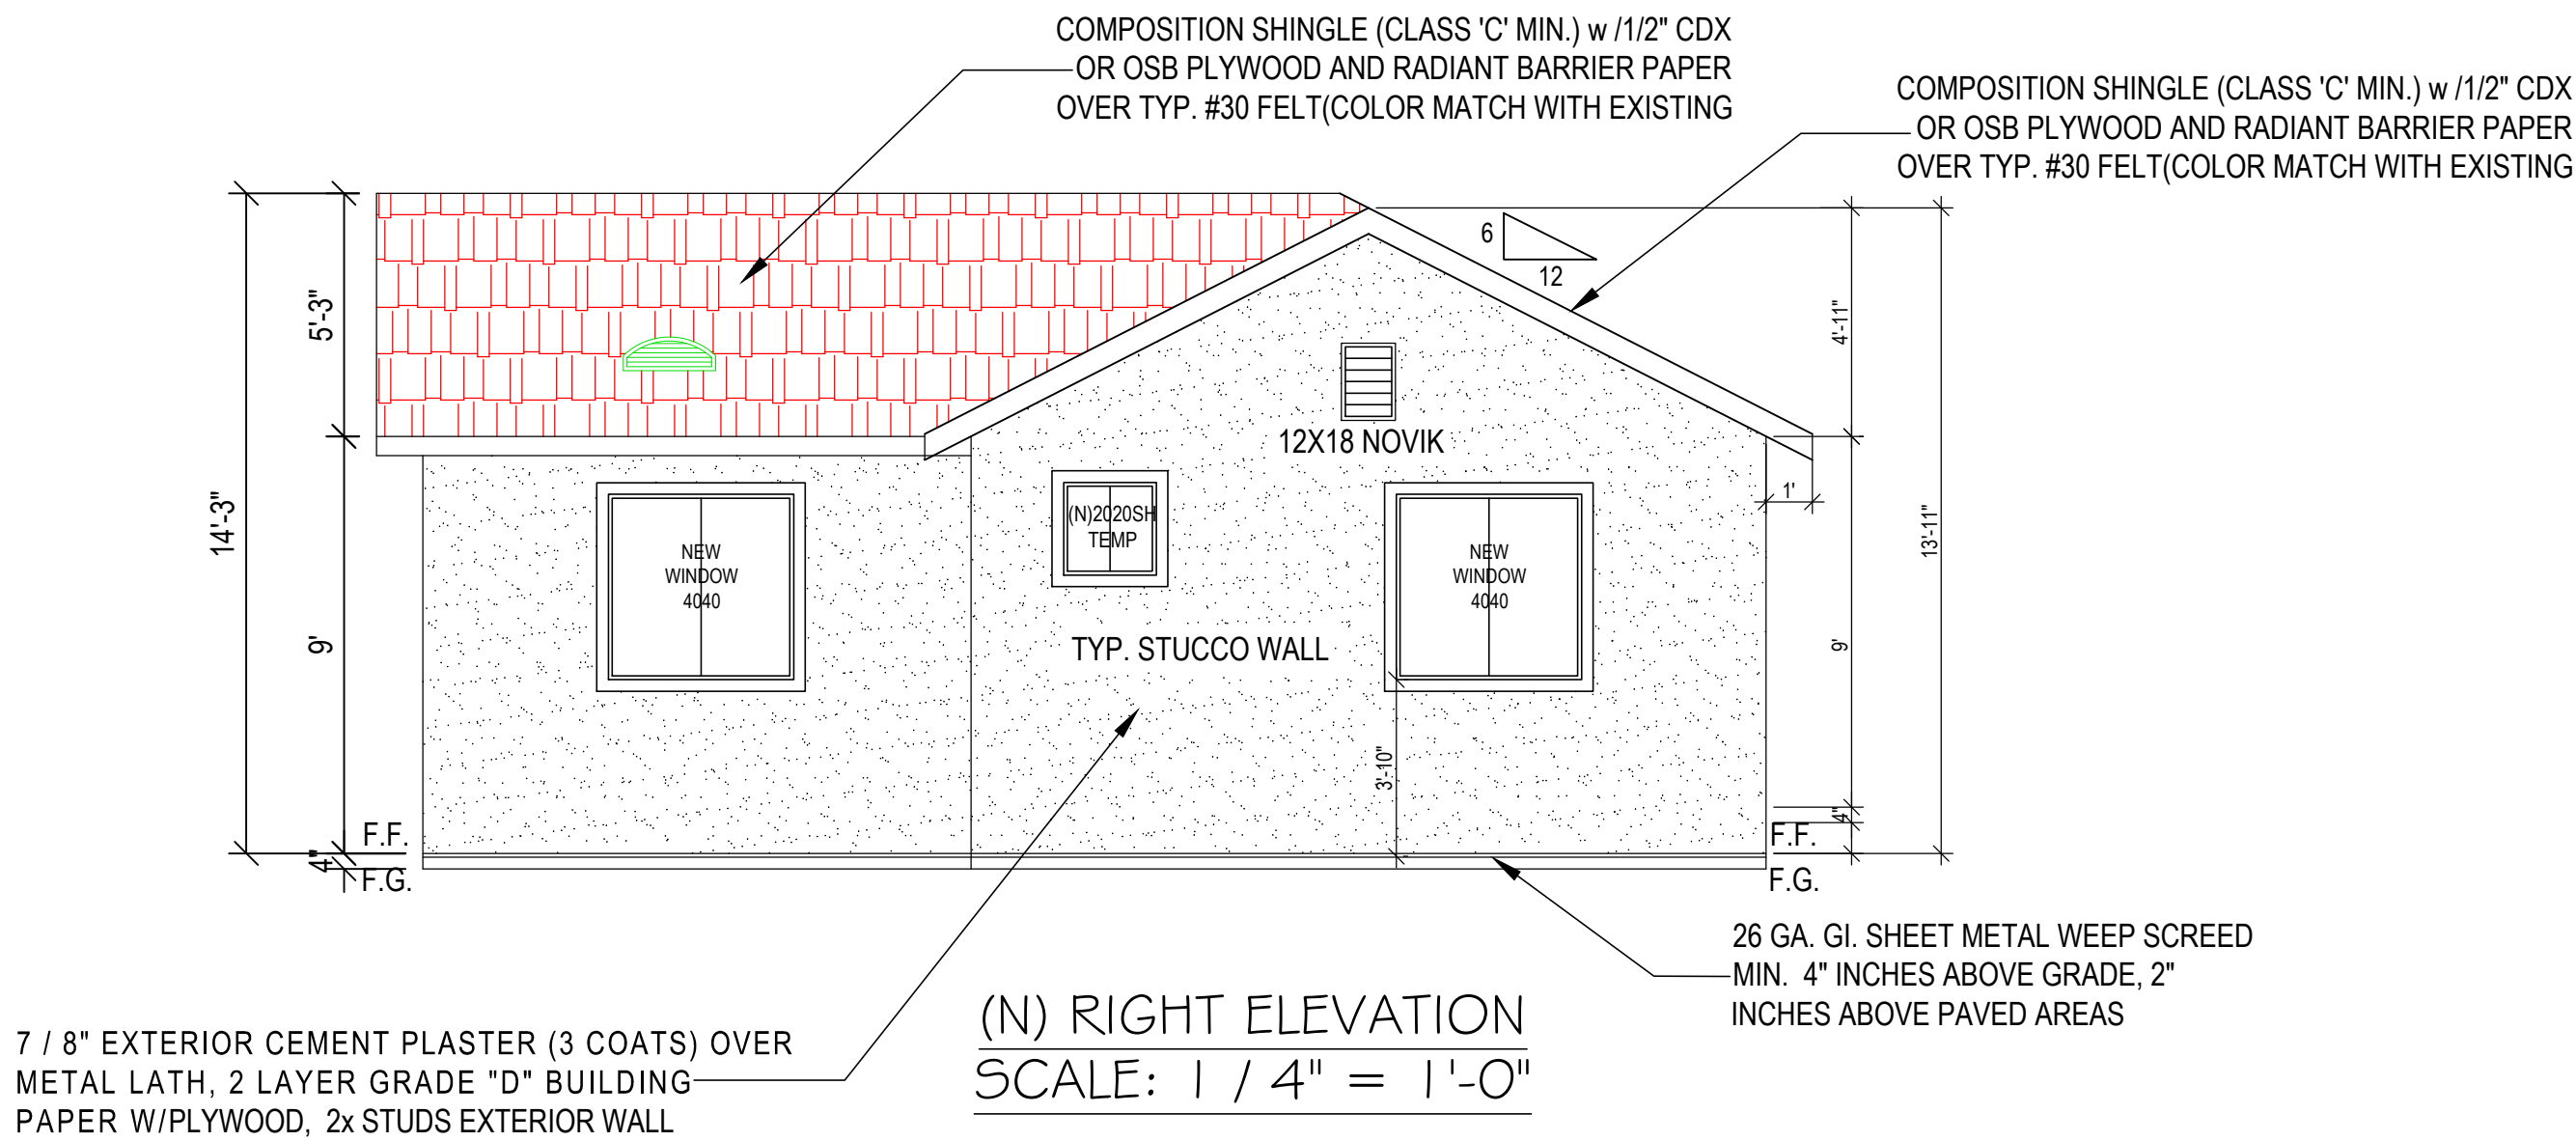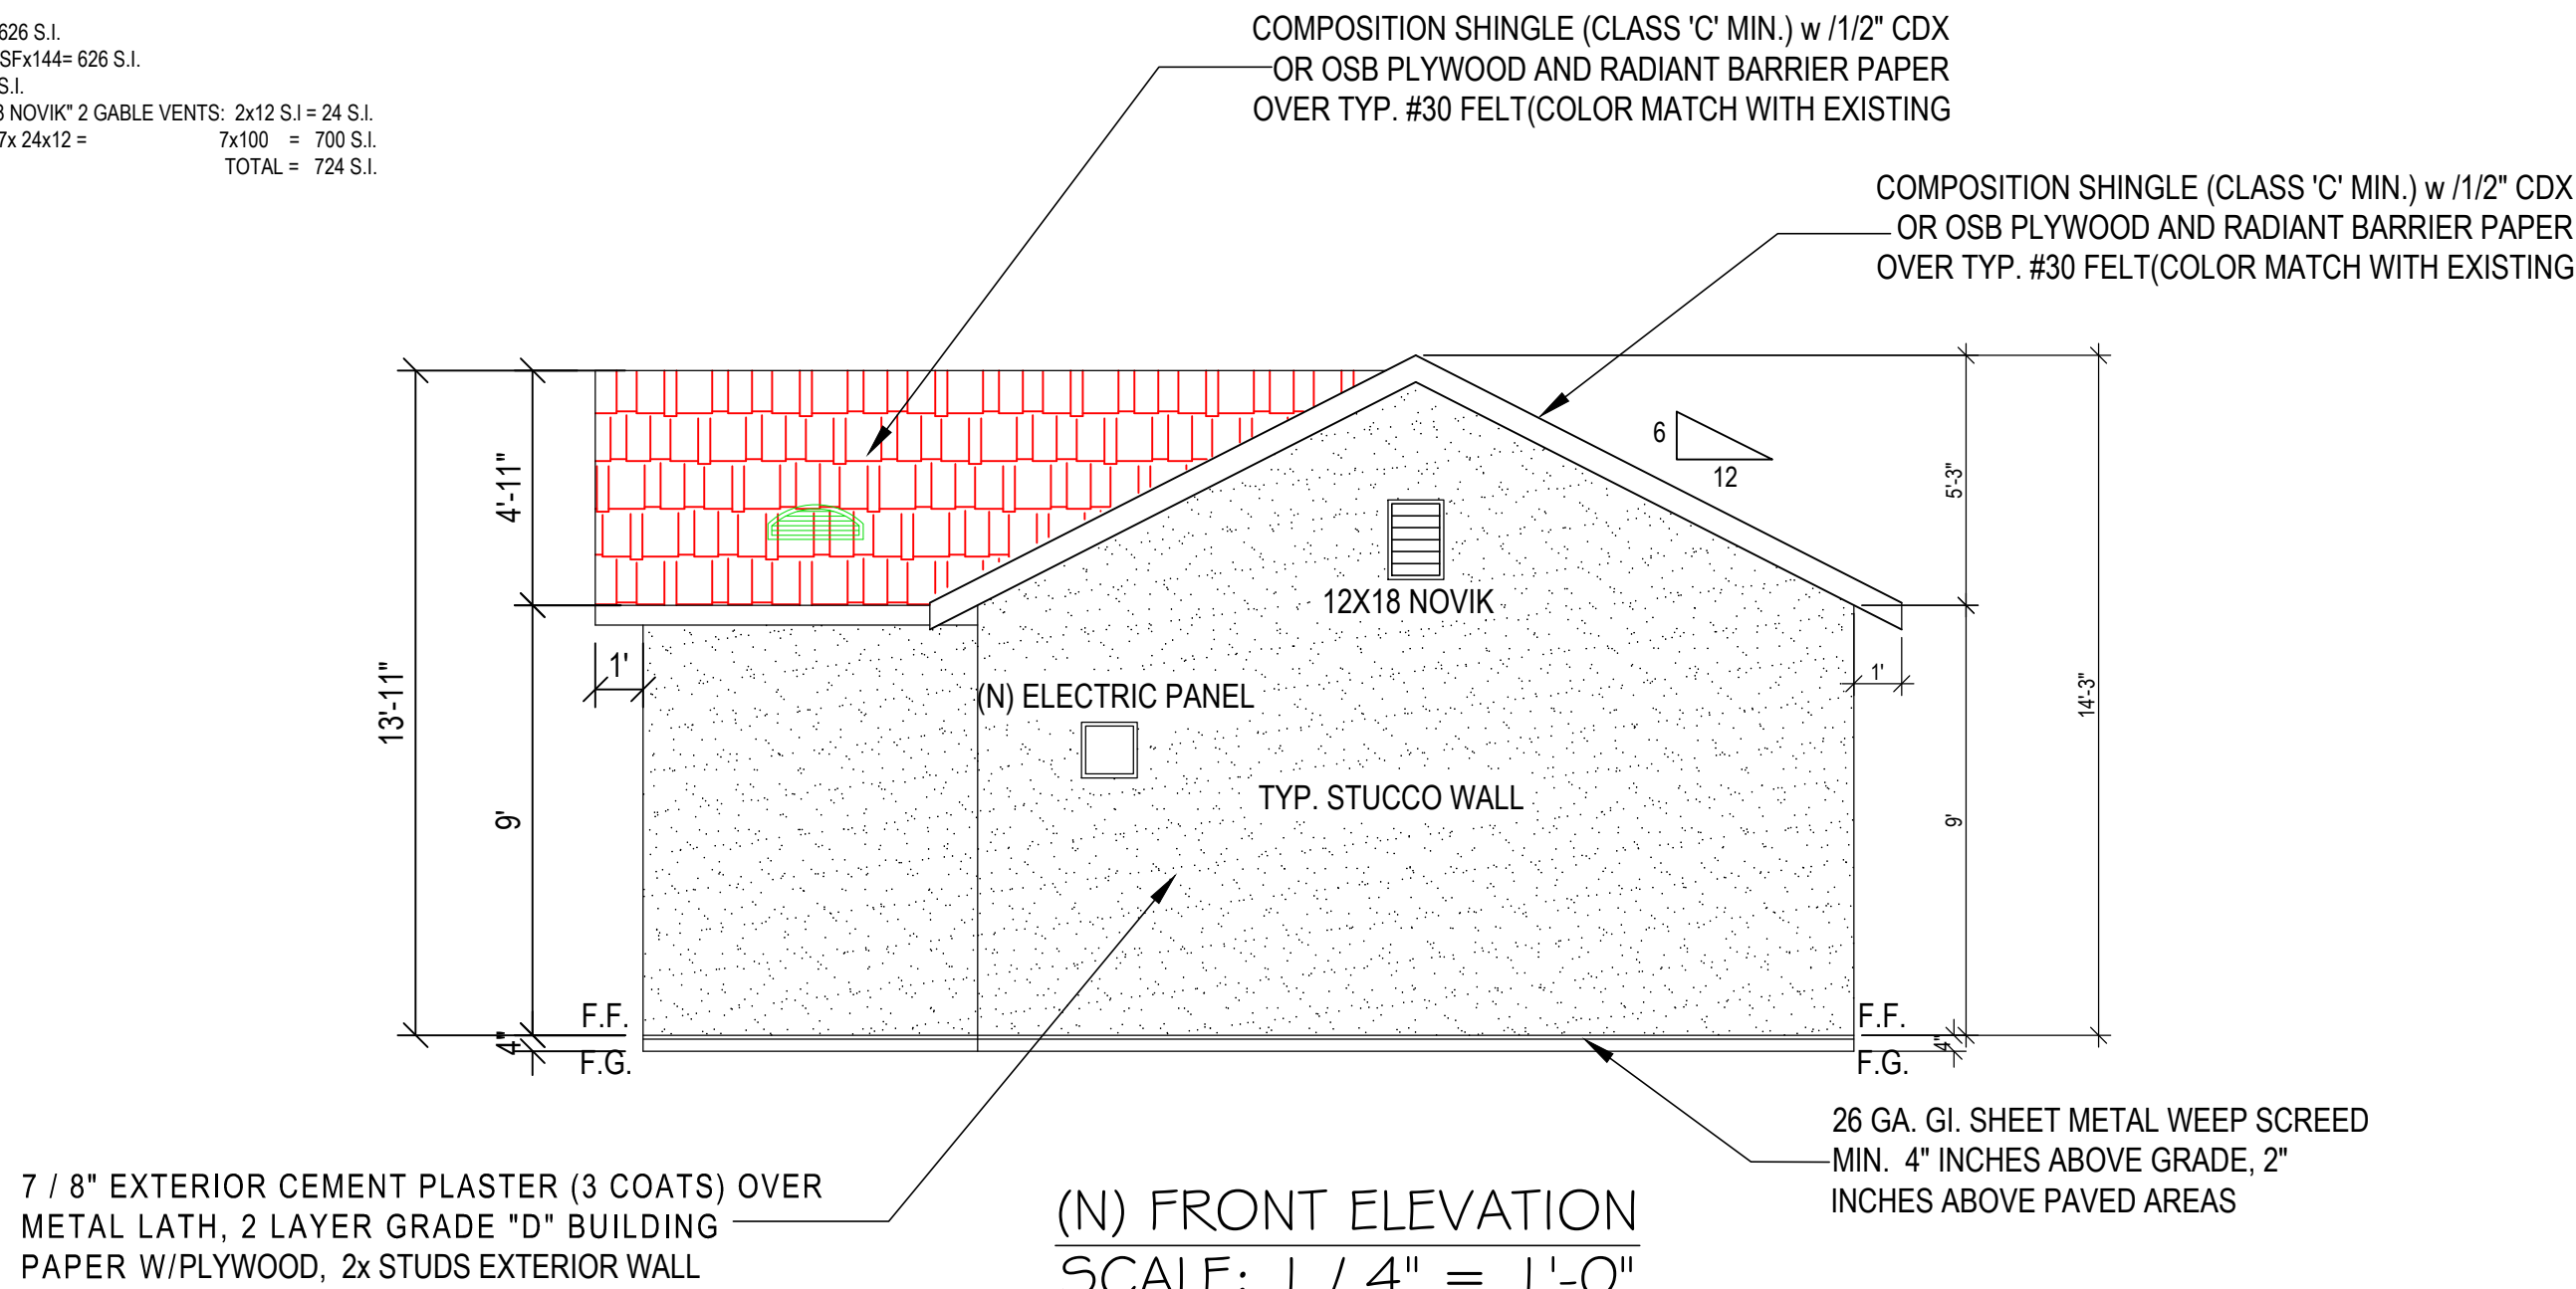

**BAJ**  
**GRAPHIC DESIGN**

9743 WHITE PINE WAY, ELK GROVE, CA 95624  
Email: helennguyen3689@gmail.com  
Tell: (916) 526-5881 & (408) 876-8402

Date: MAY 2024

Scale: AS SHOWN

Drawn: LUYEN HONG NGUYEN

Signed: *Thuy*

STAMPED FROM CITY

**JOB**  
**06/07/2024**

APPROVED  
By Tony Nguyen at 11:46 am, Jun 07, 2024

ELEVATION PLAN  
VINCENT VONG'S RESIDENCE  
6920 53Rd AVE,  
SACRAMENTO, CA 95828

REVISION	DATE	BY
△	05-30-2024	HL

SHEET NO:

**A-3**